

Accessibility Compliance Report For DA Application

Project Address: 96 - 98 Lethbridge St & 42 - 46 Evans St, Penrith NSW
Prepared For: Free Burnville Pty Ltd


Issue No: B
Issue Date: 02/12/2020
Report No: 20-109

Report Register:

The following report register documents the development and issue of this report as undertaken by Access Link Consulting Pty Ltd.

Report No.	Issue No.	Issue Date	Report Details
20-109	A	28/11/2020	Draft Issue
20-109	B	02/12/2020	Issue for DA

Yours Sincerely,



Rami Shakour
 Director

Bachelor of Architecture Degree
 Master of Project Management



Accredited Access Consultant – ACAA
 (Association of Consultants in Access,
 Australia, membership No. 488)



NDIS Accredited SDA Assessor
 (Reg No: SDA00030)



Diploma of Access
 Consulting



Livable Housing
 Australia - LHA (Reg
 No: 20157)



1.0 - Report Purpose:

This assessment has been undertaken to the necessary level to issue a DA “Development Application” under the environmental planning and assessment Act. based on the information provided.

The subject project achieves the spatial requirements to provide access for people with disability under the relevant standards and codes, it is required that a detailed assessment to be undertaken covering but not limited of internal fit-out, details for stairs, ramps, finishes, amenities and other features to occur at CC “Construction Certificate” stage.

By adopting the recommendation set in this report, compliance with the report basis will be achieved and equitable and dignified access for all users of the building/facility will be provided.

2.0 – Project Description and Use:

The proposed project consists of a total of 133 residential units above “two” levels of basement parking. A mix of units are provided as follow;

- One Bedroom Units – 14 Units
- Two Bedroom Units – 91 Units
- Three Bedroom Units – 28 Units

3.0 – Project Classification:

This accessibility compliance report for a proposed building with classification as set below:

- Class 2
- Class 7a

Note: The classification/s above is our understating of the relevant BCA classification/s. BCA consultant/certifier must confirm and determine the BCA classifications.

4.0 – Report Basis:

This report is based in the context of:

- National Construction Code, 2019 Volume One – Building Code of Australia (BCA).
 - DP1, DP2, DP8, DP9
 - EP3.4
 - FP2.1
 - Parts of D2, D3, E3 and F2
- AS 1428.1 – 2009
- AS 1428.4.1 – 2009
- AS 2890.6 – 2009
- AS 4299 – 1995
- AS 1735.12 – 1999
- Disability (Access to Premises-Building) Amended Standards 2020
- Australian Human Rights Commission’s Guidelines on application of APS version 2.
- Livable Housing Australia’s Livable Housing Design Guidelines – Fourth Edition

5.0 – Assessed Drawings:

Drawing No.	Drawing Title	Issue	Issue Date
DA-102	Ground Floor	A	27.11.2020
DA-103	Level 01-03	A	27.11.2020
DA-104	Level 04	A	27.11.2020
DA-105	Level 05	A	27.11.2020
DA-107	Basement 01	A	27.11.2020
DA-108	Basement 02	A	27.11.2020
DA-1413	Adaptable units	A	27.11.2020

6.0 – Copyright

- 6.1 The contents of this report are copyright and prepared only for the attention of the client on this project. The rights to this report are owned by Access Link Consulting Pty Ltd.
- 6.2 The contents of this report contain Standard Australia Ltd copyrighted materials and must not be reproduced, sold, published, combined with external documents or altered without the prior written permission of its distributor, SAI Global Ltd and Access Link Consulting Pty Ltd.
- 6.3 This report may be reproduced in accordance with the terms of SAI Global Ltd License 1704-c045-2 to Access Link Consulting Pty Ltd.

7.0 – Exclusions and Liabilities

- 7.1 This Clause operates simultaneously with the terms set out in Access Link Consulting Pty Ltd.'s Fee Proposal/Cost Agreement.
- 7.2 Access Link Consulting Pty Ltd is only retained for the purpose of producing information relating to Access in the context of the codes, standards, regulations and guidelines listed in Clause 4.0 of this report. Access Link Consulting Pty Ltd is not liable for producing any other information outside this context.
- 7.3 The client acknowledges the following:
 - 7.3.1 This report is solely for the purpose of reviewing, identifying and advising on Access issues/Access related provisions of the BCA.
 - 7.3.2 This report does not identify or cover any information, compliance matters or issues that are related to other services associated to this project.
The client is aware that it is the architect's responsibility to coordinate and check all services against the information and requirements provided in this report to ensure that compliance has been met and achieved.
 - 7.3.3 This report does not identify or cover any information, compliance matters or issues in relation to the construction stage of this project.
The client is aware that it is the builder's responsibility to coordinate and check that all the information and requirements provided in this report are met and achieved during the construction stage of this project.
 - 7.3.4 This report does not identify or cover checks for:
 - a) Slip resistance in surfaces such as set areas, parking areas, common spaces or stairs; and/or,
 - b) Wall reinforcement once the walls have already been constructed.*The client is aware that it is the builder's responsibility to ensure that the requirements are met as per AS 1428.1, AS 4299, AS 2890, AS 3661, AS 4586 and any other relevant codes that may arise.*
 - 7.3.5 Our Report does not assess compliance matters related to the following:
 - a. Work, Health and Safety;
 - b. Structural design;
 - c. Service Design; and/or,
 - d. Parts of the Disability Discrimination Act other than those that relate to the APS, Parts of BCA or Parts of AS other than those directly referenced in our Report.
 - 7.3.6 Access Link Consulting Pty Ltd does not guarantee or warrant that our Report is correct or complete and will not be liable for any losses arising from the reliance upon or use of our Report.
 - 7.3.7 Should the Client engage services with another certifier or access consultant, we are not liable if that certifier or access consultant comes to a different conclusion in their report.


- 7.4 Access Link Consulting Pty Ltd is therefore not liable for any other services that are associated to this project.
- 7.5 Except as required by law, Access Link Consulting Pty Ltd is not liable for any inaccurate or incorrect information in this report supplied by SAI Global Ltd.
- 7.6 This document/report is based on the classification of this project and the drawings set out in Clause 6.0 of this report. In the event that changes are made to the classification or drawings, this report will be deemed invalid and will be required to be updated accordingly.

Yours Sincerely,



Rami Shakour

Director

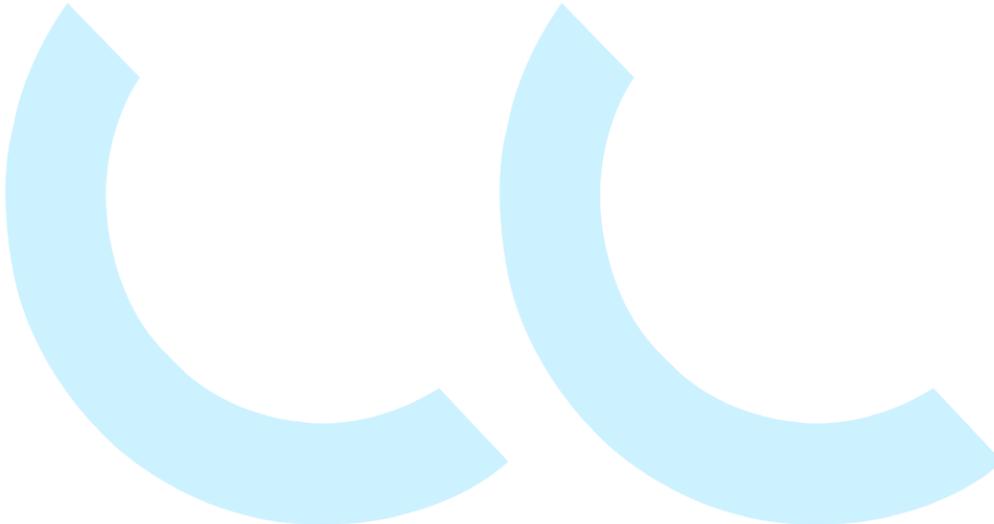

Checklist Assessment Related to the Requirements Set in the BCA

The extract clauses from the NCC, 2019 Volume 1 – BCA below to be read in full format as set in the National Construction Code, 2019 Volume 1 – Building Code of Australia.

Part D3 – Access For People With Disability

D3.1 General Building Access Requirements	ADR	N/A	C
Buildings and parts of buildings must be accessible: Class 2			
I. From a pedestrian entrance required to be accessible to at least 1 floor containing sole-occupancy units.	<input type="checkbox"/>	<input type="checkbox"/>	✓
II. To the entrance doorway of each sole-occupancy unit located on that level.	<input type="checkbox"/>	<input type="checkbox"/>	✓
III. To and within each type of room or space for use in common by the residents.	<input type="checkbox"/>	<input type="checkbox"/>	✓
IV. Where a floor is accessed via an AS 1428.1 Ramp or passenger lift, all entrance doors to sole occupancy units and common spaces used by residents located on the levels served by the lift or ramp.	<input type="checkbox"/>	<input type="checkbox"/>	✓
Reference: Figure 1, Figure 2, Figure 3, Figure 4 Notes: See Att.01			
Class 7a			
• To and within any level containing accessible car parking spaces.	<input type="checkbox"/>	<input type="checkbox"/>	✓
D3.2 Access To Buildings	ADR	N/A	C
(a) Access way must be provided to a building;			
I. From the main points of a pedestrian entry at the allotment boundary	<input type="checkbox"/>	<input type="checkbox"/>	✓
II. From another accessible building connected by a pedestrian link	<input type="checkbox"/>	<input type="checkbox"/>	✓
III. From any required accessible car parking space on the allotment	<input type="checkbox"/>	<input type="checkbox"/>	✓
Reference: Figure 6, Figure 7, Figure 9, Figure 11, Figure 12, Figure 13, Figure 14 Notes: See Att.01 – Building A & Building B are connected together with a continues path of travel. In addition, a continues step free access way from the main points of a pedestrian entry at the allotment boundary to both building “A” & “B” are provided.			
(b) In a building required to be accessible,			
I. an accessway must be provided through the principal pedestrian entrance,	<input type="checkbox"/>	<input type="checkbox"/>	✓
II. through not less than 50% of all pedestrian entrances including the principal pedestrian entrance; and	<input type="checkbox"/>	<input type="checkbox"/>	✓
III. in a building with a total floor area more than 500 m2, a pedestrian entrance which is not accessible must not be located more than 50 m from an accessible pedestrian entrance.	<input type="checkbox"/>	<input type="checkbox"/>	✓
Notes: See Att.01 – The main pedestrian entrances at Lethbridge & Evan Street are both accessible.			
(c) Where a pedestrian entrance required to be accessible has multiple doorways—			
I. if the pedestrian entrance consists of not more than 3 doorways — not less than 1 of those doorways must be accessible;	<input type="checkbox"/>	<input type="checkbox"/>	✓
II. if a pedestrian entrance consists of more than 3 doorways — not less than 50% of those doorways must be accessible	<input type="checkbox"/>	✓	<input type="checkbox"/>
Notes: See Att.01 – Can be compliant at CC stage			
(d) Access way must have a clear opening of 850mm in accordance with 1428.1	<input type="checkbox"/>	<input type="checkbox"/>	✓
Reference: Notes: See Att.01 – Can be compliant at CC stage			
D3.3 Access To Buildings	ADR	N/A	C
(a) every ramp and stairway must comply with;			
I. For a ramp, clause 10 of AS 1428.1	<input type="checkbox"/>	<input type="checkbox"/>	✓
II. For a stairway, clause 11 of AS 1428.1	<input type="checkbox"/>	<input type="checkbox"/>	✓
III. For a fire isolated stair, clause 11.1(f) and (g) of AS 1428.1	<input type="checkbox"/>	<input type="checkbox"/>	✓
Reference: Figure 4, Figure 5, Figure 6, Figure 7, Figure 8, Figure 9, Figure 10, Figure 11, Figure 12, Figure 13, Figure 14, Figure 15 Notes: See Att.01 – Can be compliant at CC stage			

(b) every passenger lift must comply with E3.6 Reference: Notes: See Att.01 – Can be compliant at CC stage & as per manufacture details	<input type="checkbox"/>	<input type="checkbox"/>	✓
(c) access ways must have; I. Passing spaces complying with AS 1428.1 II. Turning spaces complying with AS 1428.1 i. Within 2m of the end of access ways where it is not possible to continue. ii. at maximum 20m intervals along the access way Reference: Figure 1, Figure 2, Figure 3 Notes: See Att.01 – Can be compliant at CC stage	<input type="checkbox"/>	<input type="checkbox"/>	✓
(d) an intersection of access way satisfies the spatial requirements for a passing and turning space Reference: Figure 1 Notes: See Att.01 – Can be compliant at CC stage	<input type="checkbox"/>	<input type="checkbox"/>	✓
(e) a passing space may serve as a turning space Reference: Figure 1 Notes: See Att.01 – Can be compliant at CC stage	<input type="checkbox"/>	<input type="checkbox"/>	✓
(f) a ramp complying with AS 1428.1 or a passenger lift need not be provided to serve a storey or level other than the entrance storey in class 5, 6, 7b or 8 I. Containing not more than 3 storeys and II. With a floor area for each storey, excluding the entrance storey, of not more than 200m ² Notes: Notes on plans – Can be compliant at CC stage	<input type="checkbox"/>	✓	<input type="checkbox"/>
(g) Clause 7.4.1(a) of AS 1428.1 does not apply. Replaces with pile thickness not exceeding 11mm and carpet backing thickness not exceeding 4mm Notes: Notes on plans – Can be compliant at CC stage	<input type="checkbox"/>	<input type="checkbox"/>	✓
D3.4 Exemptions	ADR	N/A	C
Areas are not required to be accessible; (a) when access is not inappropriate because of particular purpose for which the area is used (b) an area which poses a health or safety risk for people with disability (c) path of travel providing access only to an area exempt by (a) or (b) Reference: Notes: See Att.01 – areas such as pump room, switch room any serviceable areas/room or the like are not required to be accessible	<input type="checkbox"/>	<input type="checkbox"/>	✓
D3.5 Accessible car parking	ADR	N/A	C
(a) in accordance with table D3.5; I. Class 7a required to be accessible II. A car parking area on the same allotment as a building required to be accessible (b) Not required in class 7a where a parking service is provided and direct access to any of the car parking spaces is not available to the public. (c) must comply AS/NZS 2890.6 (d) need not be identified with signage where there is a total of not more than 5 carparking spaces, so as to restrict the use of the carparking space only for people with a disability. Reference: Figure 22 Notes: See Att.01 – Proposed Adaptable parking spaces can be compliance at CC stage. Total of 14 adaptable parking spaces are provided, “7” of them have been designed as per AS 4299.	<input type="checkbox"/>	<input type="checkbox"/>	✓
	<input type="checkbox"/>	✓	<input type="checkbox"/>
	<input type="checkbox"/>	<input type="checkbox"/>	✓
	<input type="checkbox"/>	✓	<input type="checkbox"/>

All braille and tactile signage must comply with Specification D3.6 braille and tactile signs Reference: Figure 19 Notes: Can be compliant at CC stage	<input type="checkbox"/>	<input type="checkbox"/>	✓
D3.7 Hearing augmentation	ADR	N/A	C
(a) a hearing augmentation system must be provided where an inbuilt amplification system other than the one used only for emergency warning, is installed;			
I. In a room in a Class 9b building	<input type="checkbox"/>	✓	<input type="checkbox"/>
II. In an auditorium, conference room, meeting room or room for judicatory purposes	<input type="checkbox"/>	✓	<input type="checkbox"/>
III. At any ticket office, teller's booth, reception area or the like, where the public is screened from the service provider	<input type="checkbox"/>	✓	<input type="checkbox"/>
Notes: Does not apply to this class			
D3.8 Tactile indicators	ADR	N/A	C
(a) For a building required to be accessible, tactile ground surface indicators must be provided to warn people who are blind or have a vision impairment that they are approaching—			
I. A stairway, other than a fire-isolated stairway.	<input type="checkbox"/>	<input type="checkbox"/>	✓
II. An escalator.	<input type="checkbox"/>	✓	<input type="checkbox"/>
III. A passenger conveyor or moving walk.	<input type="checkbox"/>	✓	<input type="checkbox"/>
IV. A ramp other than a fire-isolated ramp, step ramp, kerb ramp or swimming pool ramp.	<input type="checkbox"/>	<input type="checkbox"/>	✓
V. Under an overhead obstruction less than 2 m above floor level, other than a doorway if no barrier is present.	<input type="checkbox"/>	✓	<input type="checkbox"/>
VI. Or when an access way meets a vehicular way adjacent to any pedestrian entrance to a building, if there is no kerb or kerb ramp present.	<input type="checkbox"/>	✓	<input type="checkbox"/>
Reference: Figure 04, Figure 12, Figure 15 Notes: See Att.01 – TGSI's to be made compliant at CC stage			
(b) Tactile ground surface indicators must comply with sections 1 and 2 of AS/NZS 1428.4.1. Reference: Figure 15 Notes: See Att.01 – Can be complaint at CC stage	<input type="checkbox"/>	<input type="checkbox"/>	✓
(c) A hostel for the aged, nursing home for the aged, a residential aged care building Class 3 accommodation for the aged, Class 9a health-care building or a Class 9c building need not comply with (a)(i) and (iv) if handrails incorporating a raised dome button in accordance with the requirements for stairway handrails in AS 1428.1 are provided to warn people who are blind or have a vision impairment that they are approaching a stairway or ramp.	<input type="checkbox"/>	✓	<input type="checkbox"/>
D3.9 Wheelchair seating spaces in Class 9b assembly buildings	ADR	N/A	C
Only applicable for class 9b building	<input type="checkbox"/>	✓	<input type="checkbox"/>
D3.10 Swimming pools	ADR	N/A	C
Only applicable where swimming pool is provided	<input type="checkbox"/>	✓	<input type="checkbox"/>
D3.11 Ramps	ADR	N/A	C
(a) a series of connected ramps must not have a combined vertical rise of more than 3.6m	<input type="checkbox"/>	✓	<input type="checkbox"/>
(b) a landing for a step ramp must not overlap a landing for another step ramp or ramp	<input type="checkbox"/>	✓	<input type="checkbox"/>
D3.12 Glazing on an access way	ADR	N/A	C
On an access way where there is no chair rail, handrail or transom, all frameless or fully glazed doors, sidelights and any glazing capable of being mistaken for a doorway or opening, must be clearly marked in accordance with AS 1428.1 Reference: Figure 16 Notes: Can be compliant at CC stage	<input type="checkbox"/>	<input type="checkbox"/>	✓

The references below to be read as set and referenced in each section of part D3

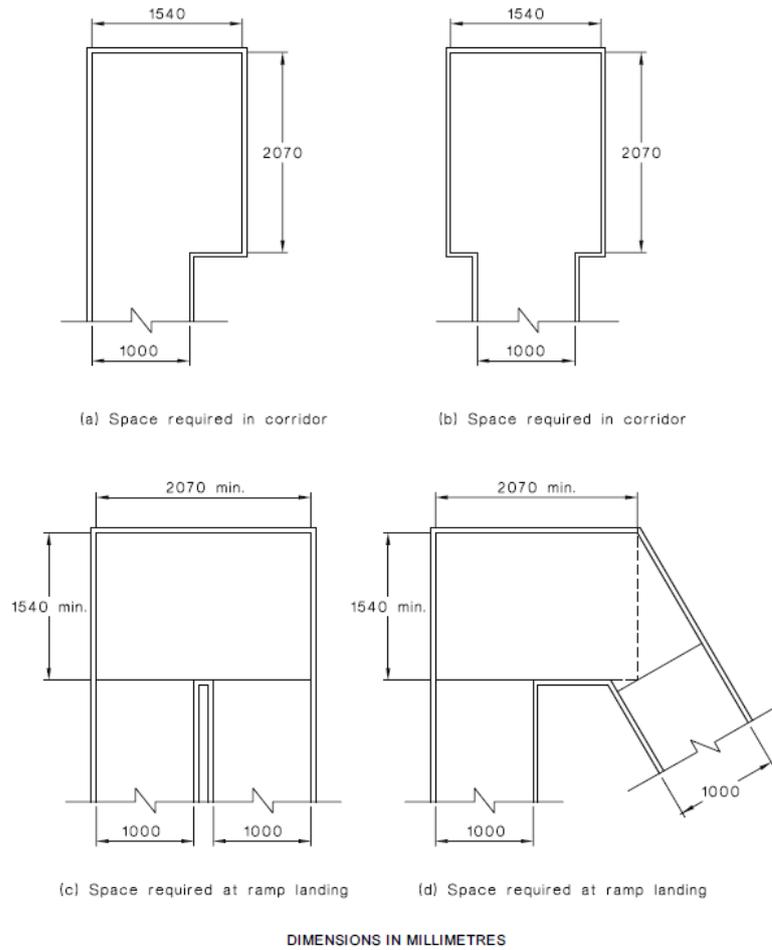


Figure 1

SAI Global Ltd License 1704-c045-2

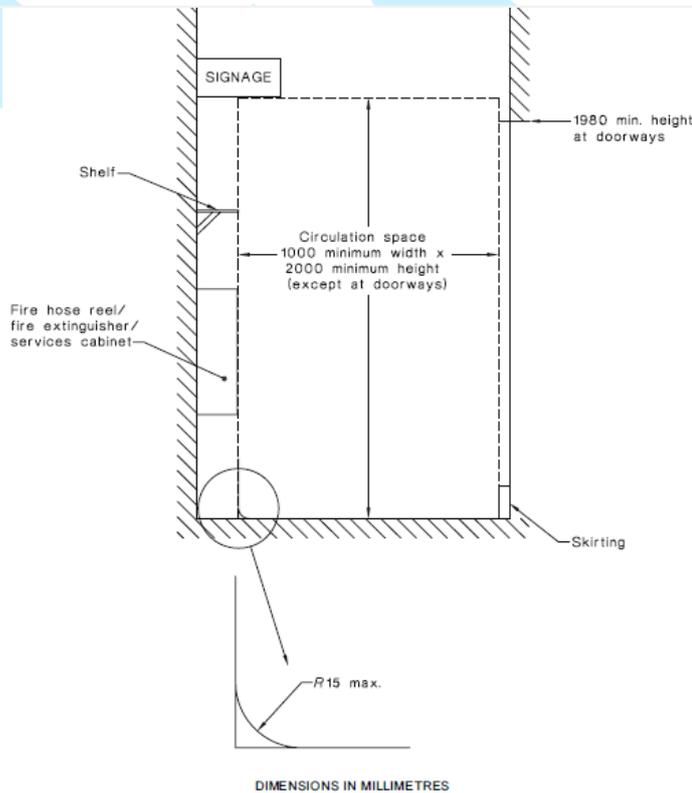


Figure 2

SAI Global Ltd License 1704-c045-2

Unless otherwise specified (such as at doors, curved ramps and similar), the minimum unobstructed width (see Figure 2) of a continuous accessible path of travel shall be 1000 mm and the following shall not intrude into the minimum unobstructed width of a continuous accessible path of travel:

- (a) Fixtures and fittings such as lights, awnings, windows that, when open, intrude into the circulation space, telephones, skirtings and similar objects.
- (b) Essential fixtures and fittings such as fire hose reels, fire extinguishers and switchboards.
- (c) Door handles less than 900 mm above the finished floor level.

Figure 3

SAI Global Ltd License 1704-c045-2


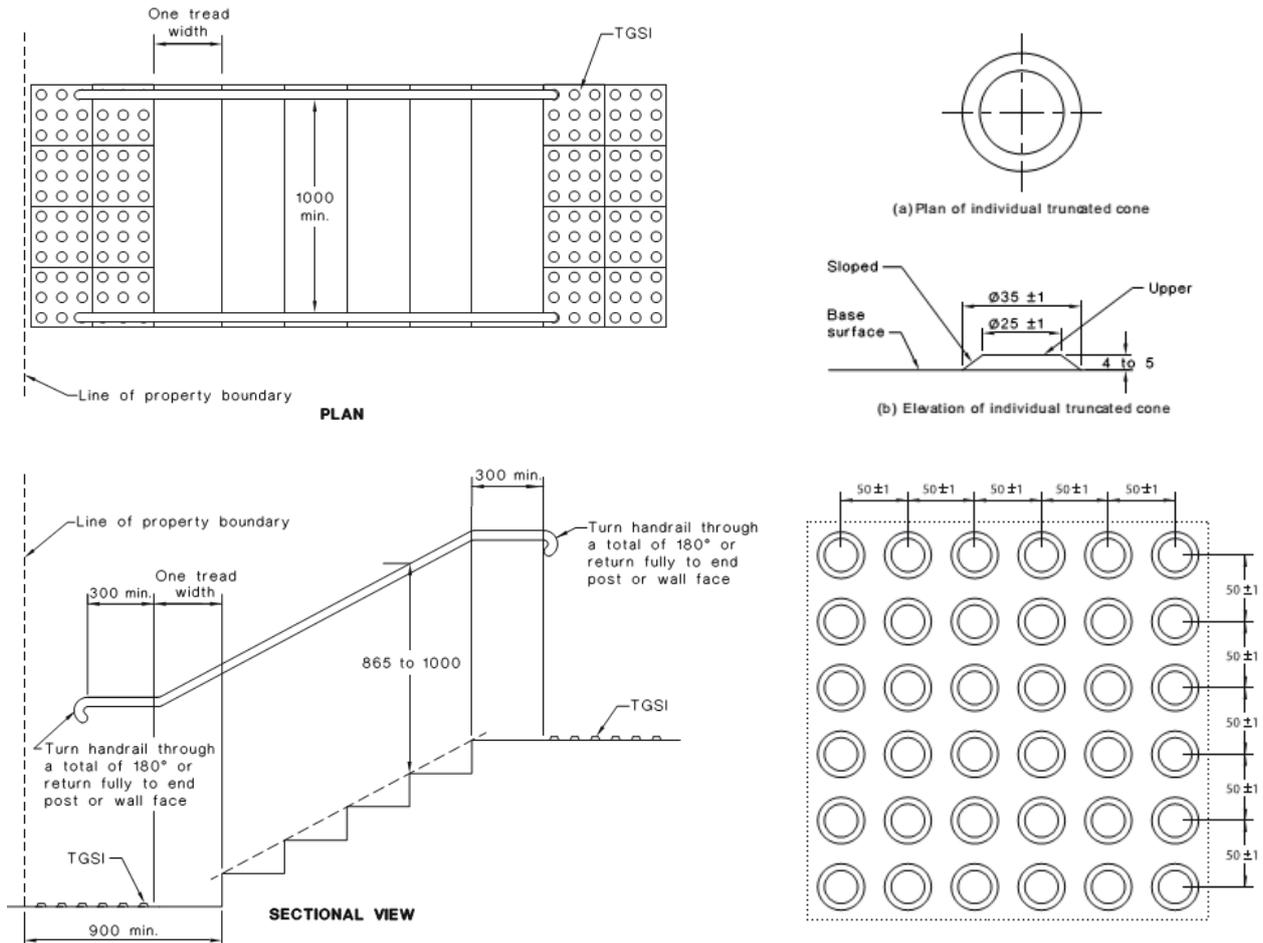


Figure 4

SAI Global Ltd License 1704-c045-2

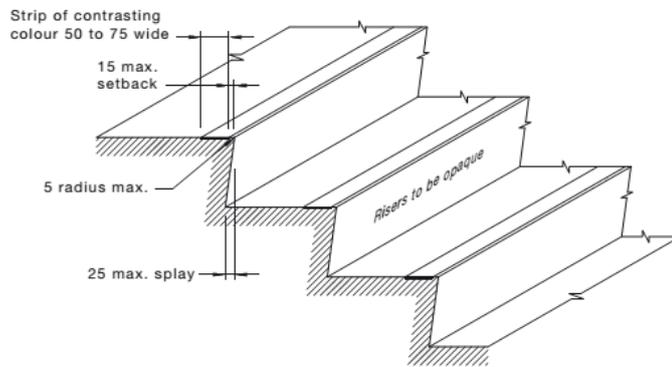


NOTE: A chamfered nosing 5 x 5 mm may be used.

DIMENSIONS IN MILLIMETRES

FIGURE 27(A) A TYPICAL STAIR NOSING PROFILE WITH NOSING STRIP

Figure 5


SAI Global Ltd License 1704-c045-2

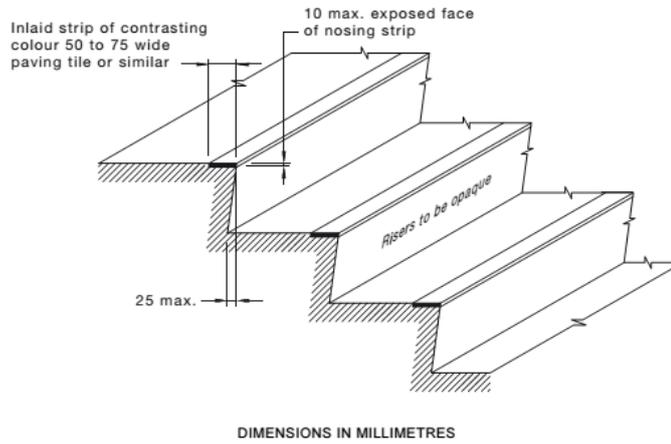

DIMENSIONS IN MILLIMETRES

FIGURE 27(B) A TYPICAL STAIR NOSING PROFILE WITH EXPOSED NOSING STRIP

Figure 6 SAI Global Ltd License 1704-c045-2

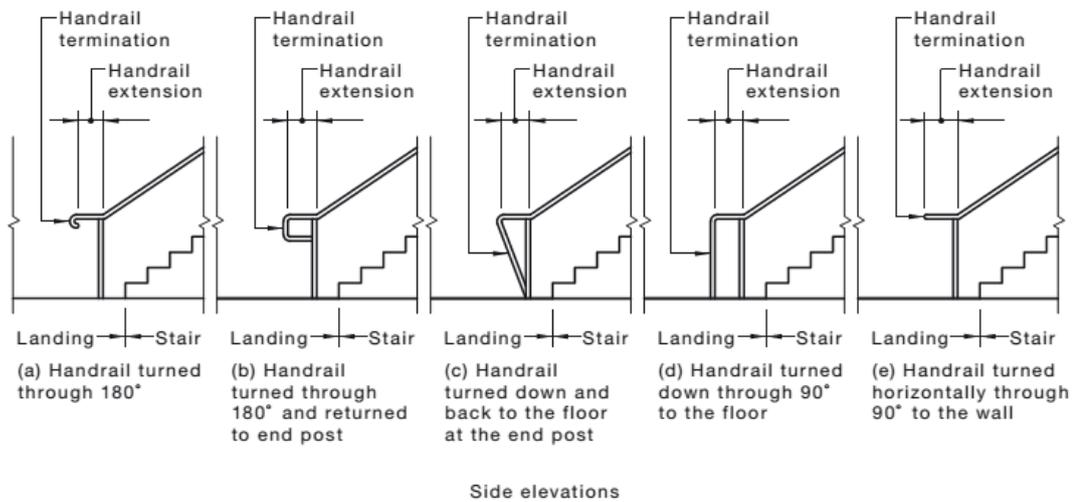


Side elevations

FIGURE 26(C) STAIR HANDRAILS—HANDRAIL TERMINATIONS

Figure 7

SAI Global Ltd License 1704-c045-2

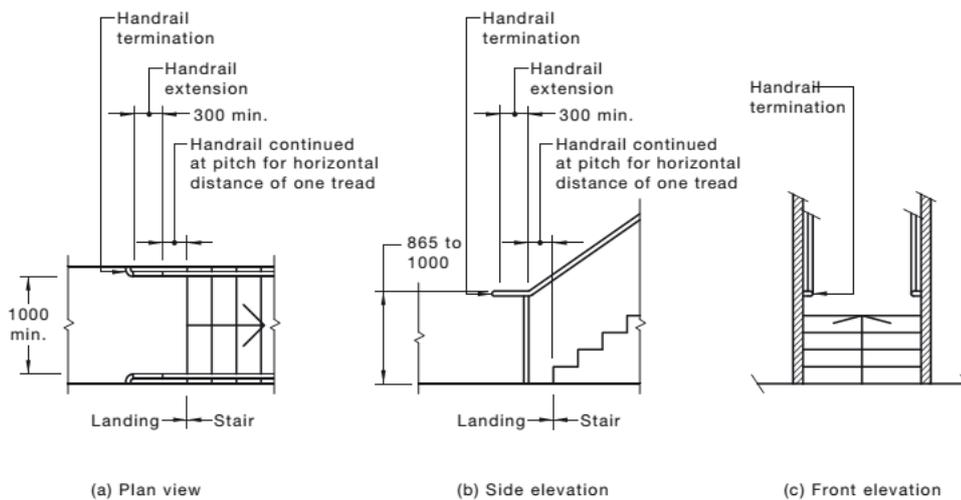

DIMENSIONS IN MILLIMETRES

FIGURE 26(D) DETAIL FOR HANDRAILS TERMINATED BY TURNING HORIZONTALLY THROUGH 90° TO THE WALL

Figure 8

SAI Global Ltd License 1704-c045-2

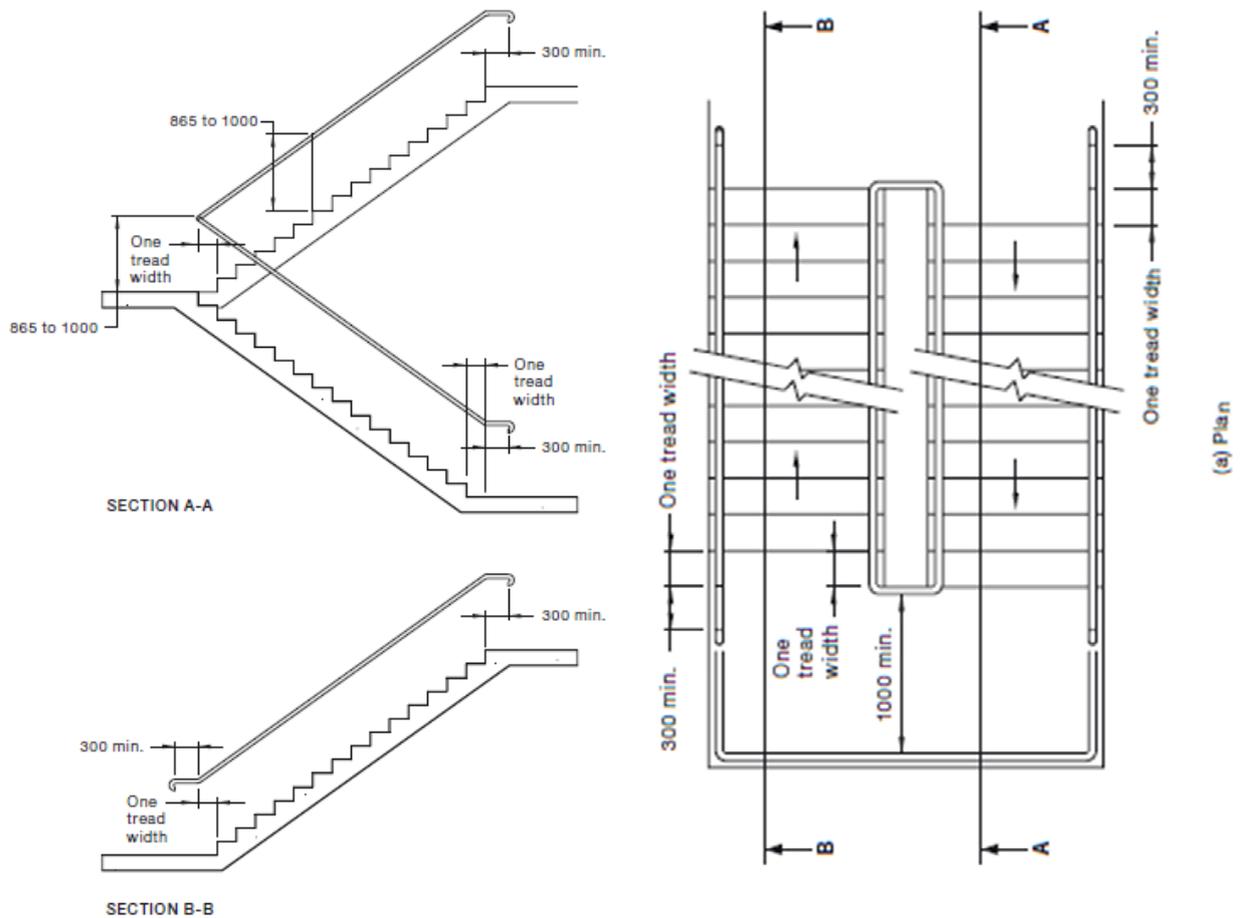


Figure 9

SAI Global Ltd License 1704-c045-2

- (a) Handrails and balustrades shall not encroach into required circulation spaces.
- (b) The cross-section of handrails shall be circular or elliptical, not less than 30 mm or greater than 50 mm in height or width for not less than 270° around the uppermost surface as shown in Figures 29(a) and 29(b). Elliptical handrails shall have the greater dimension in the horizontal axis as shown in Figure 29(b).
- (c) Exposed edges at ends and corners of handrails shall have a radius of not less than 5 mm.
- (d) The top of handrails shall be not less than 865 mm nor more than 1000 mm above the nosing of stairway tread or the plane of the finished floor of the walkway, ramp or landing.
- (e) The height of the top of the handrail, measured in accordance with Item (d), shall be consistent through the ramp (or stairs) and any landings.
- (f) If a balustrade is required at a height greater than the handrail, both shall be provided.
- (g) Handrails shall be securely fixed and rigid, and their ends shall be turned through a total of 180°, or to the ground, or returned fully to end post or wall face, as shown in Figures 26(C) and 26(D).
- (h) The clearance between a handrail and an adjacent wall surface or other obstruction shall be not less than 50 mm. This clearance shall extend above the top of the handrail by not less than 600 mm.
- (i) Handrails shall have no obstruction to the passage of a hand along the rail, as shown in Figures 29(a) and 29(b).
- (j) The inside handrail at landings shall always be continuous, as shown in Figure 28(a).

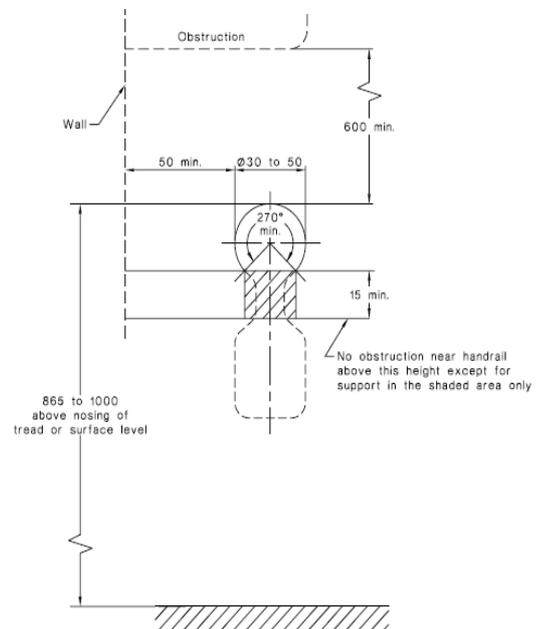


Figure 10

SAI Global Ltd License 1704-c045-2


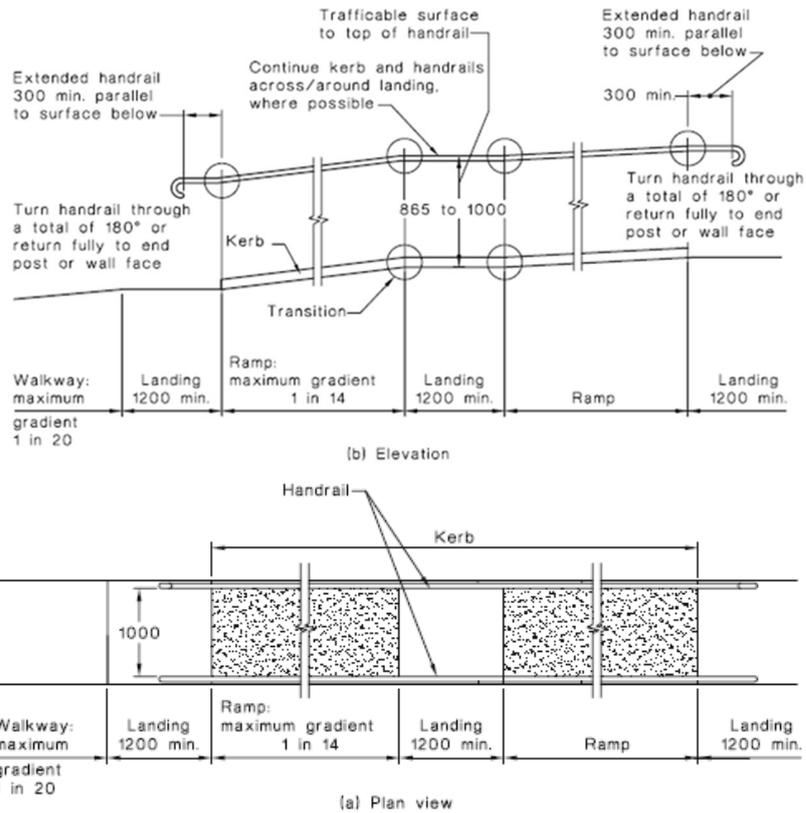


Figure 11

SAI Global Ltd License 1704-c045-2

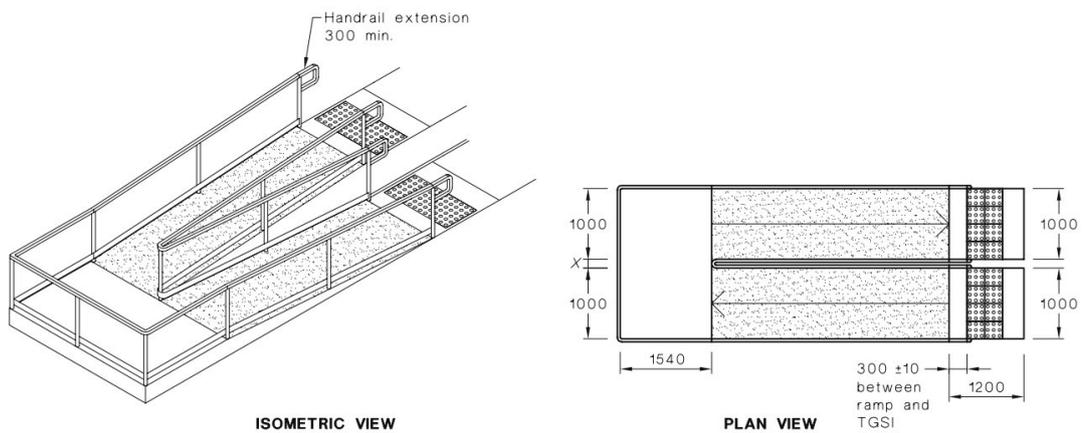

ISOMETRIC VIEW

PLAN VIEW

DIMENSIONS IN MILLIMETRES

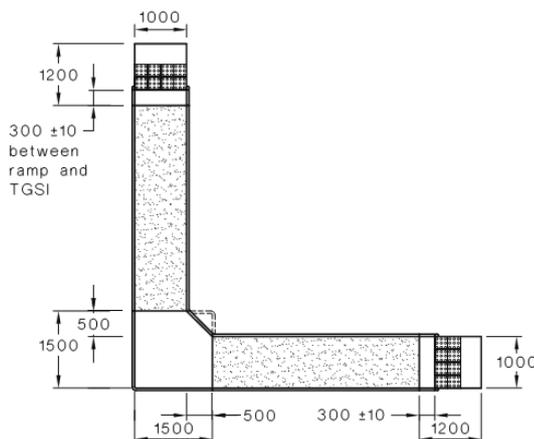


Figure 12

SAI Global Ltd License 1704-c045-2


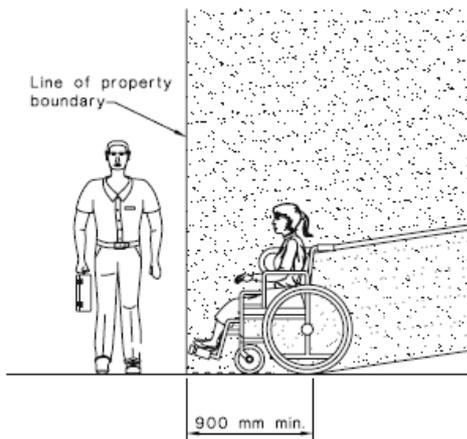


Figure 13 SAI Global Ltd License 1704-c045-2

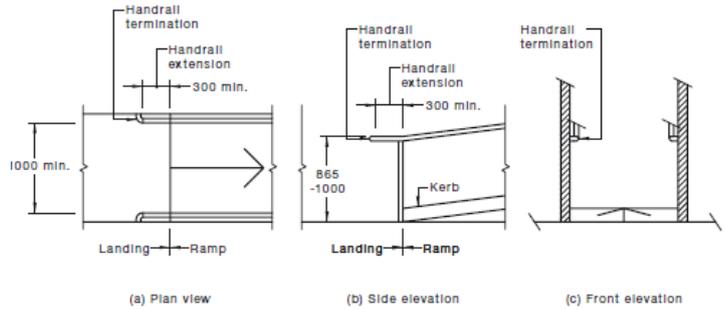

DIMENSIONS IN MILLIMETRES

Figure 14 SAI Global Ltd License 1704-c045-2

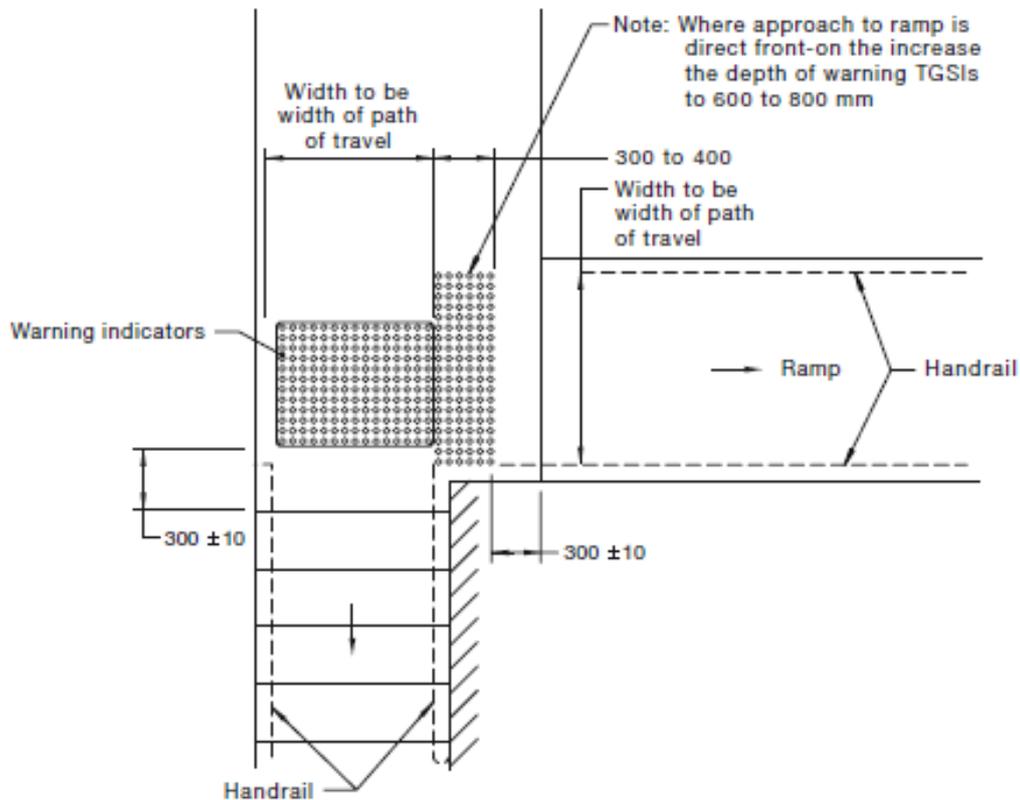


Figure 15 SAI Global Ltd License 1704-c045-2

Where there is no chair rail, handrail or transom, all frameless or fully glazed doors, sidelights, including any glazing capable of being mistaken for a doorway or opening, shall be clearly marked for their full width with a solid contrasting line. The contrasting line shall be not less than 75 mm wide and shall extend across the full width of the glazing panel. The lower edge of the contrasting line shall be located between 900 mm and 1000 mm above the plane of the finished floor level.

Any contrasting line on the glazing shall provide a minimum of 30% luminance contrast when viewed against the floor surface or surfaces within 2 m of the glazing on the opposite side.

Figure 16 SAI Global Ltd License 1704-c045-2



Figure 17

SAI Global Ltd License 1704-c045-2



Figure 18

SAI Global Ltd License 1704-c045-2

3. Braille and tactile sign specification

- (a) Tactile characters must be raised or embossed to a height of not less than 1 mm and not more than 1.5 mm.
- (b) Sentence case (upper case for the first letter of each main word and lower case for all other letters) must be used for all tactile characters, and—
 - (i) upper case tactile characters must have a height of not less than 15 mm and not more than 55 mm, except that the upper case tactile characters on a sign identifying a door *required* by E4.5 to be provided with an *exit* sign must have a height of not less than 20 mm and not more than 55 mm; and
 - (ii) lower case tactile characters must have a height of 50% of the related upper case characters.
- (c) Tactile characters, symbols, and the like, must have rounded edges.
- (d) The entire sign, including any frame, must have all edges rounded.
- (e) The background, negative space or fill of signs must be of matt or low sheen finish.
- (f) The characters, symbols, logos and other features on signs must be matt or low sheen finish.
- (g) The minimum letter spacing of tactile characters on signs must be 2 mm.
- (h) The minimum word spacing of tactile characters on signs must be 10 mm.
- (i) The thickness of letter strokes must be not less than 2 mm and not more than 7 mm.
- (j) Tactile text must be left justified, except that single words may be centre justified.
- (k) Tactile text must be Arial typeface.

Figure 19

SAI Global Ltd License 1704-c045-2

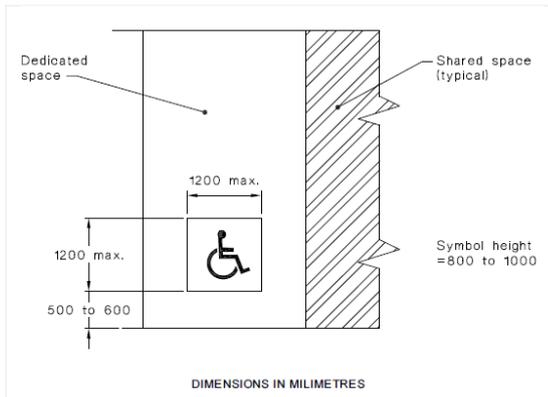


Figure 20 SAI Global Ltd License 1704-c045-2

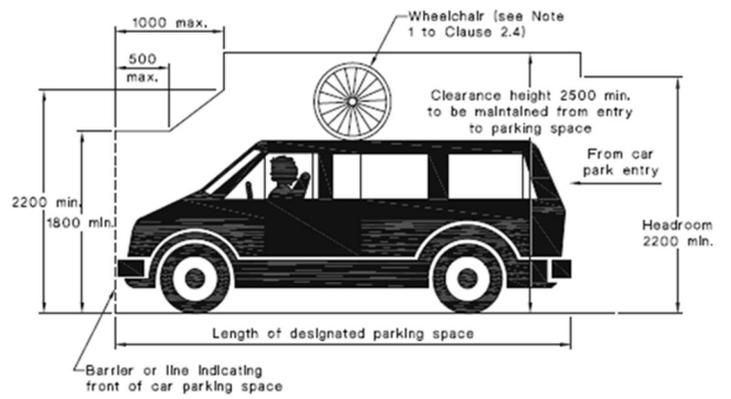


Figure 21 SAI Global Ltd License 1704-c045-2



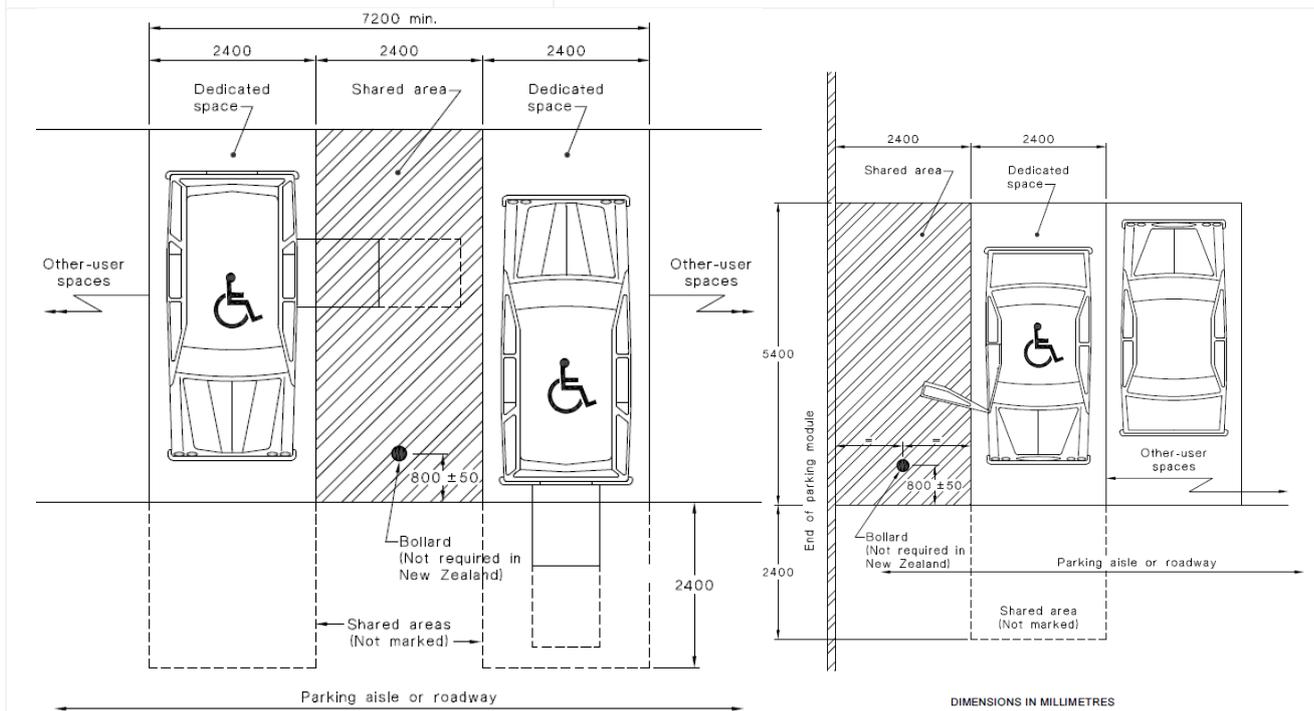


Figure 22 SAI Global Ltd License 1704-c045-2

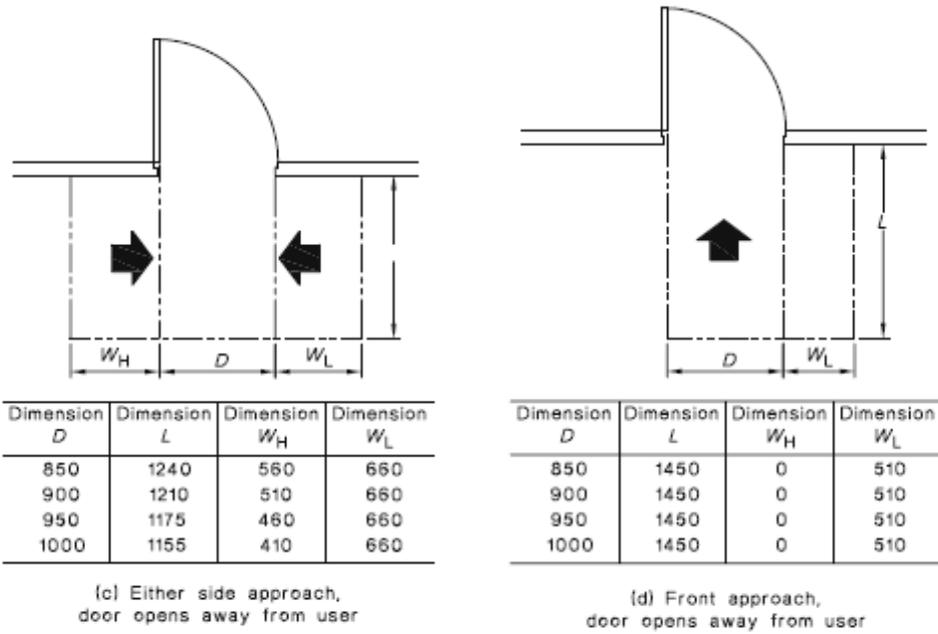

LEGEND:
 D = Clear opening of width of doorway
 L = Length
 W_H = Width—hinge side
 W_L = Width—latch side
 = Direction of approach
 ---- = Circulation space

DIMENSIONS IN MILLIMETRES

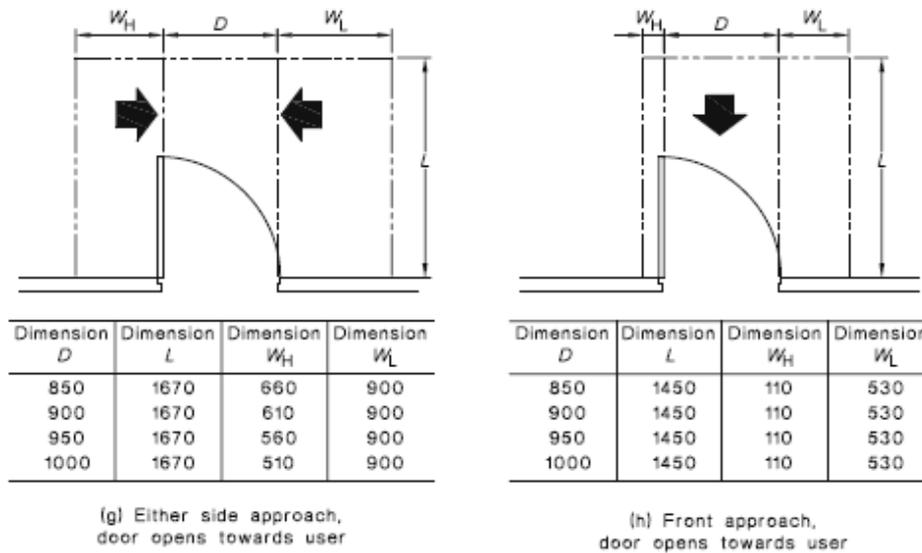

LEGEND:
 D = Clear opening of width of doorway
 L = Length
 W_H = Width—hinge side
 W_L = Width—latch side
 = Direction of approach
 ---- = Circulation space

DIMENSIONS IN MILLIMETRES


Figure 23

SAI Global Ltd License 1704-c045-2


Part D3 – Attachments

The attachments below are extracted from the Architectural Plans provided and are to be read as set and referenced in each section of part D3




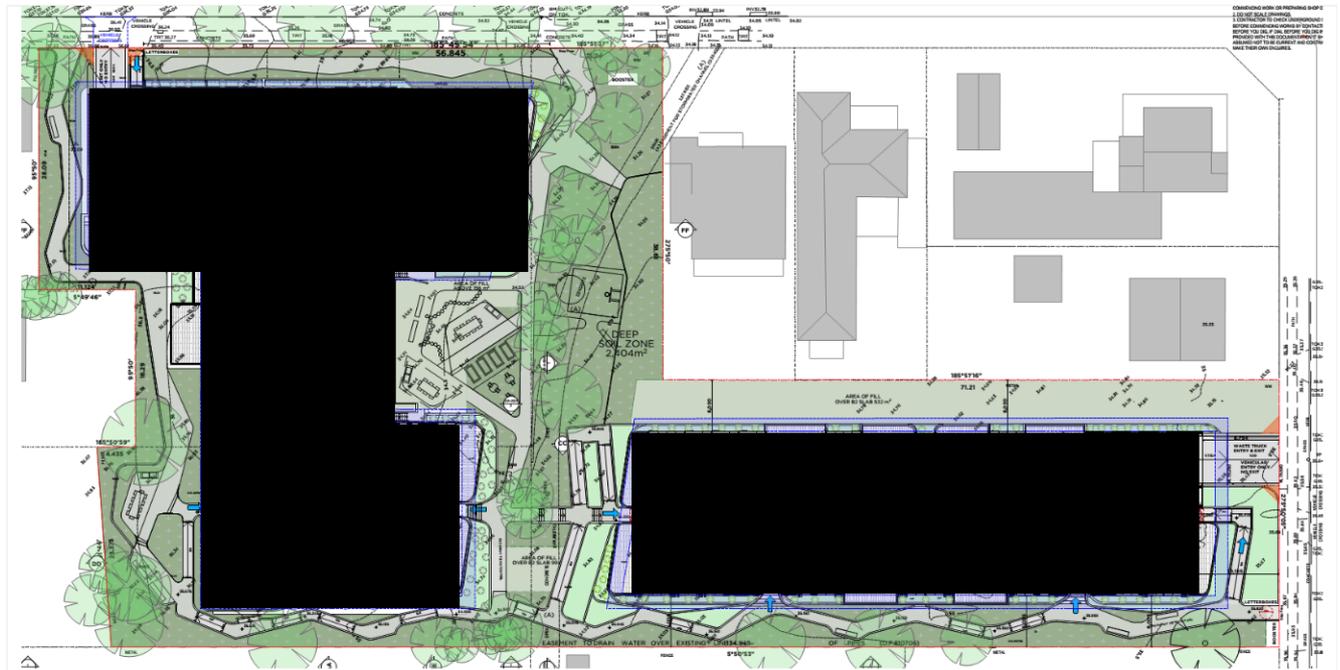


Ground Level

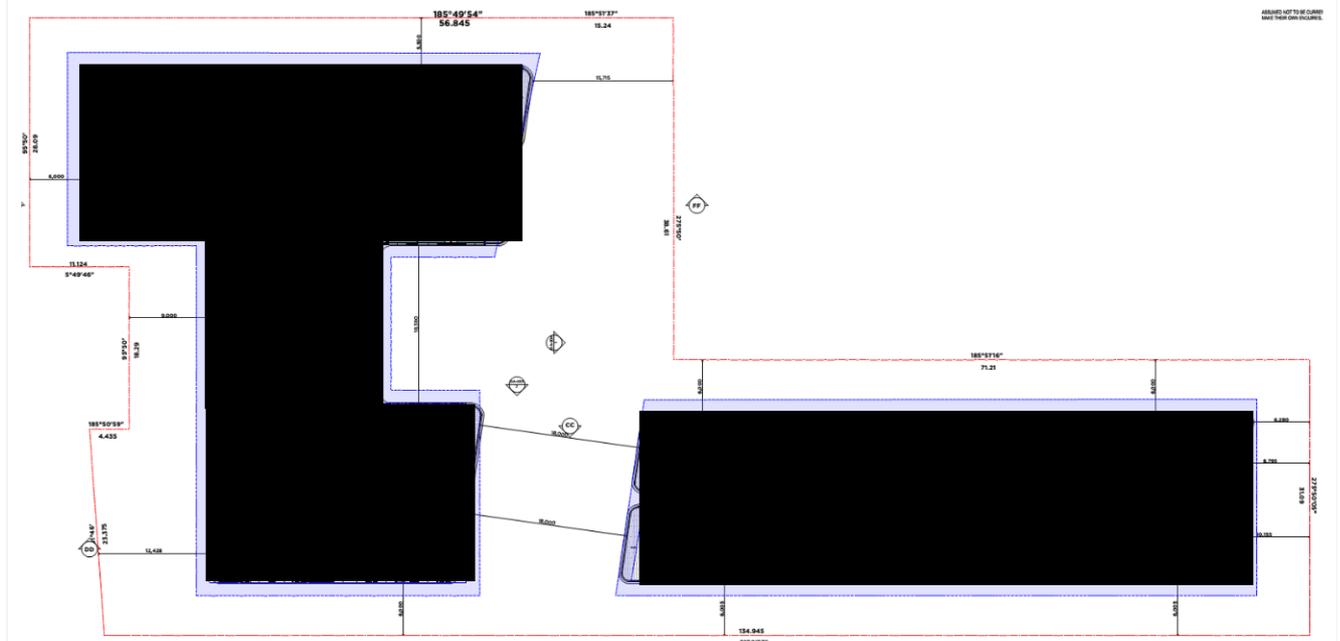

Level 01-03

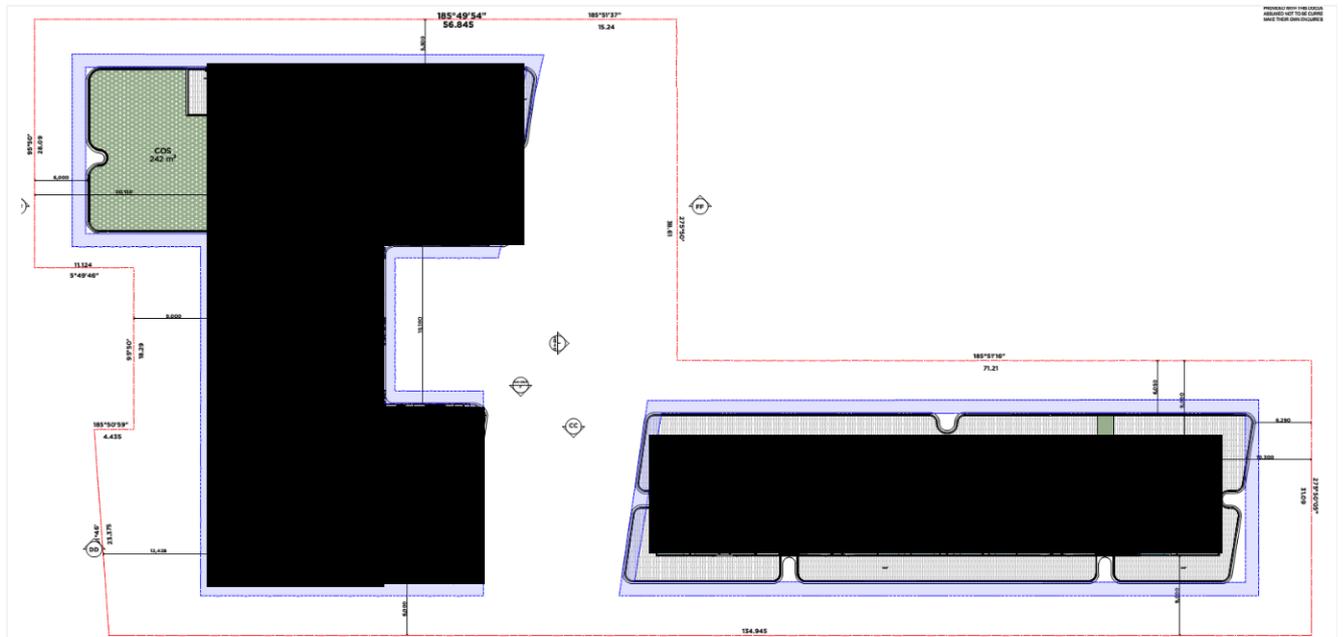

Level 04

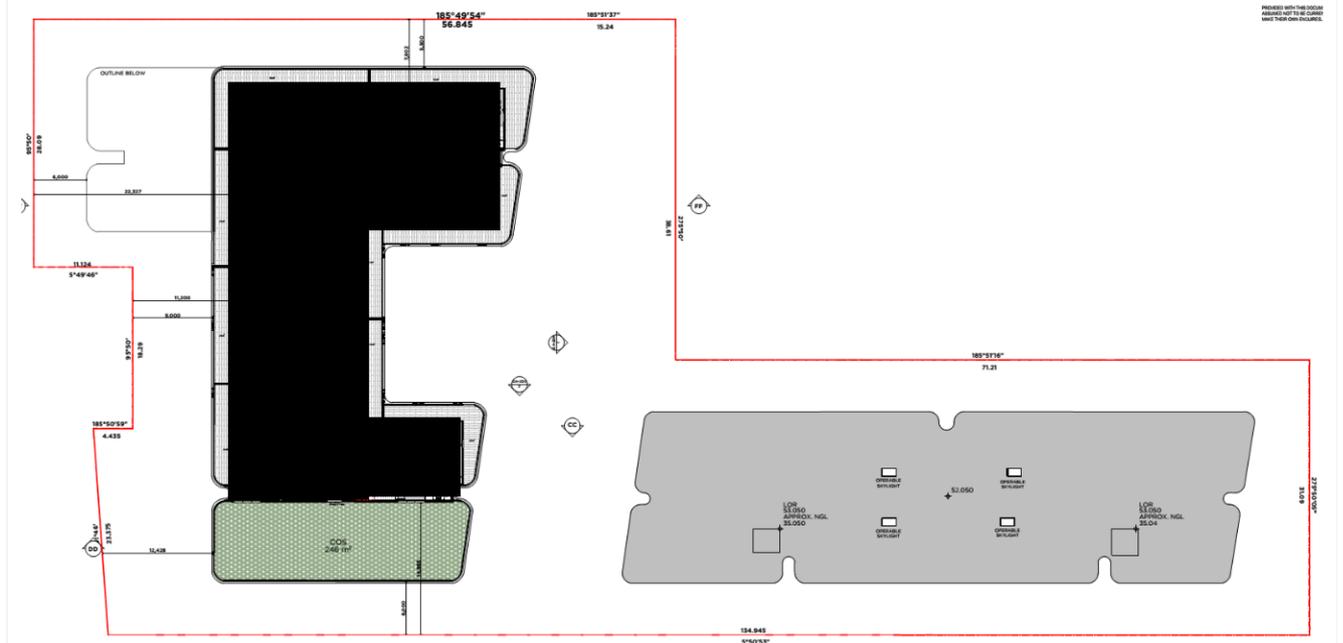

Level 05

Att.01 URBAN Link Plans Issue A dated 27.11.2020

AS 1428.1 – Additional Requirements

The additional requirements set below to be read in full	ADR	N/A	C
<p>1. Access ways:</p> <ul style="list-style-type: none"> All access ways must have a minimum width of 1m clear and a vertical clearance of at least 2m. <p>Reference: Figure 24, Figure 25 Notes: See Att.01 – Can be complaint at CC stage</p>	<input type="checkbox"/>	<input type="checkbox"/>	✓
<p>2. Doorway general requirements:</p> <ul style="list-style-type: none"> All doorways are to be in accordance with AS1428.1. Door thresholds are to be level or they can incorporate a threshold ramp as per AS1428.1 Distance between successive doorways in airlocks to be 1450mm which is measured when the door is in an open position in case of swinging doors <p>Reference: Figure 23, Figure 27, Figure 28 Notes: See Att.01 – Can be complaint at CC stage</p>	<input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/>	<input type="checkbox"/> <input type="checkbox"/> <input type="checkbox"/>	✓ ✓ ✓
<p>3. Door hardware:</p> <ul style="list-style-type: none"> Door hardware including door handles, door closers, snibs (in accessible toilets) are required to be as per the requirements in AS1428.1 <p>Reference: Figure 29 Notes: Can be complaint at CC stage</p>	<input type="checkbox"/>	<input type="checkbox"/>	✓
<p>4. Luminance contrast requirements:</p> <ul style="list-style-type: none"> All doorways are to have a minimum luminance contrast of 30% and the minimum width of 50mm provided as per AS1428.1 <p>Reference: Figure 30 Notes: Can be complaint at CC stage</p>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
<p>5. Floor Surfaces:</p> <ul style="list-style-type: none"> Use slip resistant surfaces. The texture of the surface shall be traversable by people who use a wheelchair and those with an ambulant or sensory disability. Abutment of surfaces shall have a smooth transition. Construction specifications to be as per AS1428.1. Any grates along the path must be as per AS1428.1 <p>Reference: Figure 31 Notes: Can be complaint at CC stage</p>	<input type="checkbox"/>	<input type="checkbox"/>	✓
<p>6. Switches and Outlets:</p> <ul style="list-style-type: none"> All switches and controls on an accessible path of travel, other than general purpose outlets, shall be located not less than 900 mm nor more than 1100 mm above the plane of the finished floor and not less than 500 mm from internal corners. GPOs to be located between 600-1100mm above FFL and minimum of 500mm from any internal corners. Rocker action / toggle switches to be provided in with a minimum size of 30mmx30mm Push pad switches if used to have a minimum dimension of 25mm diameter All switches in accessible sole occupancy units or sanitary facilities are to be located as per AS1428.1 <p>Reference: Figure 32 Notes: Can be complaint at CC stage</p>	<input type="checkbox"/>	<input type="checkbox"/>	✓

Additional Requirements – References

The references below to be read as set and referenced in each section of Additional Requirements

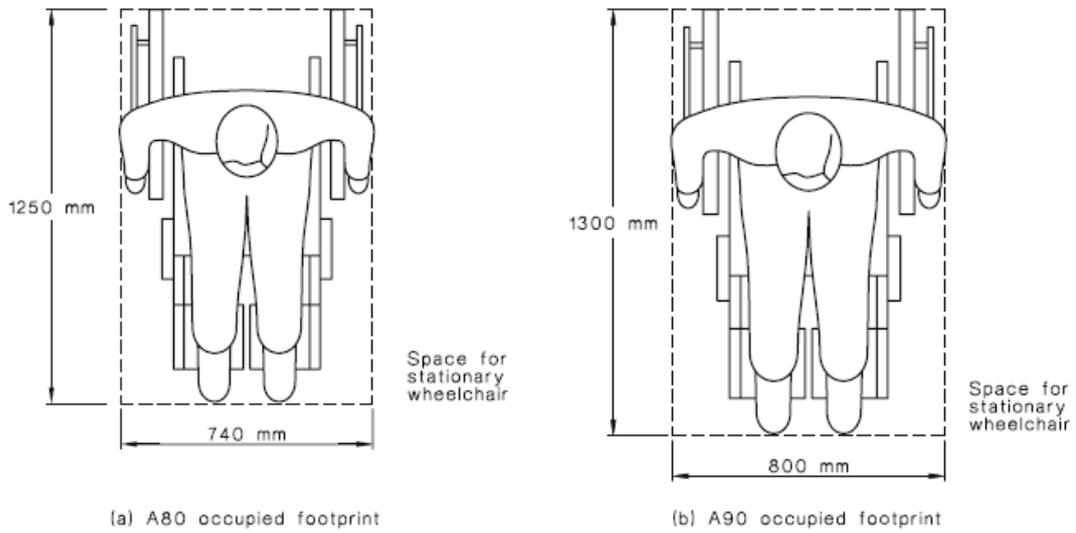


Figure 24

SAI Global Ltd License 1704-c045-2


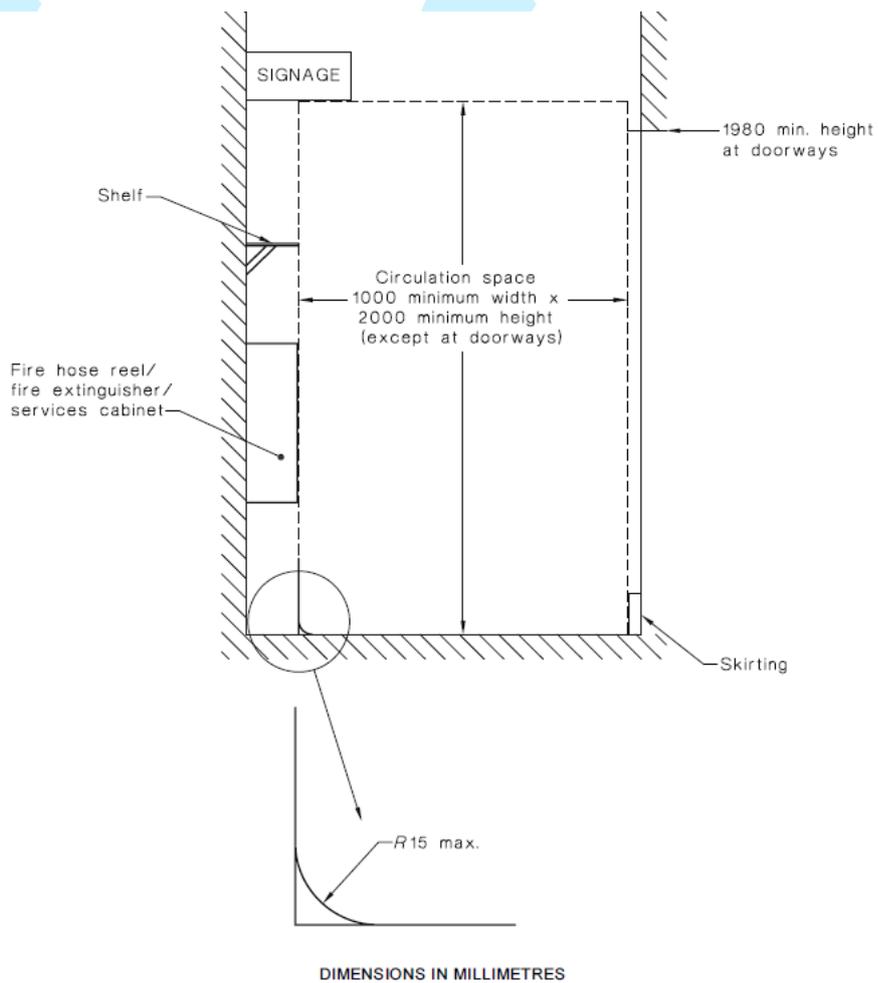


Figure 25


SAI Global Ltd License 1704-c045-2

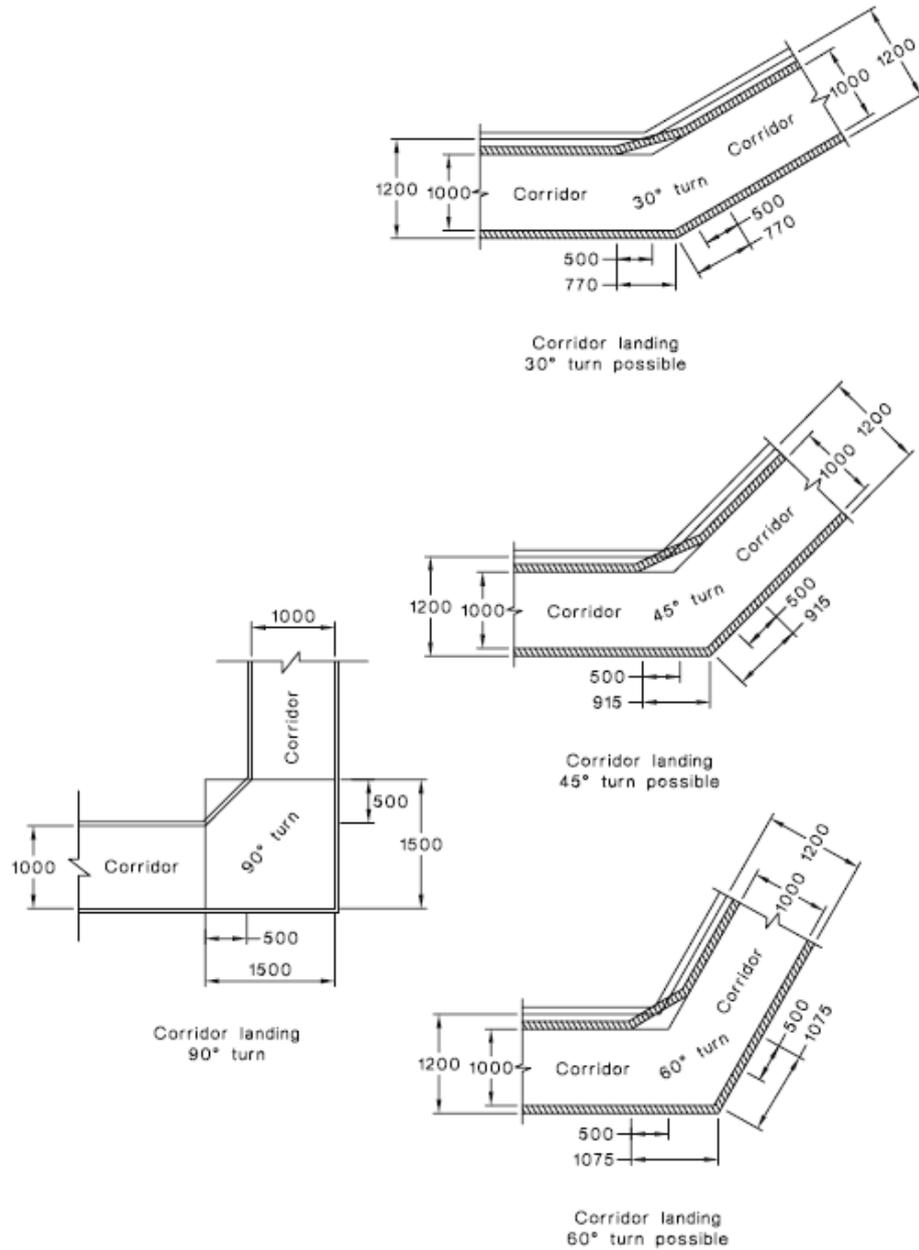

DIMENSIONS IN MILLIMETRES

Figure 26

SAI Global Ltd License 1704-c045-2

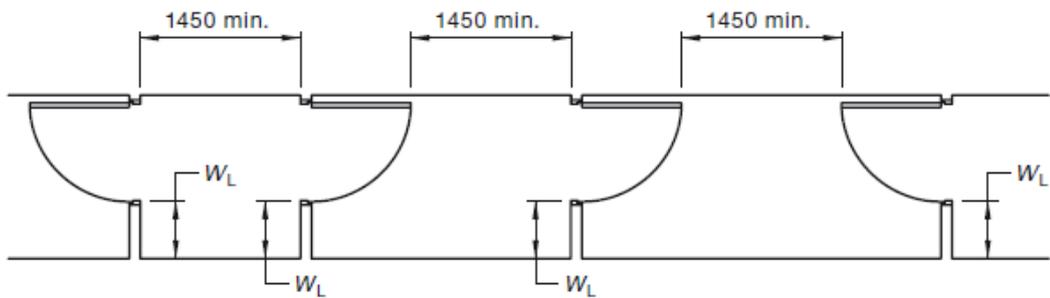


(a) Continuous accessible path of travel

DIMENSIONS IN MILLIMETRES


Figure 27

SAI Global Ltd License 1704-c045-2

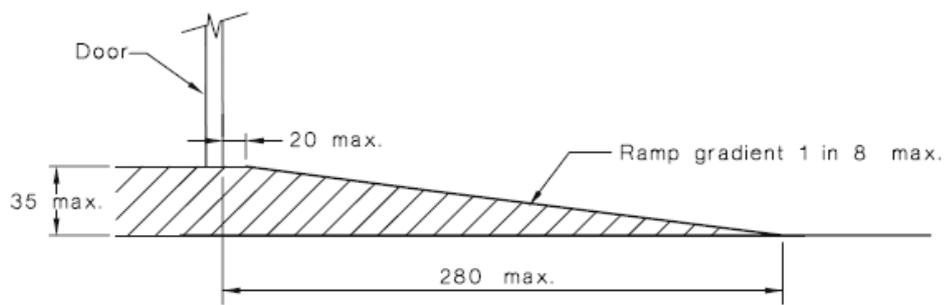

DIMENSIONS IN MILLIMETRES

Figure 28 SAI Global Ltd License 1704-c045-2

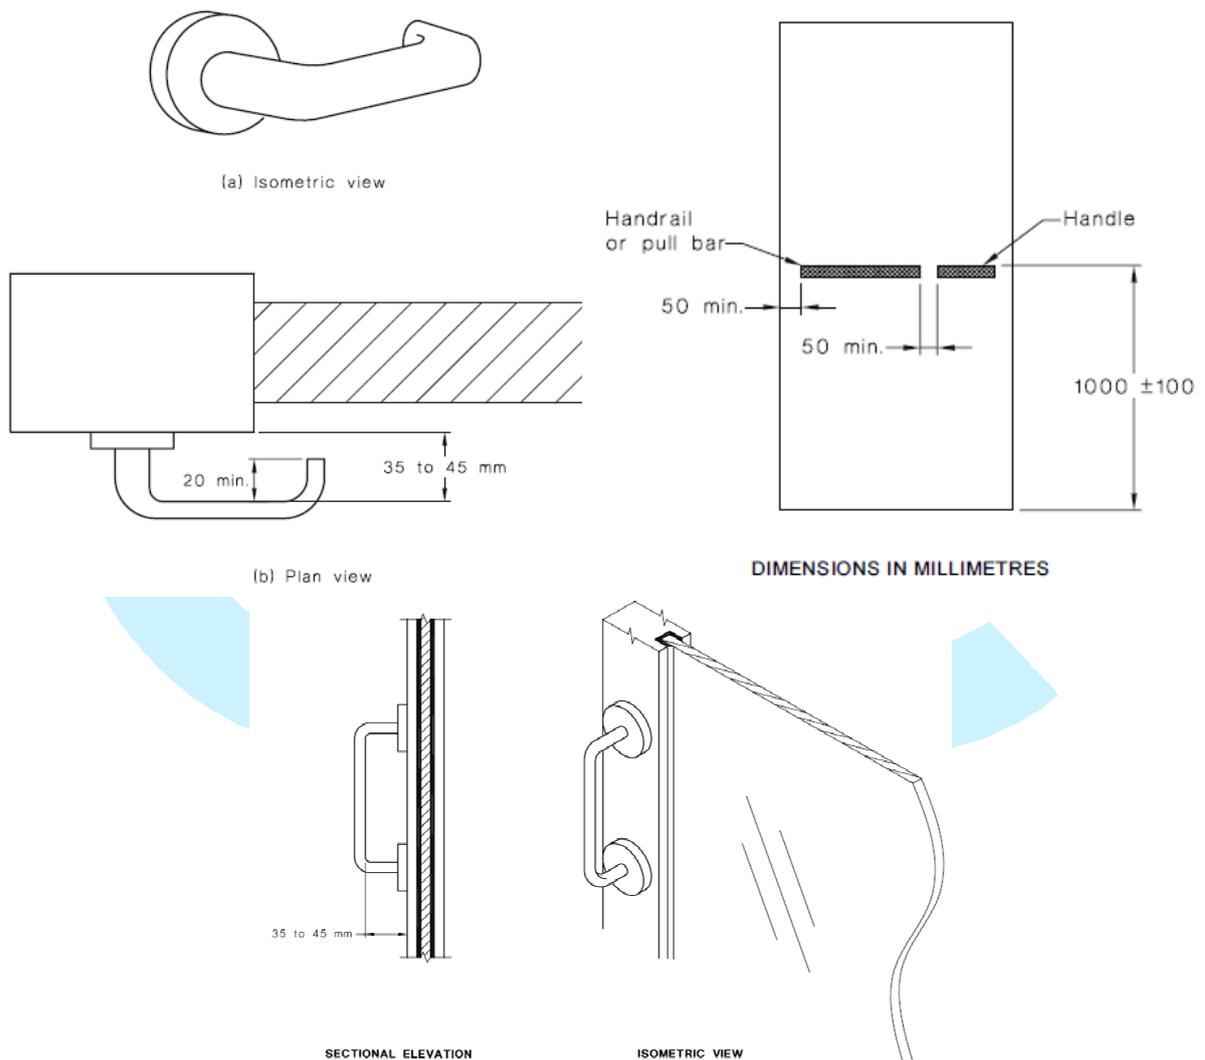

DIMENSIONS IN MILLIMETRES

Figure 29 SAI Global Ltd License 1704-c045-2

4. Luminance contrast

The following applies to *luminance contrast*:

- The background, negative space, fill of a sign or border with a minimum width of 5 mm must have a *luminance contrast* with the surface on which it is mounted of not less than 30%.
- Tactile characters, icons and symbols must have a minimum *luminance contrast* of 30% to the surface on which the characters are mounted.
- Luminance contrasts* must be met under the lighting conditions in which the sign is to be located.

Figure 30 SAI Global Ltd License 1704-c045-2

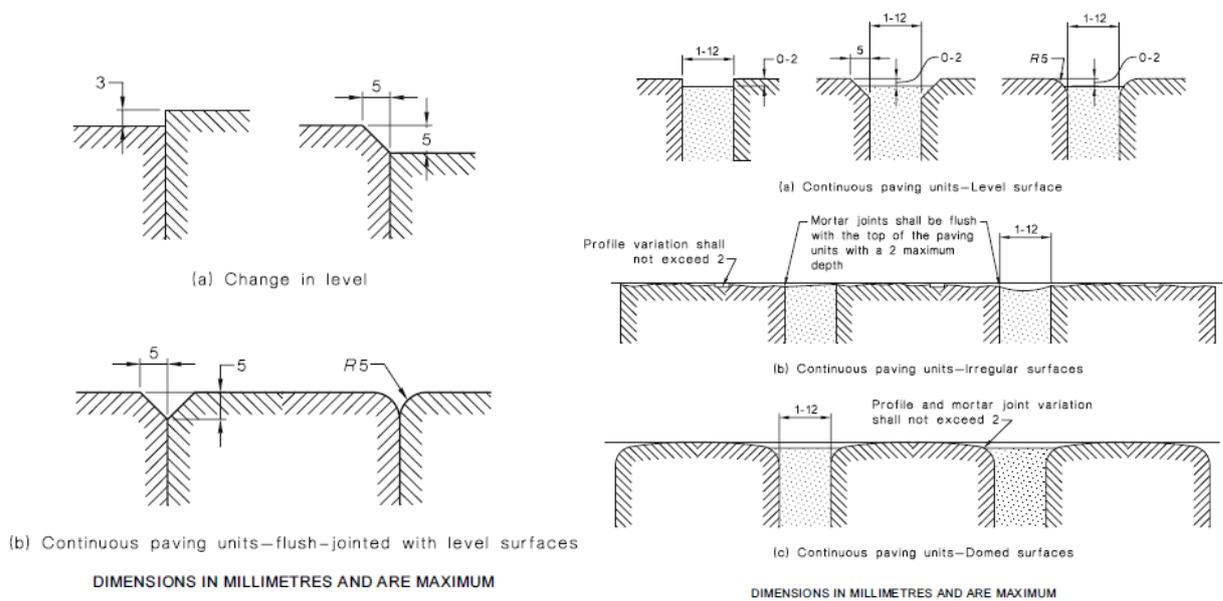


Figure 31

SAI Global Ltd License 1704-c045-2

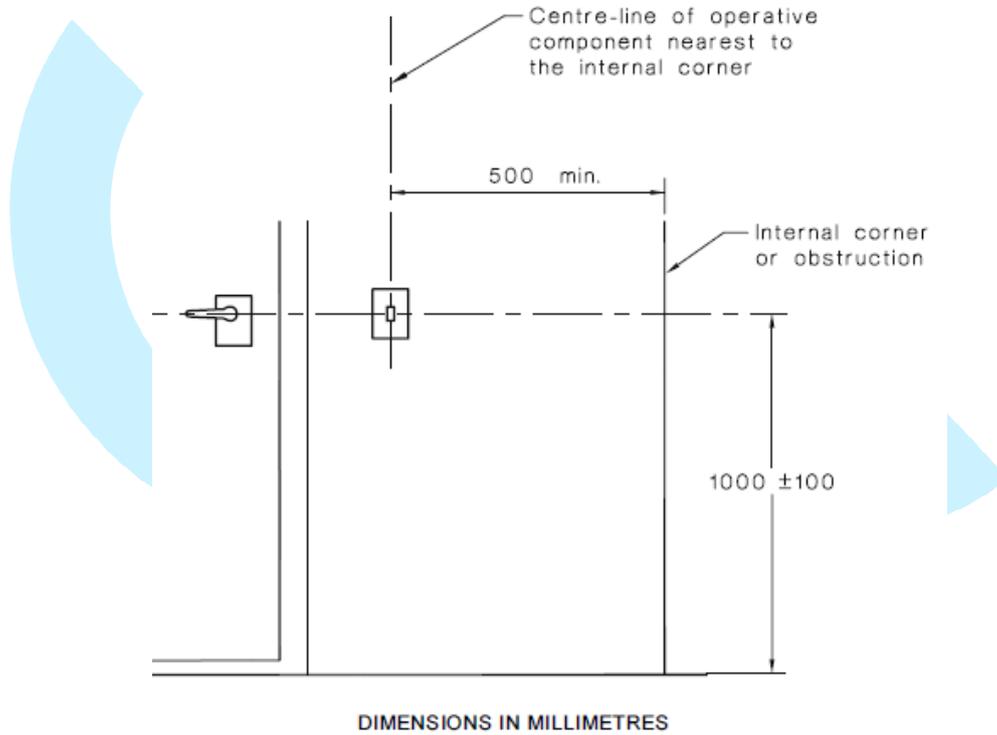


Figure 32

SAI Global Ltd License 1704-c045-2

Part E3 – Lift Installations

E3.2 Stretcher facility lifts	ADR	N/A	C
(a) a stretcher facility in accordance with (b) must be provided; <ul style="list-style-type: none"> I. In at least one emergency lift required by E3.4 II. When an emergency lift is not required, if passenger lifts are installed to serve any storey above an effective height of 12m, in at least one of those lifts to serve each floor served by the lifts Notes: Can be complaint at CC stage and as per manufacturers specifications and details	<input type="checkbox"/>	<input type="checkbox"/>	✓
(b) a stretcher facility must accommodate a raised stretcher providing a clear space not less than 600mm wide x 2000mm long x 1400mm high above the floor level Notes: Can be complaint at CC stage and as per manufacturers specifications and details	<input type="checkbox"/>	<input type="checkbox"/>	✓
E3.6 Passenger lifts	ADR	N/A	C
(a,b,c) in an accessible building every passenger lift excluding (electric passenger lift, electrohydraulic passenger lift and inclined lift) must be subject to the limitations on use specified in table E3.6a and have accessible features in accordance with table E3.6b also not rely on a constant pressure device for its operation if the lift car is fully enclosed Notes: Can be complaint at CC stage and as per manufacturers specifications and details	<input type="checkbox"/>	<input type="checkbox"/>	✓
Table E3.6a Limitation on use of types of passenger lifts	ADR	N/A	C
Stairway platform lift; Must Not – <ul style="list-style-type: none"> (a) be used to serve a space in a building accommodating more than 100 persons calculated according to D1.13 (b) be used in a high traffic public use area such as a theatre, cinema, auditorium, transport interchange, shopping centre or the like (c) be used where it is possible to install another type of passenger lift (d) connect more than 2 storeys (e) where more than 1 stairway lift is installed, serve more than 2 consecutive storeys (f) when in the folded position, encroach on the minimum width of stairway required by D1.6 	<input type="checkbox"/>	✓	<input type="checkbox"/>
Low-rise platform lift; Must not travel more than 1000mm	<input type="checkbox"/>	✓	<input type="checkbox"/>
Low-rise, low-speed constant pressure lift; Must not – <ul style="list-style-type: none"> (a) for an enclosed type travel more than 4m (b) for an unenclosed type, travel more than 2m (c) be used in high traffic public use areas in buildings such as a theatre, cinema, auditorium, transport interchange, shopping complex or the like 	<input type="checkbox"/>	✓	<input type="checkbox"/>
Small sized, low-speed automatic lift; Must not travel more than 12m	<input type="checkbox"/>	✓	<input type="checkbox"/>
Table E3.6b Application of features to passenger lifts	ADR	N/A	C
All lifts except “stair platform lift” and “low-rise platform lift” have handrails complying with the provisions for a mandatory handrail in AS1735.12 Notes: Can be complaint at CC stage and as per manufacturers specifications and details	<input type="checkbox"/>	<input type="checkbox"/>	✓

All lifts which travel more than 12m to have lift floor dimension of not less than 1400mm wide x 1600mm deep Notes: Can be complaint at CC stage and as per manufacturers specifications and details	<input type="checkbox"/>	<input type="checkbox"/>	✓
All lifts which travel not more than 12m “excluding stairway platform lift” to have lift floor dimension of not less than 1100mm wide x 1400mm deep	<input type="checkbox"/>	✓	<input type="checkbox"/>
Floor dimension for a stairway platform lift of not less than 810 mm wide x 1200 mm deep	<input type="checkbox"/>	✓	<input type="checkbox"/>
Minimum door opening complying with AS 1735.12 for All lifts except a stairway platform lift Notes: Can be complaint at CC stage and as per manufacturers specifications and details	<input type="checkbox"/>	<input type="checkbox"/>	✓
Passenger protection system complying with AS 1735.12 for all lifts with a power operated door Notes: Can be complaint at CC stage and as per manufacturers specifications and details	<input type="checkbox"/>	<input type="checkbox"/>	✓
Lift landing doors at the upper landing to be provided for All lifts except “stairway platform lift” Notes: Can be complaint at CC stage and as per manufacturers specifications and details	<input type="checkbox"/>	<input type="checkbox"/>	✓
Lift car and landing control buttons to comply with AS 1735.12 for All lifts except a “stairway platform lift” and “low-rise platform lift” Notes: Can be complaint at CC stage and as per manufacturers specifications and details	<input type="checkbox"/>	<input type="checkbox"/>	✓
Lighting in accordance with AS 1735.12 for all enclosed lift cars Notes: Can be complaint at CC stage and as per manufacturers specifications and details	<input type="checkbox"/>	<input type="checkbox"/>	✓
All lifts servicing more than 2 levels; (a) Automatic audible information within the lift car to identify the level each time the car stops, and (b) Audible and visual indication at each lift landing to indicate the arrival of the lift car, and (c) Audible information and audible indication required by (z) and (b) is to be provided in a range of between 20-80 dB(A) at a maximum frequency of 1500 Hz Reference: Notes: Can be complaint at CC stage and as per manufacturers specifications and details	<input type="checkbox"/>	<input type="checkbox"/>	✓
All lifts except “stairway platform lift” to have an emergency hands-free communication, including a button that alerts a call centre of a problem and a light to signal that the call has been received Notes: Can be complaint at CC stage and as per manufacturers specifications and details	<input type="checkbox"/>	<input type="checkbox"/>	✓

Part F2 – Access For People With Disability


F2.4 Accessible sanitary facilities	ADR	N/A	C
<p>(a) accessible unisex sanitary compartments must be provided in accessible parts of the building: Class 2; Where sanitary compartments are provided in common area, not less than 1</p> <p>Reference: Figure 34, Figure 35, Figure 36, Figure 37, Figure 38, Figure 39, Figure 40 Notes: See att.001. Can be compliant at CC Stage as per AS1428.1-2009</p>	<input type="checkbox"/>	✓	<input type="checkbox"/>
<p>(b) accessible unisex showers must be provided in accessible parts of the building: Class 2;Where showers are provided in common area, not less than 1</p>	<input type="checkbox"/>	✓	<input type="checkbox"/>
<p>(c) at each bank of toilets in addition to an accessible unisex sanitary compartment, a sanitary compartment suitable for a person with an ambulant disability must be provided in accordance with 1428.1 for male and females</p>	<input type="checkbox"/>	✓	<input type="checkbox"/>
<p>(d) an accessible unisex sanitary must contain a closet pan, washbasin, shelf or bench top and adequate means of disposal of sanitary towels</p>	<input type="checkbox"/>	✓	<input type="checkbox"/>
<p>(e) the circulation space, fixture and fittings must comply with the requirements of AS 1428.1 Reference: Figure 34, Figure 35, Figure 36, Figure 37, Figure 38, Figure 39, Figure 40 Notes: See att.001 – Accessible sanitary facility in post adaptation can be compliant at CC Stage as per AS1428.1-2009</p>	<input type="checkbox"/>	<input type="checkbox"/>	✓
<p>(f) an accessible unisex sanitary must be located to that it can be entered without crossing an area reserved for one sex only</p>	<input type="checkbox"/>	✓	<input type="checkbox"/>
<p>(g) where two or more of each type of accessible unisex sanitary facility are provided, the number of left and right-handed facilities must be provided as evenly as possible Notes: See Att.01</p>	<input type="checkbox"/>	<input type="checkbox"/>	✓
<p>(h) where male and sanitary facility are provided at a separate location of female sanitary facilities, accessible unisex sanitary facility are only required at one of those locations.</p>	<input type="checkbox"/>	✓	<input type="checkbox"/>
<p>(i) an accessible unisex sanitary or an accessible unisex shower need not be provided on a storey or level that is not required by D3.3(f) to be provided with a passenger lift or ramp complying with AS 1428.1</p>	<input type="checkbox"/>	✓	<input type="checkbox"/>
<p>(j) Baby change tables cannot encroach into the circulation space. Maximum height to be 820mm with 720mm underneath when in an open position.</p>	<input type="checkbox"/>	✓	<input type="checkbox"/>

Part F2 – References

The references below to be read as set and referenced in each section of part F2



(a) Isometric view

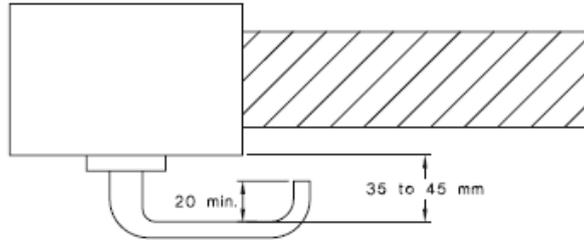




(b) Plan view

FIGURE 35(A) EXAMPLE OF ACCEPTABLE DOOR HARDWARE FOR HINGED DOORS

Figure 34

SAI Global Ltd License 1704-c045-2

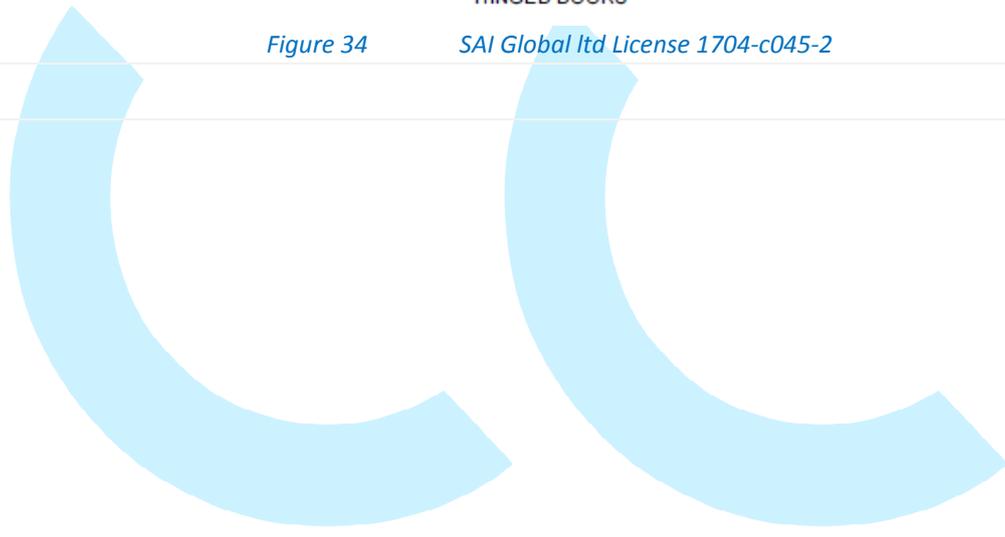

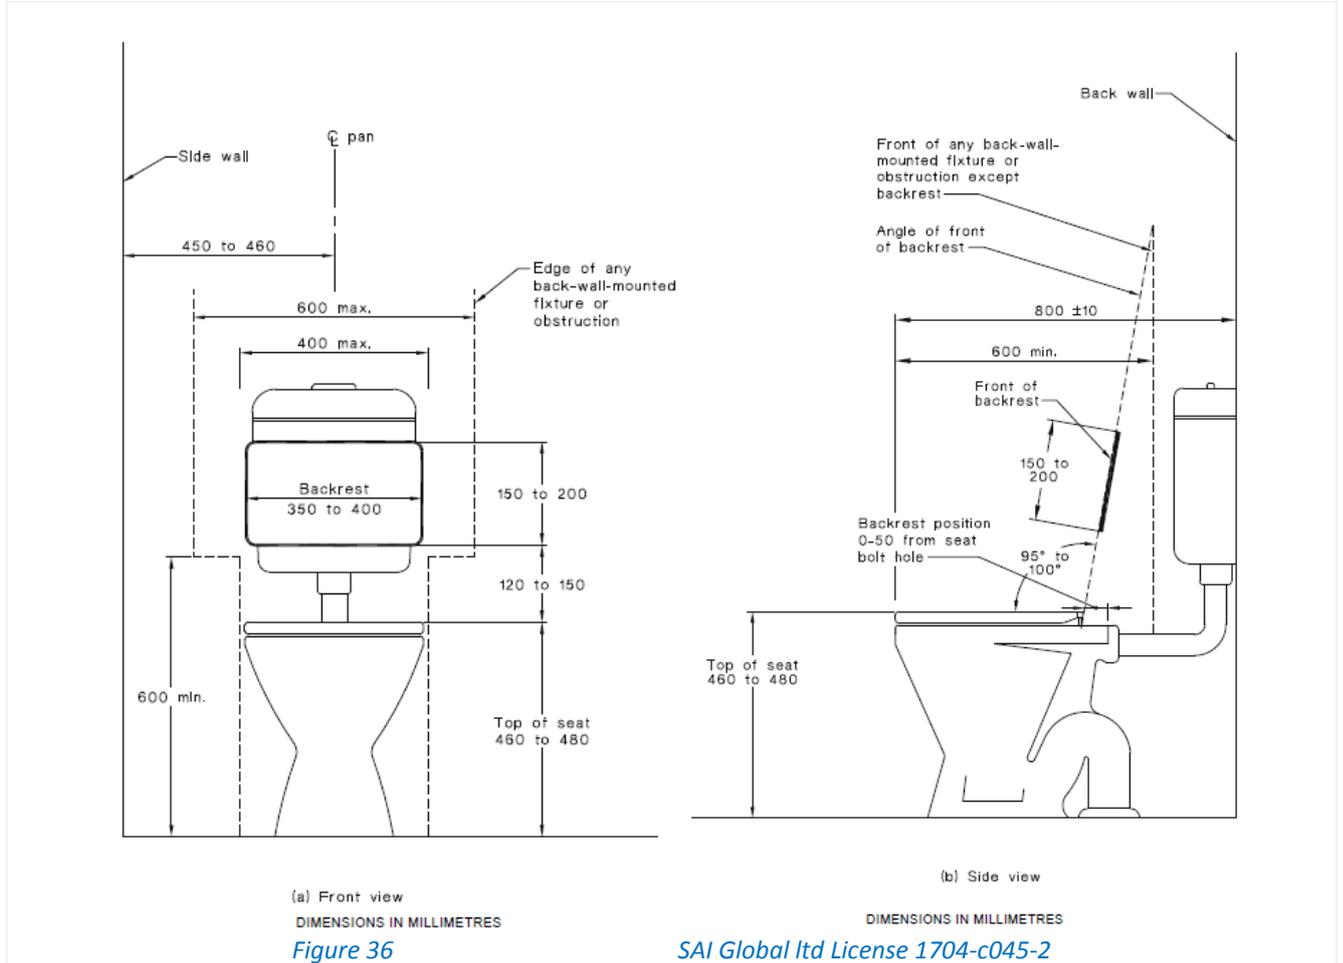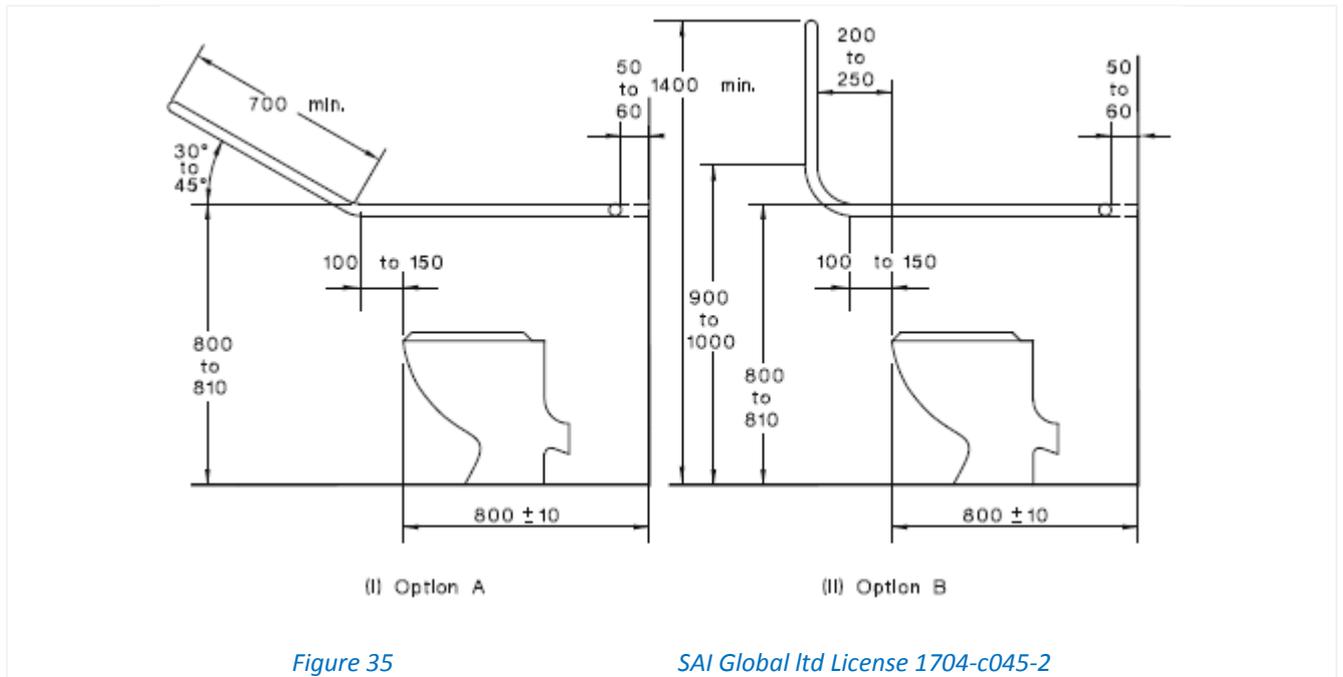

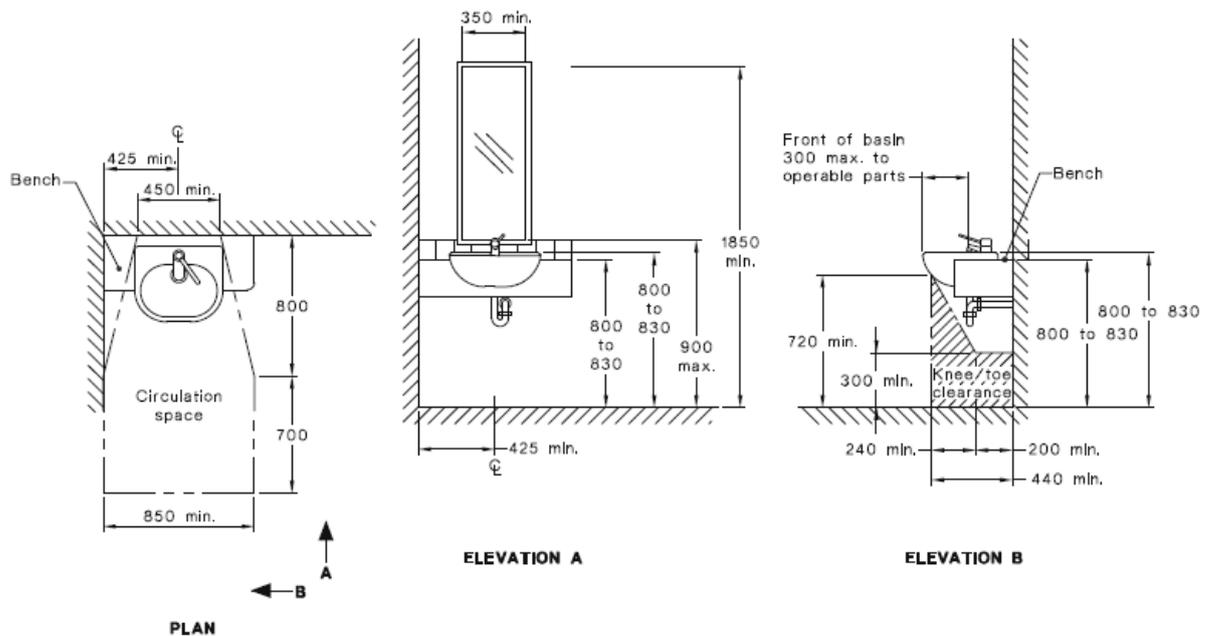


Figure 37

SAI Global Ltd License 1704-c045-2

15.4 Fixtures and fittings within a sanitary facility

15.4.1 Mirrors

In all sanitary facilities, the mirror shall be located either above or adjacent to the washbasin.

Where provided, a vertical mirror with a reflective surface not less than 350 mm wide shall extend from a height of not more than 900 mm to a height of not less than 1850 mm above the plane of the finished floor. Where provided, a second vertical mirror shall extend from a height of not less than 600 mm to a height of not less than 1850 mm above the plane of the finished floor.

NOTE: Angled or tilted mirrors should not be used since they do not work for all users or accessible facilities.

In an accessible sole occupancy unit, the mirror shall be centred over the washbasin.

15.4.2 Shelves

Shelf space shall be provided adjacent to the washbasin in one of the following ways:

- (a) As a vanity top at a height of 800 mm to 830 mm and a minimum width of 120 mm and depth of 300 mm to 400 mm without encroaching into any circulation space.
- (b) As a separate fixture—
 - (i) within any circulation space at a height of 900 mm to 1000 mm with a width of 120 mm to 150 mm and length of 300 mm to 400 mm; and
 - (ii) external to all circulation spaces at a height of 790 mm to 1000 mm with a minimum width of 120 mm and minimum length of 400 mm.

15.4.3 Soap dispensers, towel dispensers and similar fittings

Where provided, soap dispensers, towel dispensers, hand dryers and similar fittings shall be operable by one hand, and shall be installed with the height of their operative component or outlet not less than 900 mm and not more than 1100 mm above the plane of the finished floor, and no closer than 500 mm from an internal corner.

15.4.4 Clothes-hanging devices

A clothes-hanging device shall be installed 1200 mm to 1350 mm above the plane of the finished floor and not less than 500 mm out from any internal corner.

15.4.5 Sanitary disposal unit

Where provided, the sanitary disposal unit shall be located as follows:

- (a) Portable unit as shown in Figure 43.
- (b) Recessed unit within 500 mm from the pan.

15.4.6 Switches and general purpose outlets

Where provided near the washbasin, switches and general purpose outlets shall be located in accordance with Clause 14 and as close to the shelf or worktop as practicable.

Figure 38

SAI Global Ltd License 1704-c045-2



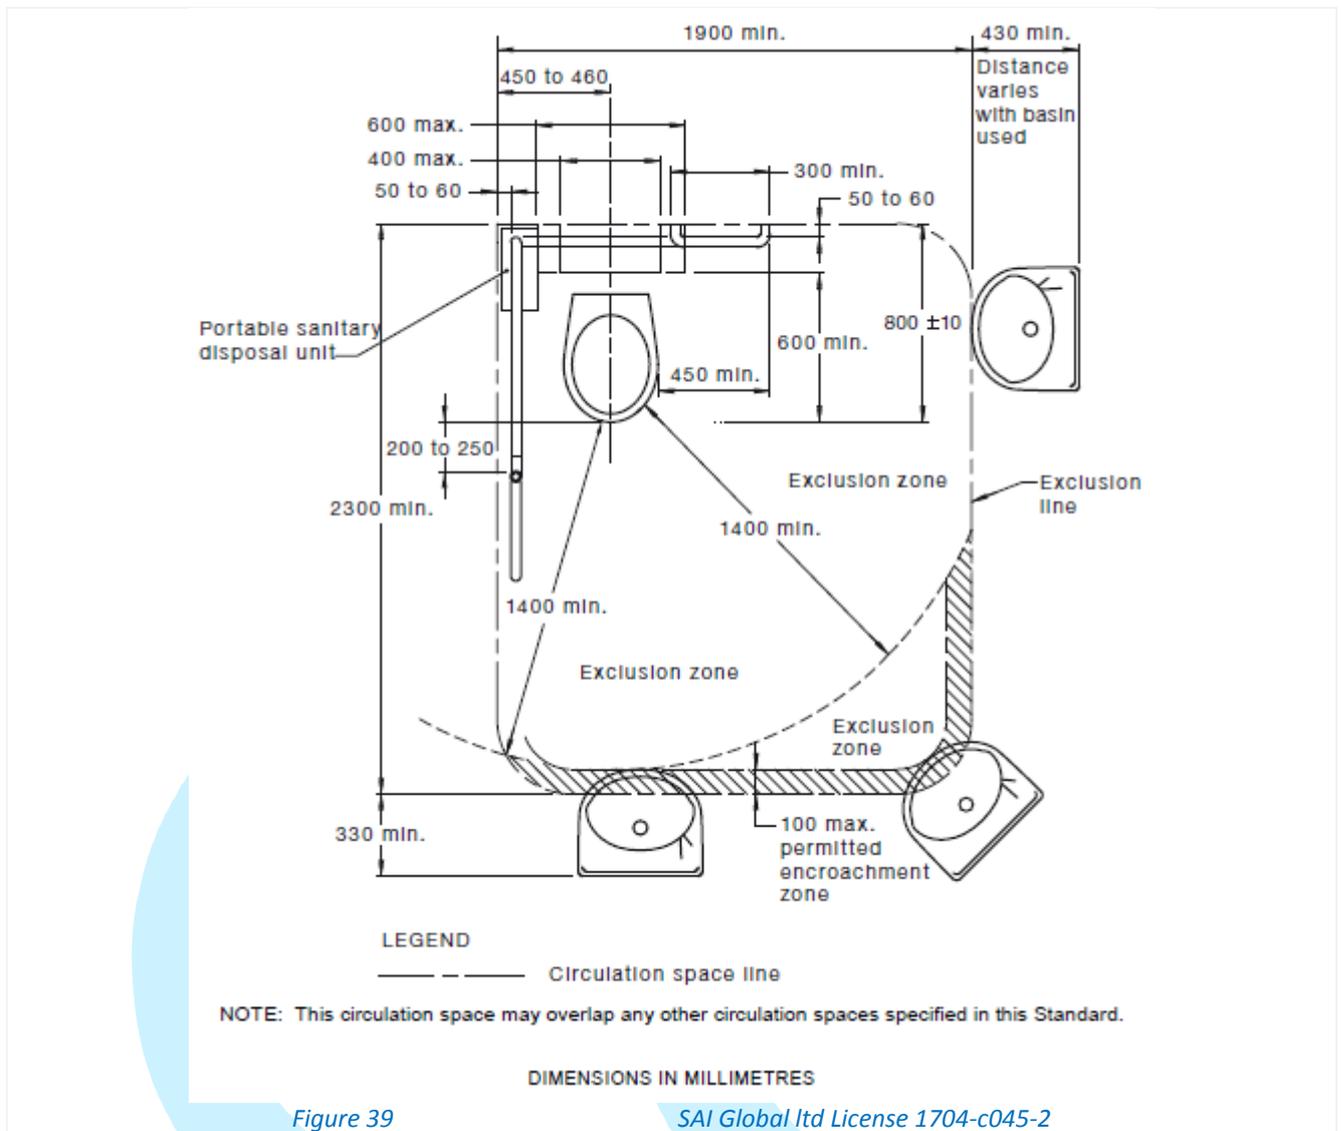


Figure 39

SAI Global Ltd License 1704-c045-2

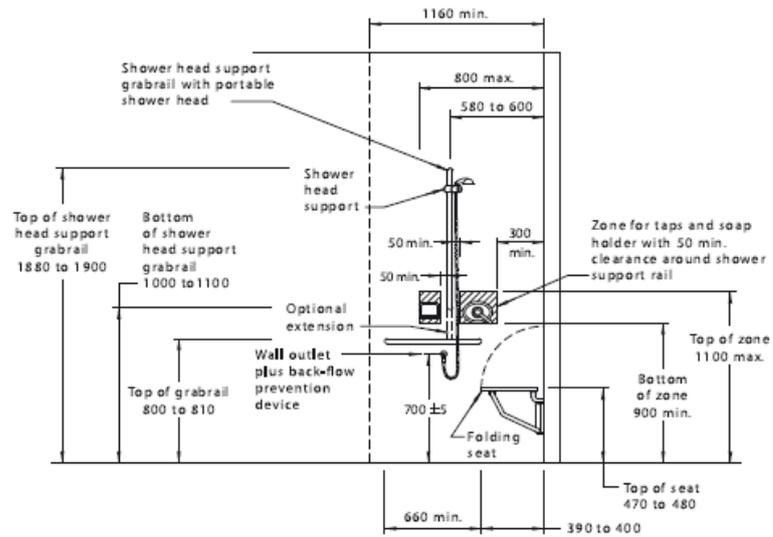

DIMENSIONS IN MILLIMETRES

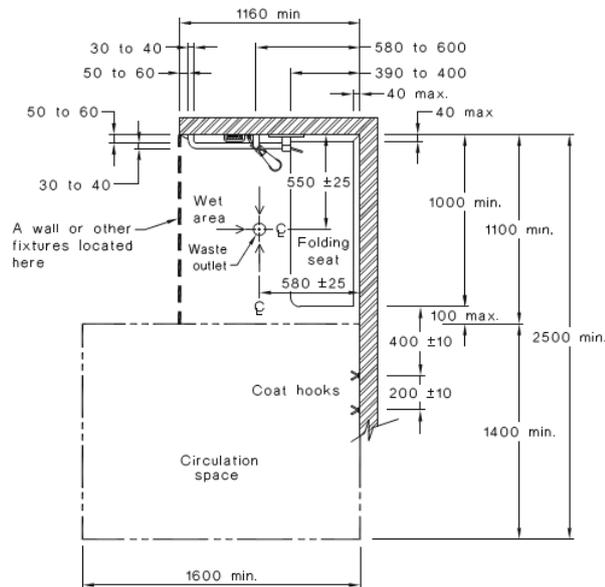

LEGEND: - - - - - Circulation space

(b) Shower recess with a third side provided by a wall or other fixtures

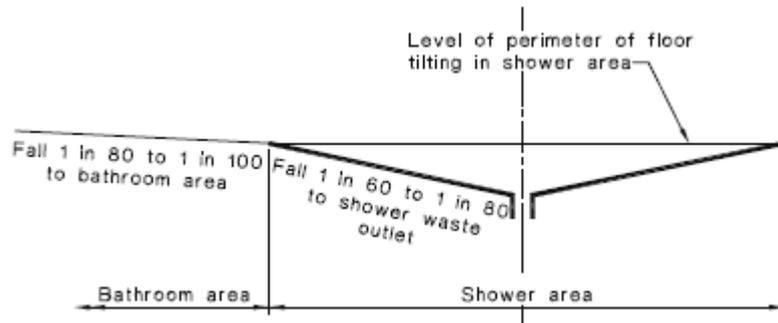


Figure 40

SAI Global Ltd License 1704-c045-2

AS 4299 – 1995 Adaptable Housing Requirements

This schedule is a list of essential features to be incorporated into a housing unit for it to be termed an 'Adaptable House'. "**14" adaptable units** are required as per Penrith City Councils DCP (10% of total amount).

The units must achieve **Class C** compliance as per AS4299 Checklist below where all essential features are incorporated. Some requirements are achieved at post adaptation where noted.

Units **G.12A, G.01A, G.03A, G.06A, L1.06A, L2.06A, L3.06A, L4.06A, G.14A, G.09B, L1.14A, L2.14A, L3.14A, L4.14A** have been chosen as "Adaptable units"


R = Required

C = Capable of Compliance by adding the requirement to the project specifications or at post adaption stage.


Item No.	Clause No.	Requirements as per AS4299	R	C	Comments
DRAWINGS					
1	2.3	Provision of drawings showing the housing unit in its pre-adaption and post-adaption stages.	✓	✓	Can be compliant at post adaptation
SITING					
3	3.3.2	A continuous accessible path of travel from street frontage and vehicle parking to entry complying with AS 1428.1	✓	✓	Complies.
LETTER BOXES IN ESTATE DEVELOPMENTS					
11	3.8	Letterboxes to be on hard standing area connected to accessible pathway	✓	✓	Letterboxes for adaptable units to be at a height of 900-1100mm above FFL
PRIVATE CAR ACCOMODATION					
14	3.7.2	Car parking space or garage min. area 6.0 m × 3.8 m	✓	✓	Parking spaces being provided in accordance with AS2890.6 & AS4299
ACCESSIBLE ENTRY					
20	4.3.1	Accessible entry	✓	✓	
22	4.3.2	Accessible entry to be level (i.e. max. 1:40 slope)	✓	✓	
23	4.3.2	Threshold to be low-level	✓	✓	
24	4.3.2	Landing to enable wheelchair manoeuvrability	✓	✓	
25	4.3.1	Accessible entry door to have 850 mm min. clearance	✓	✓	
27	4.3.4	Door lever handles and hardware to AS 1428.1	✓	✓	Can be compliant at post adaptation
INTERIOR GENERAL					
32	4.3.3	Internal doors to have 820 mm min. clearance	✓	✓	Can be compliant at post adaptation
33	4.3.7	Internal corridors min. width of 1000 mm	✓	✓	
34	4.3.7	Provision for compliance with AS 1428.1 for door approaches	✓	✓	Can be compliant at post adaptation
LIVING ROOM & DINING ROOM					
36	4.7.1	Provision for circulation space of min. 2250 mm diameter	✓	✓	Can be compliant at post adaptation
38	4.7.4	Telephone adjacent to GPO	✓	✓	Notes on plans
41	4.10	Potential illumination level min. 300 lux	✓	✓	Notes on plans
KITCHEN					
42	4.5.2	Minimum width 2.7 m (1550 mm clear between benches)	✓	✓	Can be compliant at post adaptation
43	4.5.1	Provision for circulation at doors to comply with AS 1428.1	✓	✓	Can be compliant at post adaptation

44	4.5.5	Provision for benches planned to include at least one work surface of 800 mm length, adjustable in height from 750 mm to 850 mm or replaceable. Refer to Figure 4.8	✓	✓	Can be compliant at post adaptation
45	4.5.5	Refrigerator adjacent to work surface	✓	✓	Can be compliant at post adaptation
46	4.5.6	Kitchen sink adjustable to heights from 750 mm to 850 mm or replaceable	✓	✓	Can be compliant at post adaptation
47	4.5.6	Kitchen sink bowl max. 150 mm deep	✓	✓	Can be compliant at post adaptation
48	4.5.6 e	Tap set capstan or lever handles or lever mixer	✓	✓	Can be compliant at post adaptation
49	4.5.6 e	Tap set located within 300 mm of front of sink	✓	✓	Can be compliant at post adaptation
51	4.5.7	Cooktops to include either front or side controls with raised cross bars	✓	✓	Can be compliant at post adaptation
52	4.5.7	Cooktops to include isolating switch	✓	✓	Can be compliant at post adaptation
53	4.5.7	Work surface min. 800 mm length adjacent to cooktop at same height	✓	✓	Can be compliant at post adaptation
54	4.5.8	Oven located adjacent to an adjustable height or replaceable work surface	✓	✓	Can be compliant at post adaptation
59	4.5.11	GPOs to comply with AS 1428.1. At least one double GPO within 300 mm of front of work surface	✓	✓	Can be compliant at post adaptation
60	4.5.11	GPO for refrigerator to be easily reachable when the refrigerator is in its operating position	✓	✓	Can be compliant at post adaptation
61	4.5.4	Slip-resistant floor surface	✓	✓	Can be compliant at post adaptation
MAIN BEDROOM					
62	4.6.1	At least one bedroom of area sufficient to accommodate queen size bed and wardrobe and circulation space requirements of AS 1428.2	✓	✓	Can be compliant at post adaptation
BATHROOM					
75	4.4.1	Provision for bathroom area to comply with AS 1428.1	✓	✓	A bathroom with the minimum dimension of 2 x2.95m or 2.3x2.7m or 2.4x2.45m
76	4.4.2	Slip-resistant floor surface	✓	✓	Can be compliant at post adaptation
77	4.4.4f	Shower recess- no hob. Minimum size 1160 x 1100 to comply with AS 1428.1. (Refer Figures 4.6 and 4.7)	✓	✓	Can be compliant at post adaptation
78	4.4.4f	Shower area waterproofed to AS 3740 with floor to fall to waste	✓	✓	Can be compliant at post adaptation
79	4.4.4f	Recessed soap holder	✓	✓	Can be compliant at post adaptation
80	4.4.4f	Shower taps positioned for easy reach to access side of shower sliding track	✓	✓	Can be compliant at post adaptation
82	4.4.4h	Provision for adjustable, detachable hand held shower rose mounted on a slider grab rail or fixed hook	✓	✓	Can be compliant at post adaptation
83	4.4.4h	Provision for grab rail in shower (Refer to Figure 4.7) to comply with AS 1428.1	✓	✓	Can be compliant at post adaptation
86	4.4.4c	Tap sets to be capstan or lever handles with single outlet	✓	✓	Can be compliant at post adaptation
88	4.4.4g	Provision for washbasin with clearances to comply with AS 1428.1	✓	✓	Can be compliant at post adaptation
90	4.4.4d	Double GPO beside mirror 4.4.4(d)	✓	✓	Can be compliant at post adaptation
TOILET					
92	4.4.3	Provision of either 'visitable toilet' or accessible toilet	✓	✓	Can be compliant at post adaptation
93	4.4.1	Provision to comply with AS 1428.1	✓	✓	Can be compliant at post adaptation
94	4.4.3	Location of WC pan at correct distance from fixed walls	✓	✓	Can be compliant at post adaptation
95	4.4.4b	Provision for grab rail zone. (Refer Figure 4.6)	✓	✓	Can be compliant at post adaptation

96	4.4.2	Slip resistant floor surface. (Vitreous tiles or similar)	✓	✓	Can be compliant at post adaptation
LAUNDRY					
98	4.8	Circulation at doors to comply with AS 1428.1	✓	✓	
99	4.8	Provision for adequate circulation space in front of or beside appliances (min. 1550 mm depth)	✓	✓	
100	4.8 e	Provision for automatic washing machine	✓	✓	Can be compliant at post adaptation
102	4.8a	Where clothes line is provided, an accessible path of travel to this	✓	✓	
105	4.8 g	Double GPO	✓	✓	Can be compliant at post adaptation
108	4.9.1	Slip-resistant floor surface	✓	✓	Can be compliant at post adaptation
DOORLOCKS					
110	4.3.4	Door hardware operable with one hand, located 900–1100 mm above floor	✓	✓	Can be compliant at post adaptation

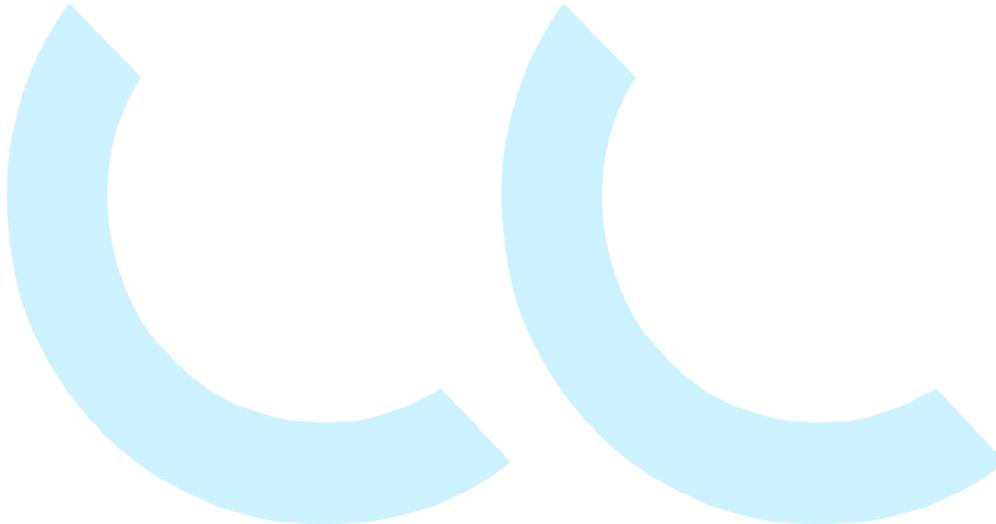


The references below to be read as set and referenced in each section of Adaptable Housing AS4299

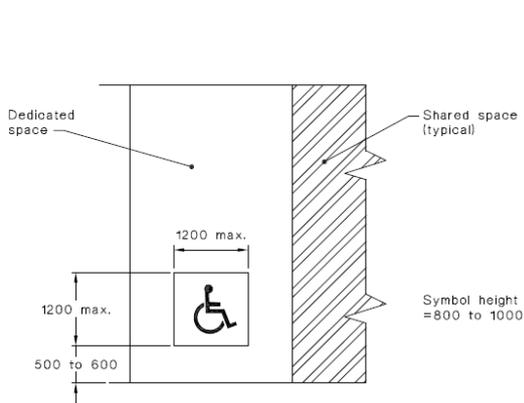


DIMENSIONS IN MILLIMETRES

Figure 41

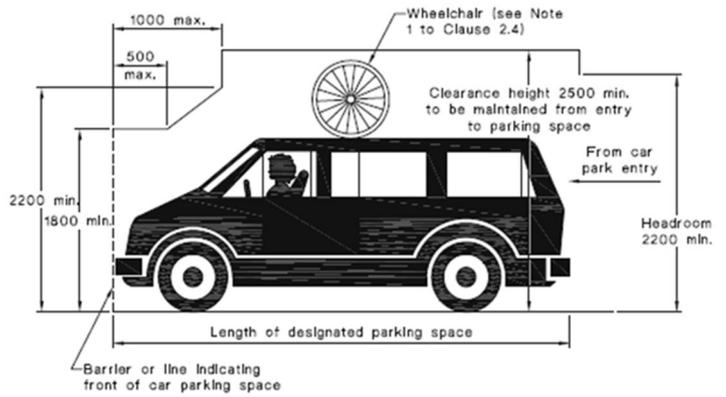


DIMENSIONS IN MILLIMETRES

SAI Global Ltd License 1704-c045-2

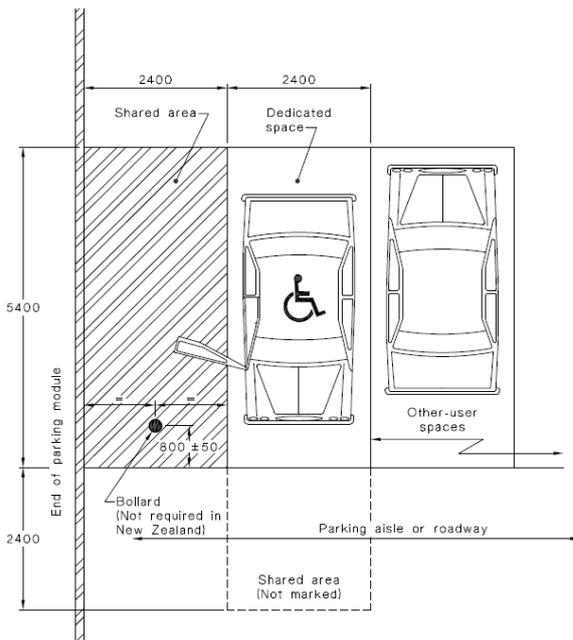


DIMENSIONS IN MILLIMETRES

Figure 42

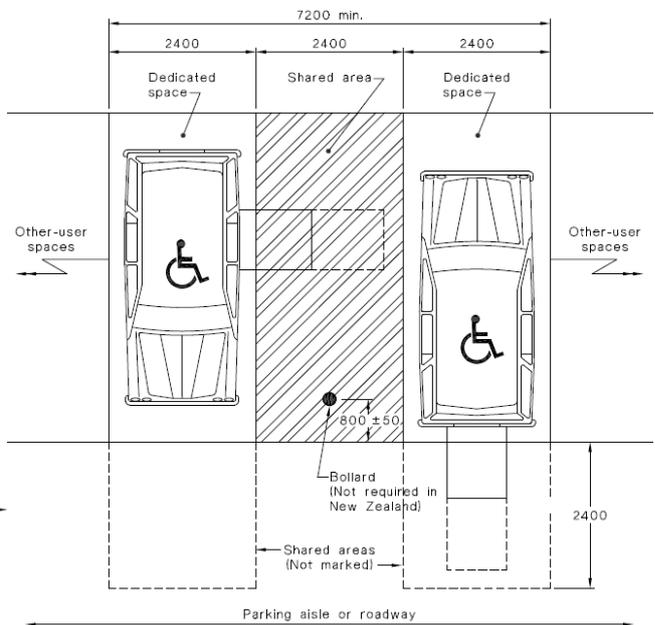

DIMENSIONS IN MILLIMETRES

SAI Global Ltd License 1704-c045-2

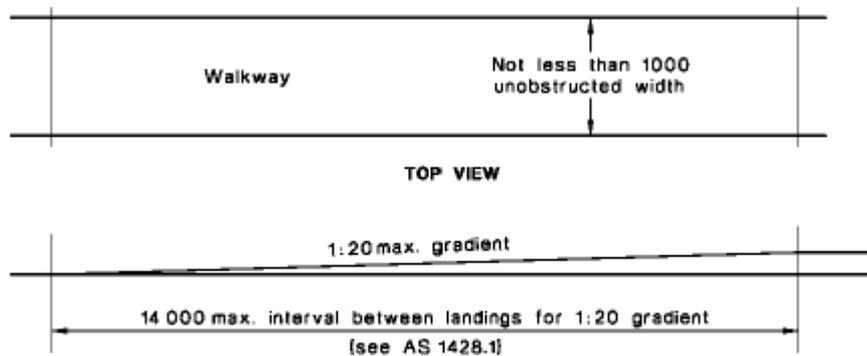

DIMENSIONS IN MILLIMETRES

Figure 43

SAI Global Ltd License 1704-c045-2



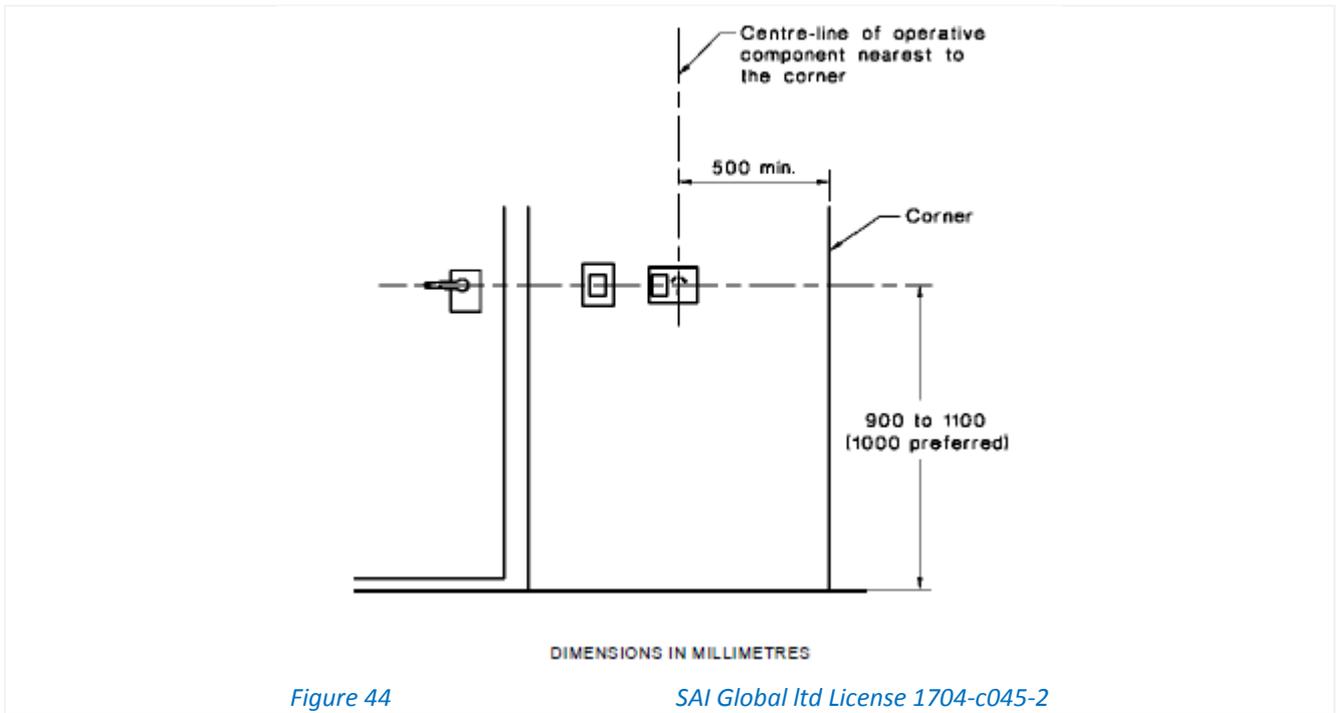


Figure 44

SAI Global Ltd License 1704-c045-2

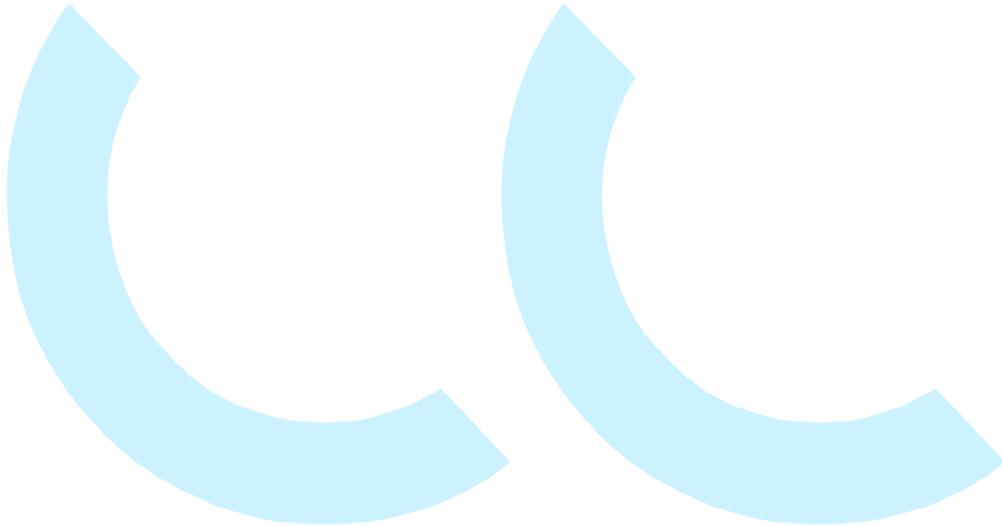


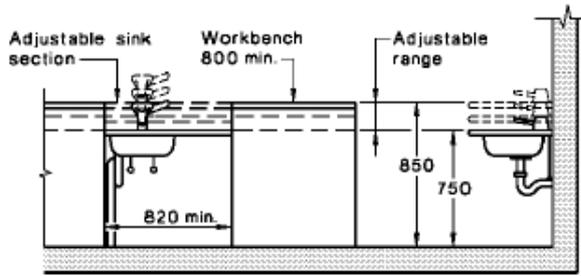

DIMENSIONS IN MILLIMETRES


FIGURE 4.9 SINKS AFTER MODIFICATION

Figure 39

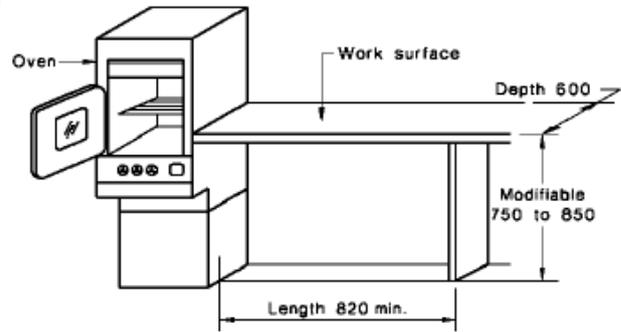


DIMENSIONS IN MILLIMETRES


SAI Global Ltd License 1704-c045-2

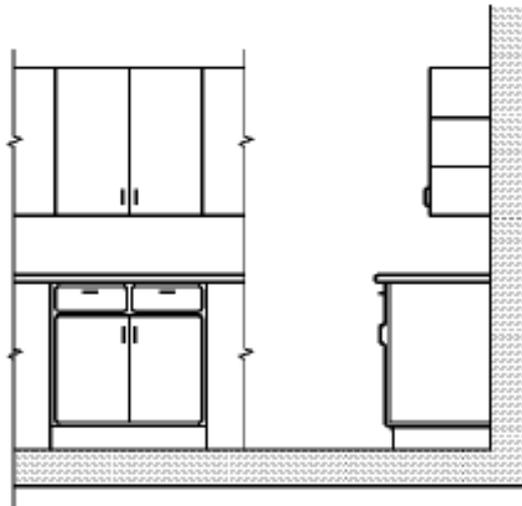

(a) Before removal of cabinets

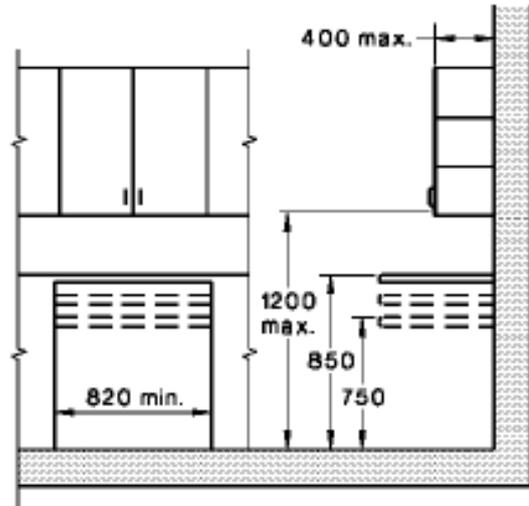

(b) After removal of cabinets

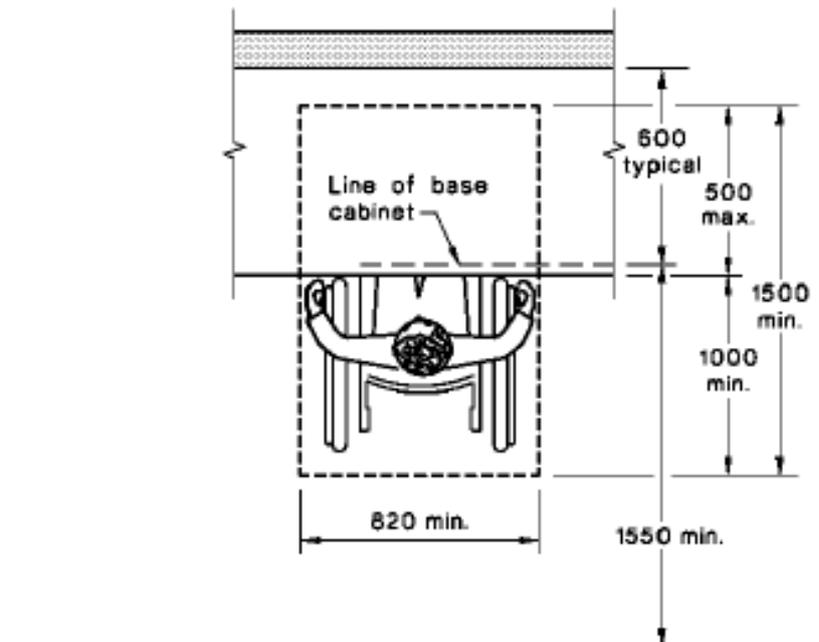

(c) Clear floor space under work surface

Figure 45

SAI Global Ltd License 1704-c045-2



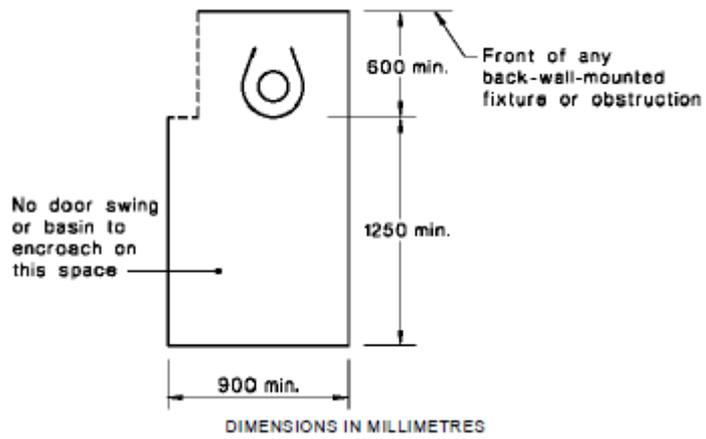


Figure 46

SAI Global Ltd License 1704-c045-2

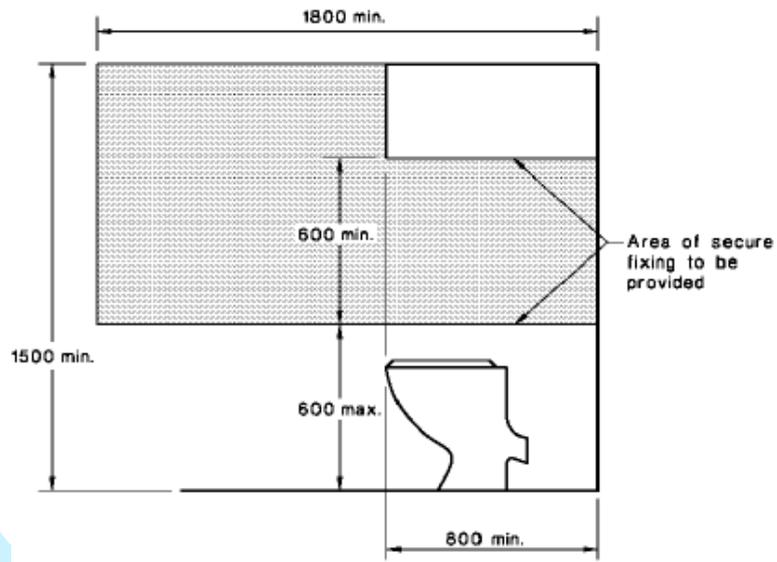

(a) Side view

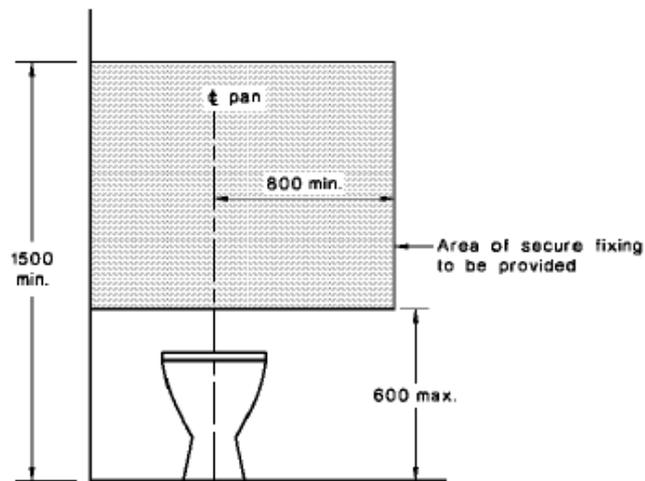


(b) Front view

DIMENSIONS IN MILLIMETRES


FIGURE 4.5 REINFORCED AREAS FOR SUBSEQUENT INSTALLATION OF GRABRAILS IN TOILETS

Figure 48

SAI Global Ltd License 1704-c045-2

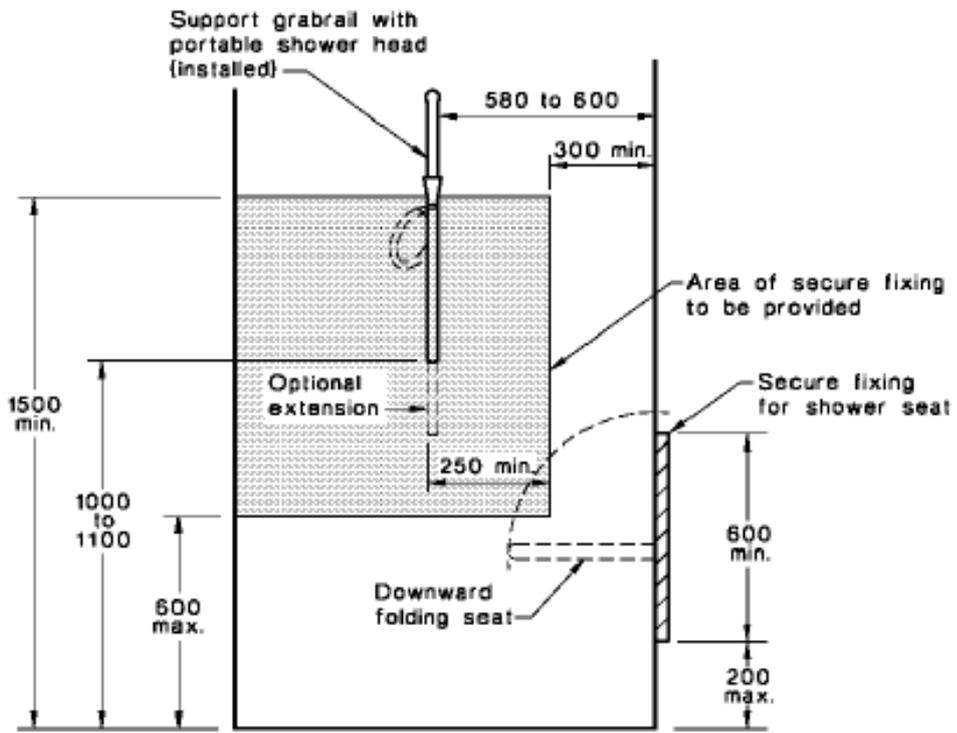

(a) Back wall

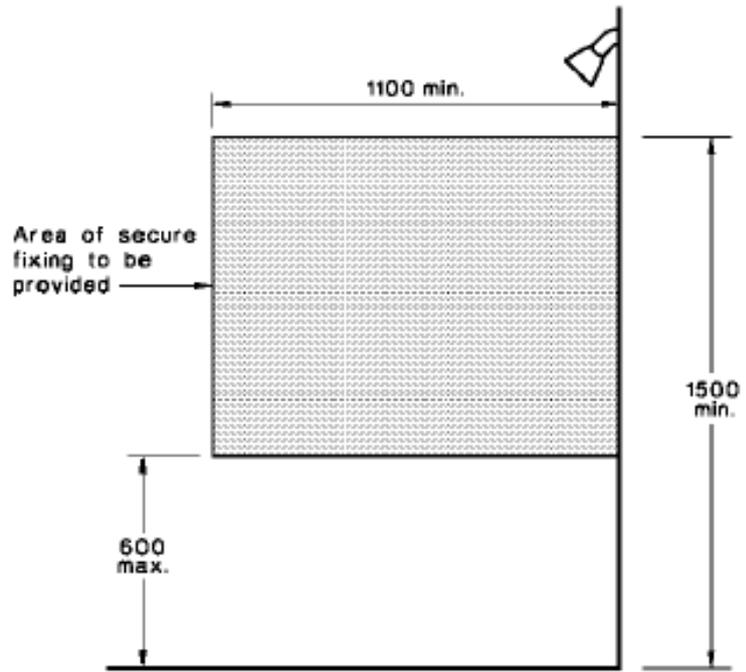

(b) Side wall

DIMENSIONS IN MILLIMETRES


Figure 49

SAI Global Ltd License 1704-c045-2


Adaptable Housing – Pre & Post Adaptable Units

The attachments below are extracted from the Architectural Plans provided and are to be read together with AS 4299 Adaptable Housing Requirements.


Pre & Post Adaptable Layout – Unit G.12A

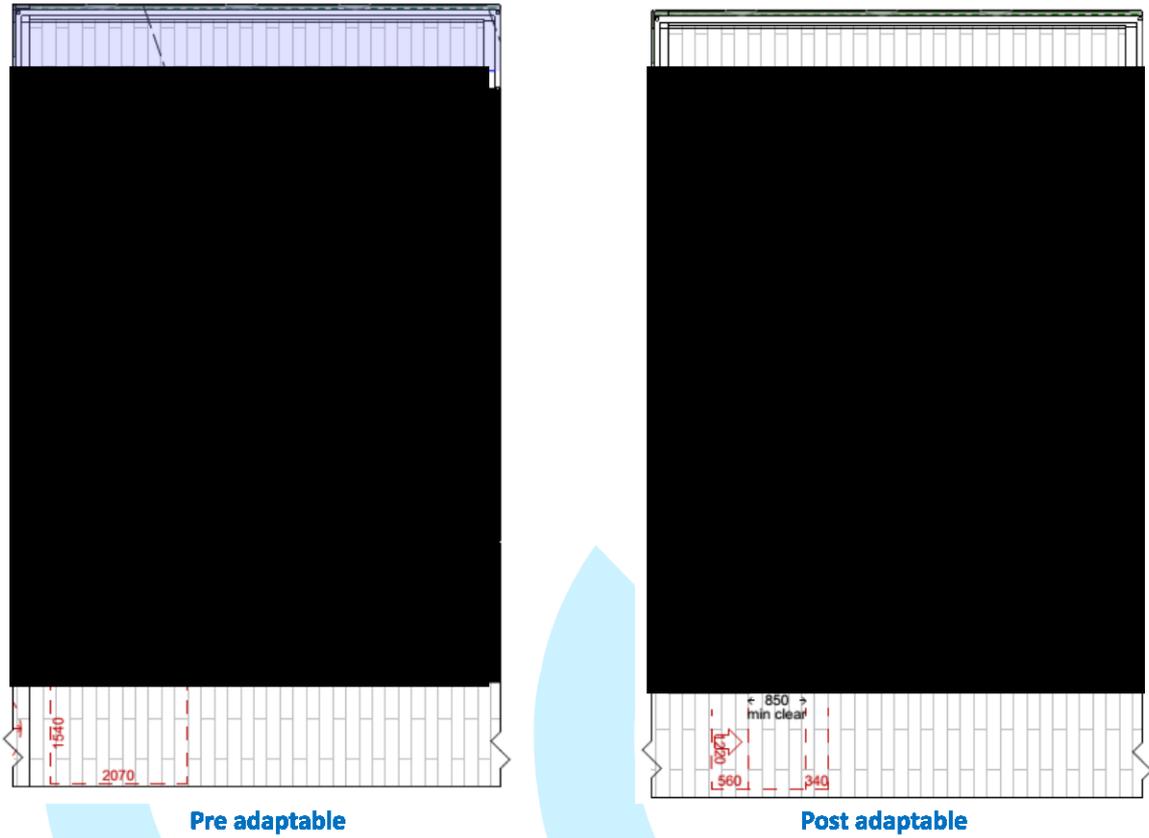


Typical Pre & Post Adaptable Layouts – Units G.14A, L1.14A, L2.14A, L3.14A, L4.14A

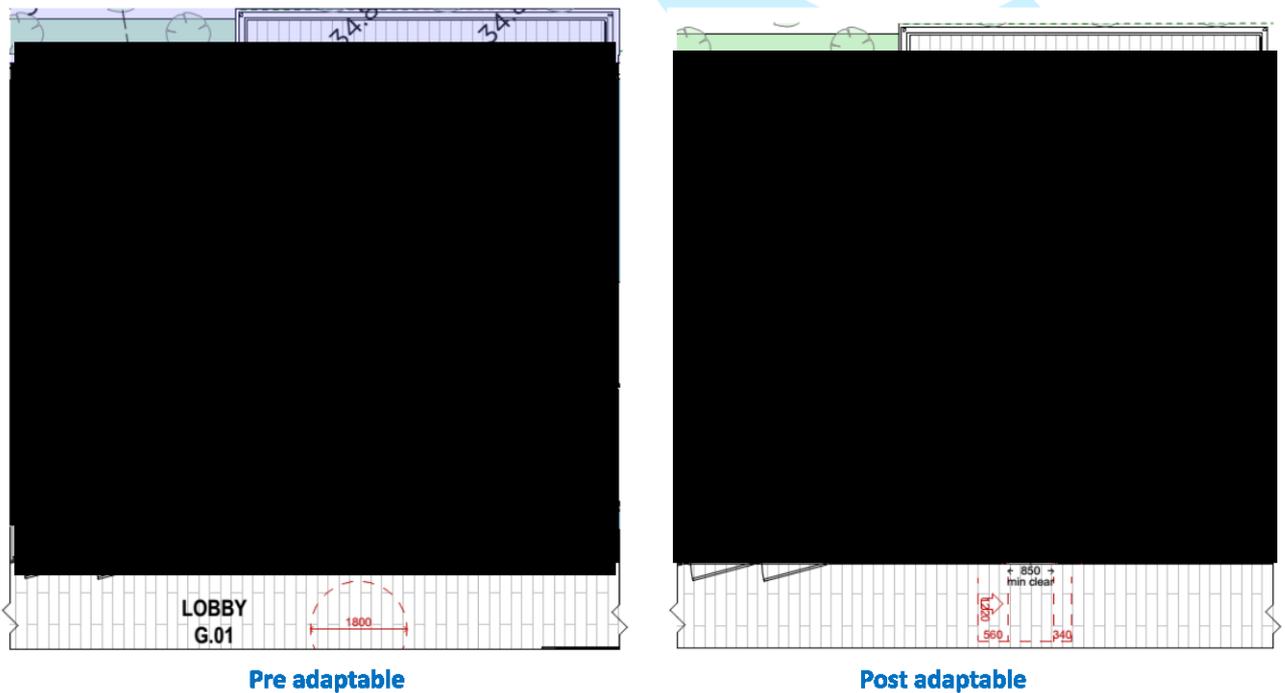

Pre & Post Adaptable Layout – Unit G.01A

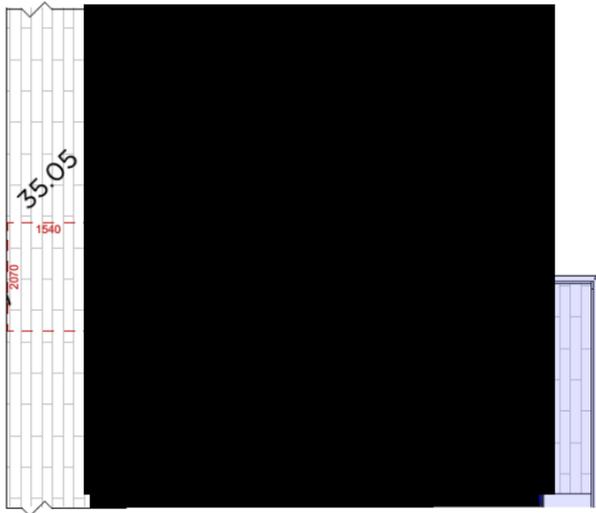


Pre adaptable

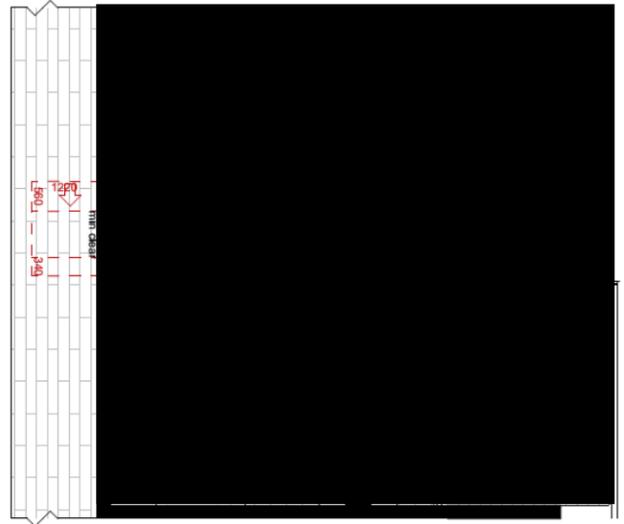


Post adaptable

Pre & Post Adaptable Layout – Unit G.03A

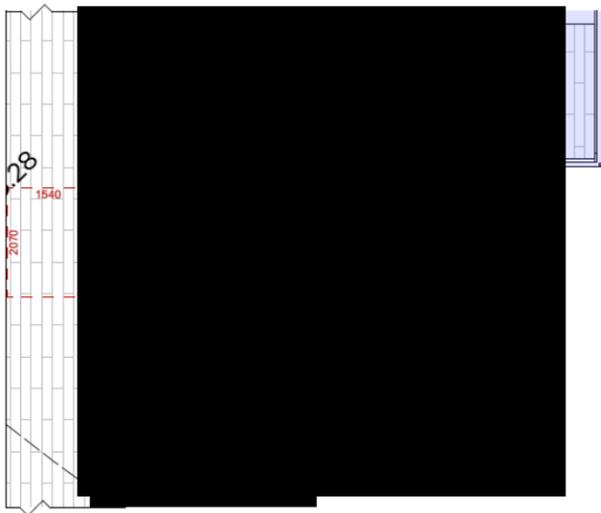


Pre adaptable

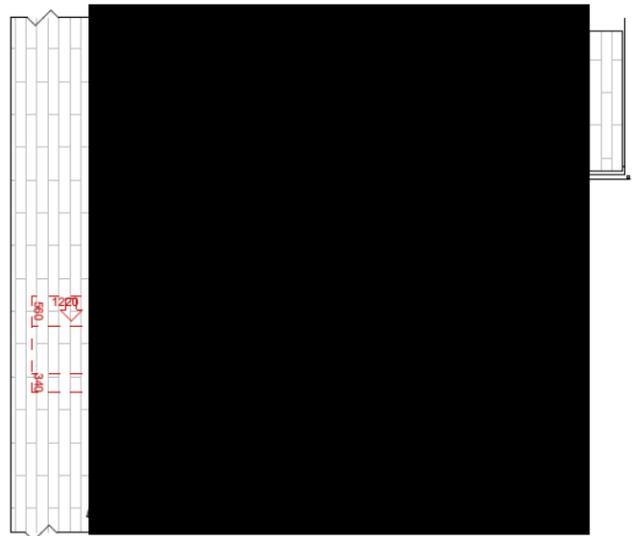

Post adaptable

Typical Pre & Post Adaptable Layouts – Units G.06A, L1.06A, L2.06A, L3.06A, L4.0A

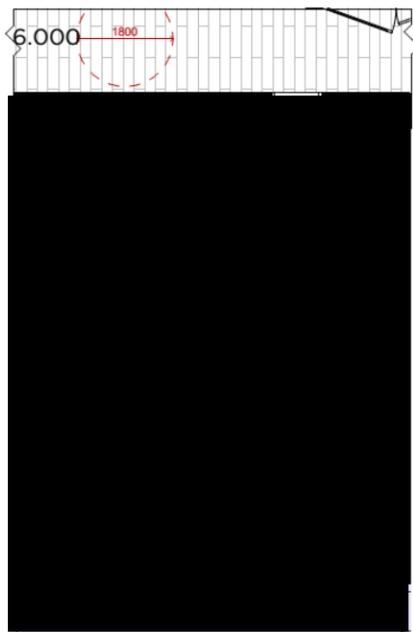


Pre adaptable




Post adaptable

Pre & Post Adaptable Layout – Unit G.09B

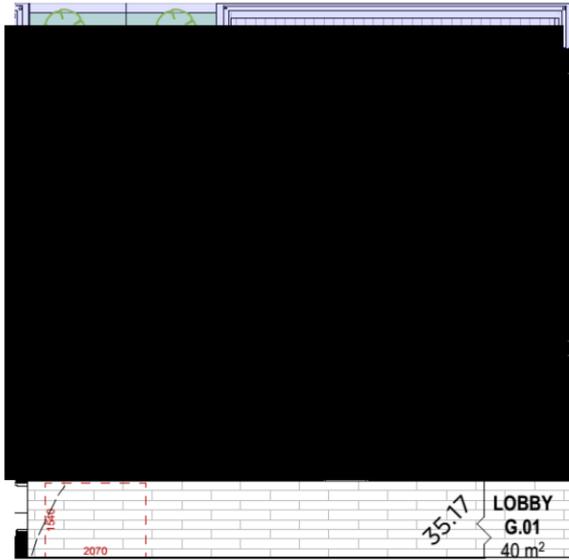


Pre adaptable

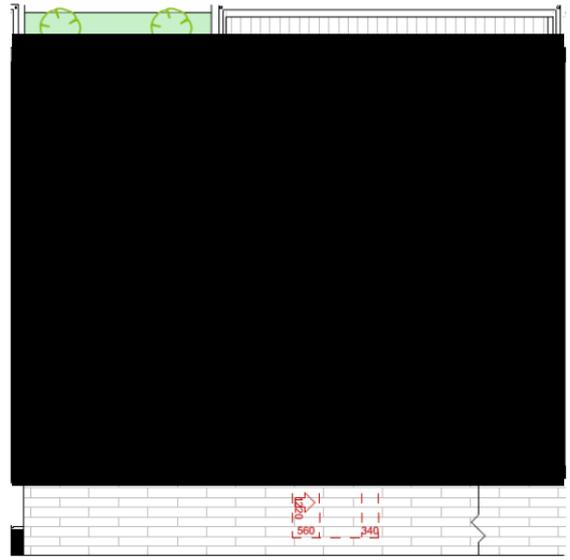

Post adaptable

URBAN Link Plans Issue A dated 27.11.20

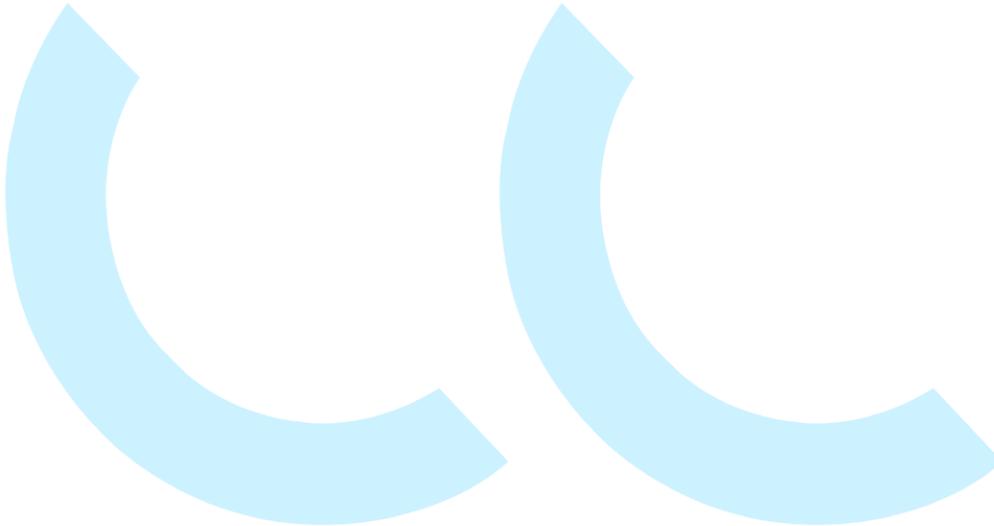


SEPP 65 – Part 4Q1 Livable Housing Guidelines

As per SEPP 65, 20% of the units are to be designed as 'Livable'. The development proposes 133 Units which require 27 Units to be designed as 'Livable', being units G.12A, G.01A, G.02A, G.03A, G.06A, L1.06A, L2.06A, L3.06A, L4.06A, G.13A, G.14A, G.09A, G.09B, L1.14A, L1.13A, L1.09A, L1.09B, L2.14A, L2.13A, L2.09A, L2.09B, L3.14A, L3.13A, L3.09A, L3.09B, L4.14A, L4.09A

1. A safe continuous and step free path of travel from the street entrance and/ or parking area to a dwelling entrance that is level	ADR	N/A	C
<p>a. Provide a safe and continuous pathway from:</p> <ul style="list-style-type: none"> I. the front boundary of the allotment; or II. a car parking space, where provided, which may include the driveway on the allotment, to an entrance that is level (step-free) <p>This provision does not apply where the average slope of the ground where the path would feature is steeper than 1:14. Reference: Notes: See layouts below</p>	<input type="checkbox"/> <input type="checkbox"/>	<input type="checkbox"/> <input type="checkbox"/>	<input checked="" type="checkbox"/> <input checked="" type="checkbox"/>
<p>b. The path of travel as referred to in (a) should have a minimum clear width of 1000mm and –</p> <ul style="list-style-type: none"> I. an even, firm, slip resistant surface; II. a cross fall of not more than 1:40; III. A maximum pathway slope of 1:14, with landings provided at no greater than 9m for a 1:14 ramp and no greater than 15m for ramps steeper than 1:20. Landings should be no less than 200mm in length; and IV. be step-free 	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>
<p>c. A step ramp may be incorporated at an entrance doorway where there is a change in height of 190mm or less. The step ramp should provide:</p> <ul style="list-style-type: none"> I. a maximum gradient of 1:10 II. a minimum clear width of 1000mm (please note: width should reflect the pathway width) III. a maximum length of 1900mm <p>Level landings no less than 1200mm in length, exclusive of the swing of the door or gate than opens onto them, must be provided at the head and foot of the ramp.</p>	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>
2. At least one, level (Step free) entrance into the dwelling			
<p>a. The dwelling should provide an entrance door with –</p> <ul style="list-style-type: none"> I. a minimum clear opening width of 820mm (see Figure 2(a)); II. a level (step-free) transition and threshold (maximum vertical tolerance of 5mm between abutting surfaces is allowable provided the lip is rounded or bevelled); and III. Reasonable shelter from the weather. <p>Reference: Figure 50 Notes: Notes on plans – can be compliant at CC stage</p>	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>
<p>b. A level landing area of 1200mm x 1200mm should be provided at the level (step-free) entrance door.</p>	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>
<p>c. Where the threshold at the entrance exceeds 5mm and is less than 56mm, a ramped threshold may be provided.</p>	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>
<p>d. The level (step-free) entrance should be connected to the safe and continuous pathway.</p>	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>
3. Car parking			
<p>a. Where the parking area forms part of the dwelling access the space should incorporate:</p> <ul style="list-style-type: none"> I. minimum dimensions of at least 3200mm (width) x 5400mm (length); II. an even, firm and slip resistant surface; and III. A level surface (1:40 maximum gradient, 1:33 maximum gradient for bitumen). 	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>

Notes: Proposed parking spaces comply with AS4299 & AS2890.6			
4. Internal doors and corridors that facilitate comfortable and unimpeded movement between spaces.			
a. Doorways to rooms on the entry level used for living, dining, bedroom, bathroom, kitchen, laundry and sanitary compartment purposes should provide:			
I. a minimum clear opening width of 820mm (see Figure 2(a)); and			
II. A level transition and threshold (maximum vertical tolerance of 5mm between abutting surfaces is allowable provided the lip is rounded or bevelled).	<input type="checkbox"/>	<input type="checkbox"/>	✓
Reference: Figure 50 Notes: Notes on plans			
b. Internal corridors/passageways to the doorways referred to in (a) should provide a minimum clear width of 1000mm.	<input type="checkbox"/>	<input type="checkbox"/>	✓
5. A toilet on the ground (or entry) level that provides easy access.			
a. Dwellings should have a toilet on the ground (or entry) level that provides:			
I. a minimum clear width of 900mm between the walls of the bathroom if located in a separate room; and			
II. A minimum 1200mm clear circulation space forward of the toilet pan exclusive of the swing of the door in accordance with Figure 3(a).	<input type="checkbox"/>	<input type="checkbox"/>	✓
Reference: Figure 51 Notes: Notes on plans			
b. If the toilet is located within the ground (or entry) level bathroom, the toilet pan should be located in the corner of the room to enable the installation of grab rails.	<input type="checkbox"/>	<input type="checkbox"/>	✓
Reference: Figure 52, Figure 53 Notes: Notes on plans			
6. A bathroom that contains a hob-less (step-free) shower recess.			
a. One bathroom should feature a slip resistant, hobless (step-free) shower recess. Shower screens are permitted provided they can be easily removed at a later date.	<input type="checkbox"/>	<input type="checkbox"/>	✓
b. The shower recess should be located in the corner of the room to enable the installation of grab rails at a future date.	<input type="checkbox"/>	<input type="checkbox"/>	✓
Reference: Figure 55 Notes: Notes on plans			
7. Reinforced walls around the toilet, shower and bath to support the safe installation of grab rails at a later date			
a. Except for walls constructed of solid masonry or concrete, the walls around the shower, bath (if provided) and toilet should be reinforced to provide a fixing surface for the safe installation of grab rails.	<input type="checkbox"/>	<input type="checkbox"/>	✓
Reference: Figure 54, Figure 55 Notes: Notes on plans			
b. The fastenings, wall reinforcement and grab rails combined must be able to withstand 1100N of force applied in any position and in any direction.	<input type="checkbox"/>	<input type="checkbox"/>	✓
Notes: Notes on plans – Can be compliant at CC stage			
c. The walls around the toilet are to be reinforced by installing:	<input type="checkbox"/>	<input type="checkbox"/>	✓
I. noggings with a thickness of at least 25mm in accordance with Figure 6(a); or			
II. Sheeting with a thickness of at least 12mm in accordance with Figure 6(b).			
Reference: Figure 53 Notes: Notes on plans – Can be compliant at CC stage			
d. The walls around the bath are to be reinforced by installing:	<input type="checkbox"/>	✓	<input type="checkbox"/>

noggings with a thickness of at least 25mm in accordance with Figure I. 7(a); or II. Sheeting with a thickness of at least 12mm in accordance with Figure 7(b). Notes: No bathtub proposed			
e. The walls around the hobless (step-free) shower recess are to be reinforced by installing: I. noggings with a thickness of at least 25mm in accordance with Figure 8(a); or II. Sheeting with a thickness of at least 12mm in accordance with Figure 8(b). Reference: Figure 54 Notes: Notes on plans – Can be compliant at CC stage	☐	☐	☐
8. A continuous handrail on one side of any stairway where there is a rise of more than one metre.			
a. Stairways in dwellings must feature: I. A continuous handrail on one side of the stairway where there is a rise of more than 1m. Notes: Notes: There are no internal stairways	☐	☐	☐

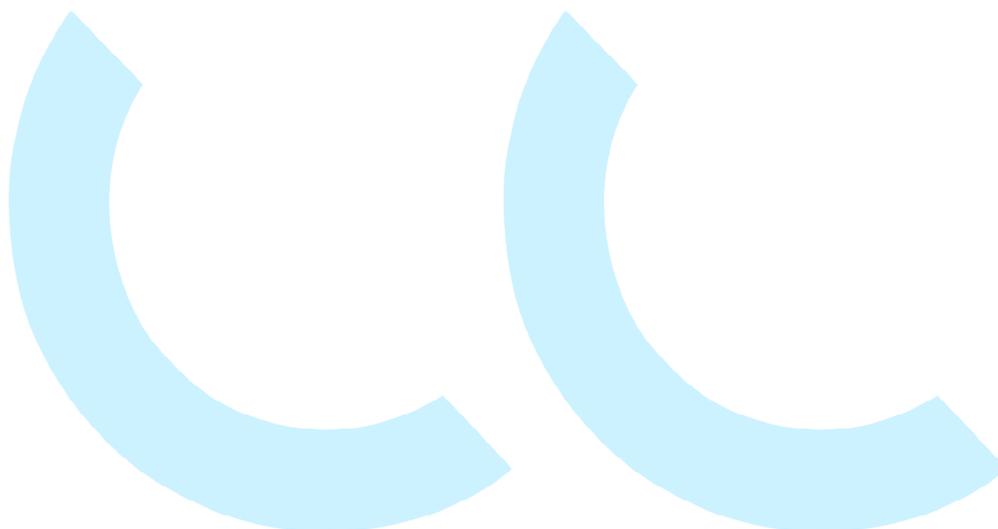

The references below are to be read as set and referenced in each section of the SEPP 65 Part 4Q1

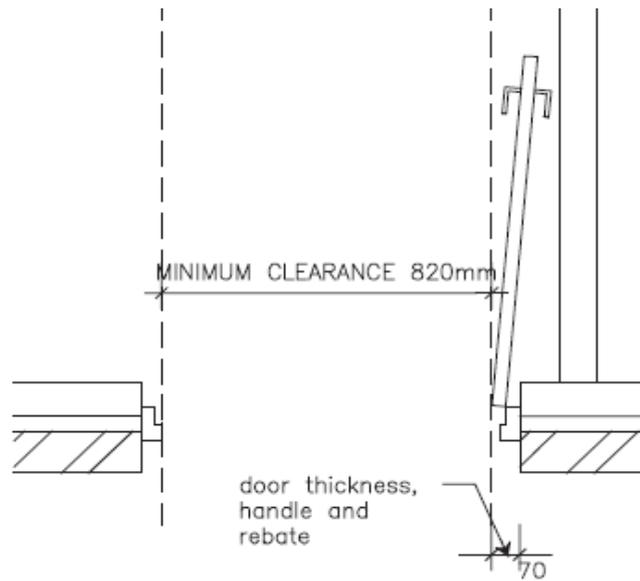


Figure 2(a) Silver level clear door opening

Figure 50

SAI Global Ltd License 1704-c045-2

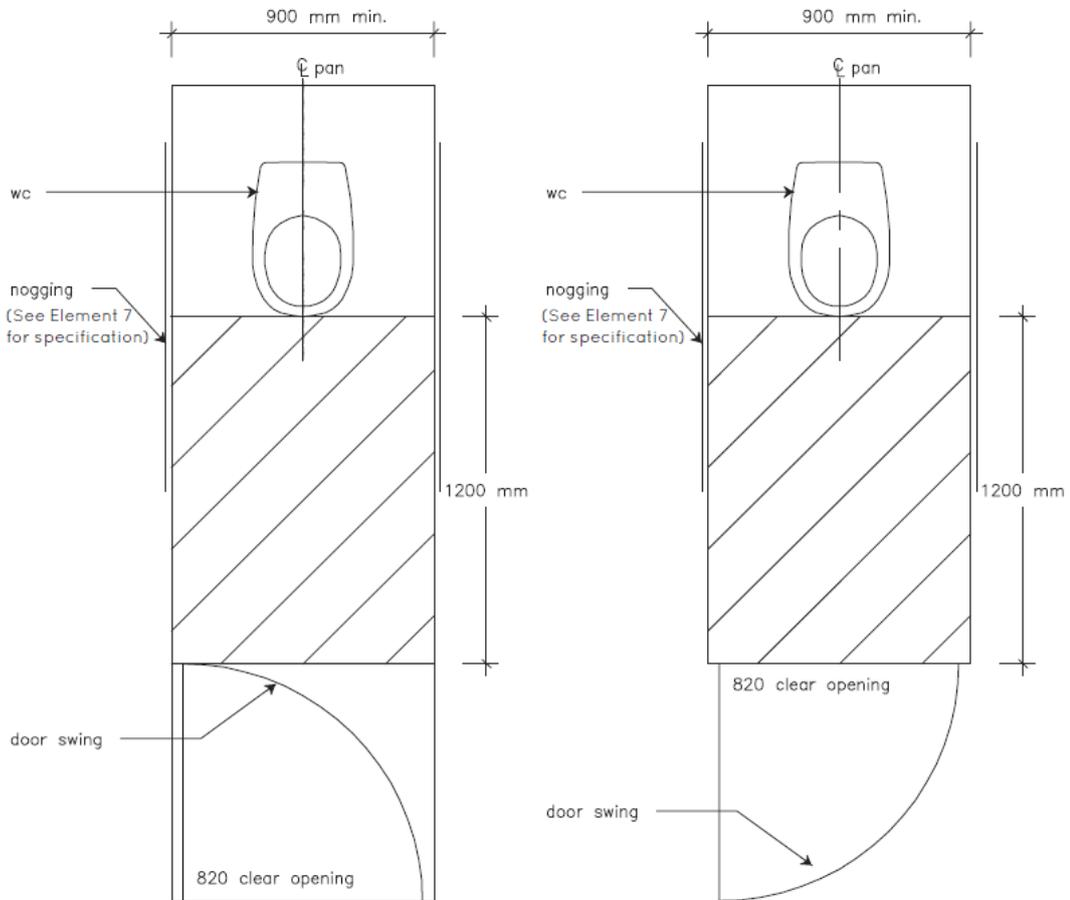


Figure 51

SAI Global Ltd License 1704-c045-2


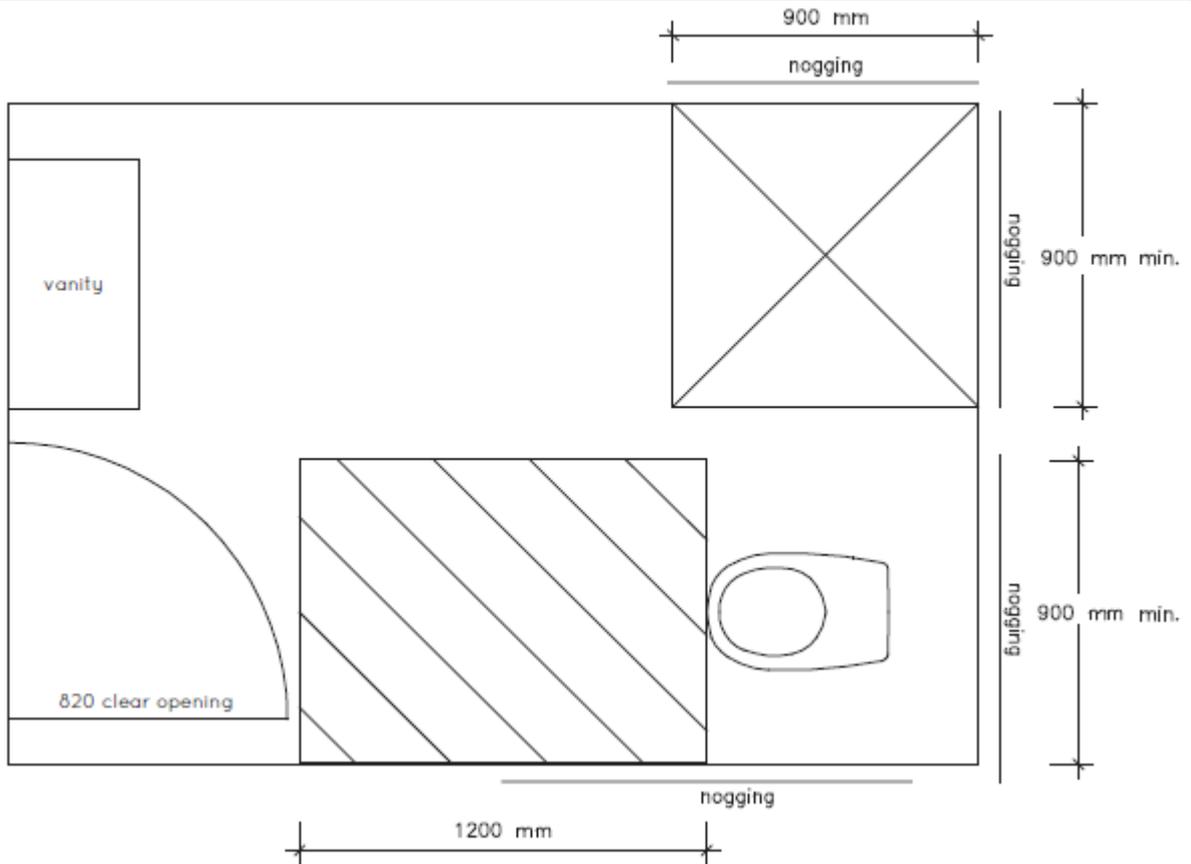


Figure 3(b) Silver level ground (or entry) level toilet layout and space requirements in a combined bathroom.

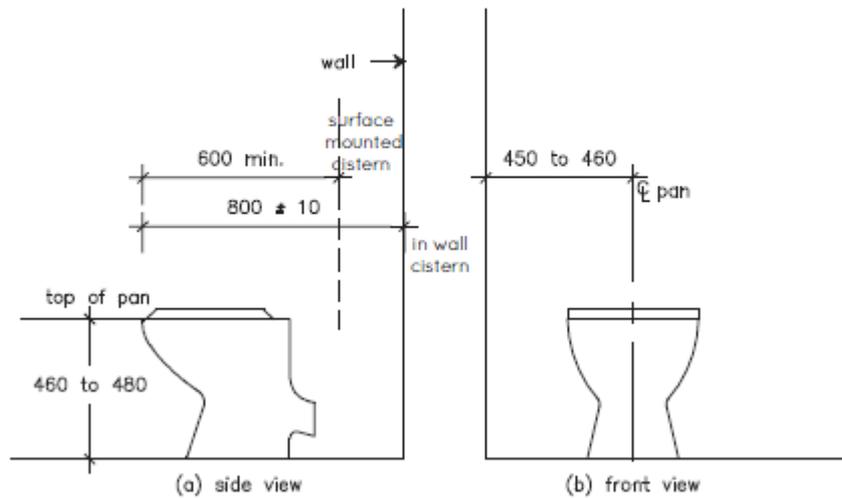

note: for the purpose of dimensioning, the front of the wc pan has been used as the datum plane
 dimensions in millimetres

Figure 52

SAI Global Ltd License 1704-c045-2

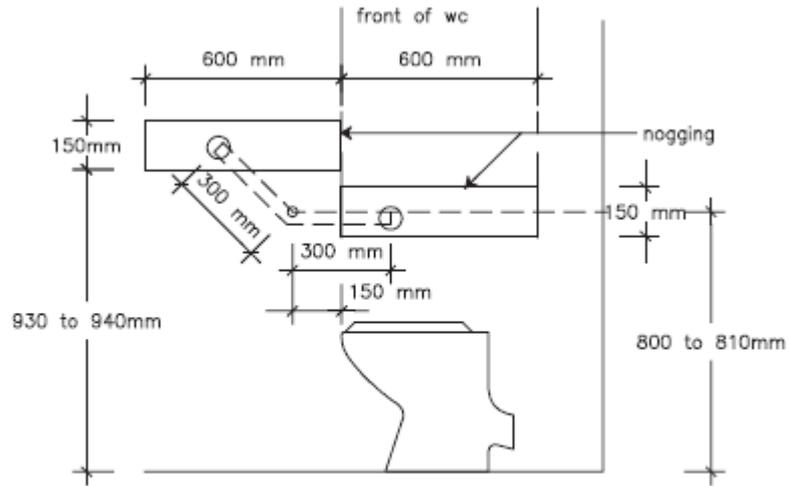


Figure 6(a) Toilet – Location of noggings

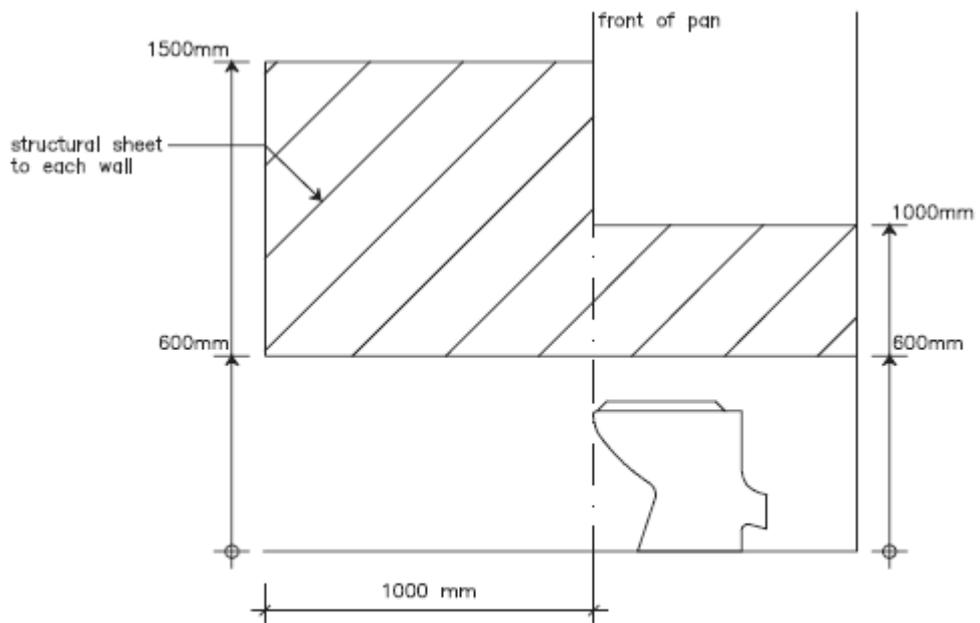


Figure 6(b) Toilet – Location of sheeting

Figure 53

SAI Global Ltd License 1704-c045-2

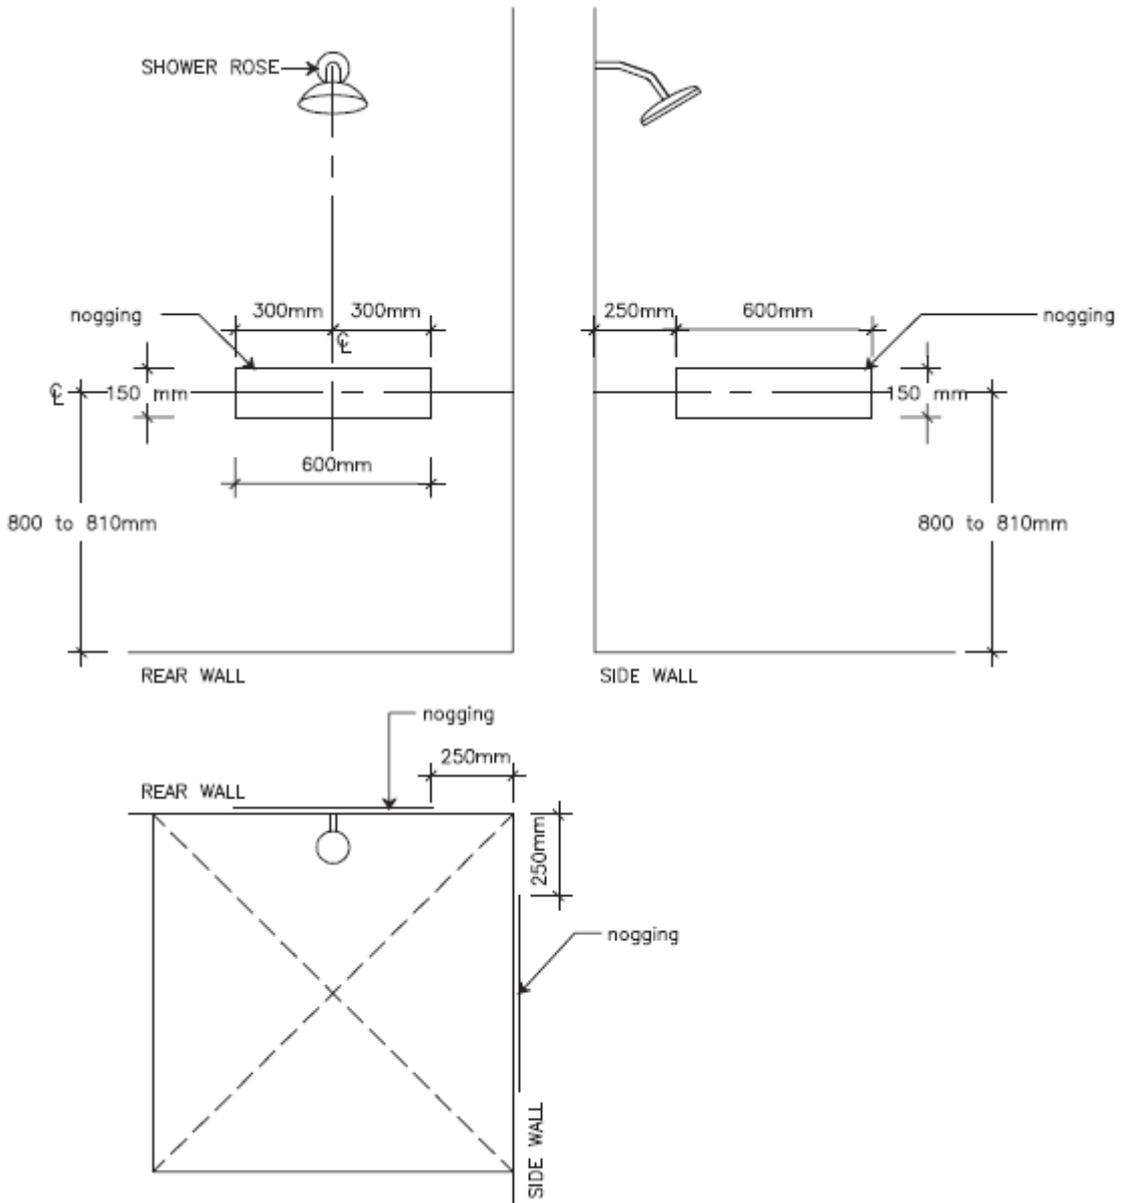


Figure 8(a) Shower recess – Location of noggings

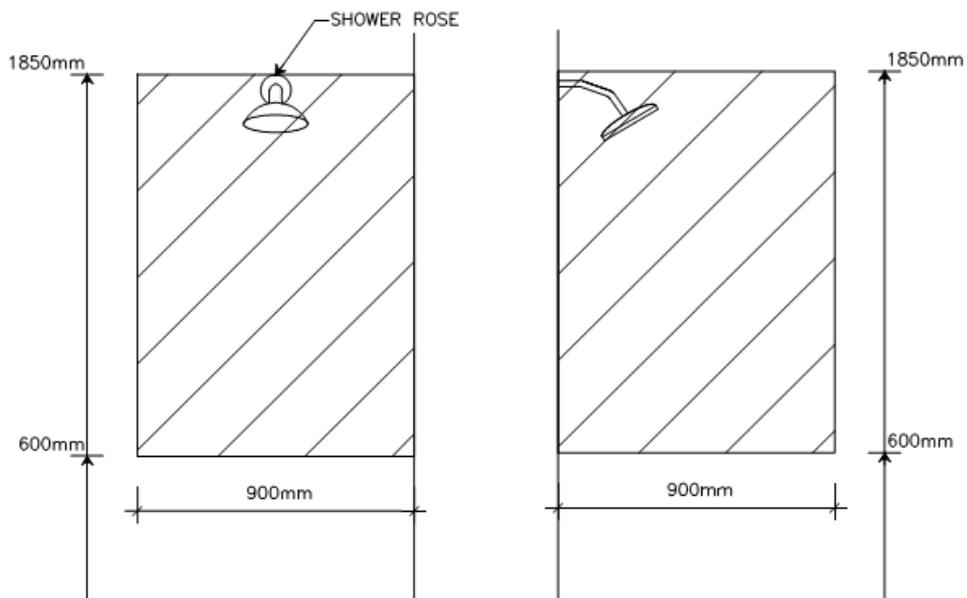


Figure 54

SAI Global Ltd License 1704-c045-2



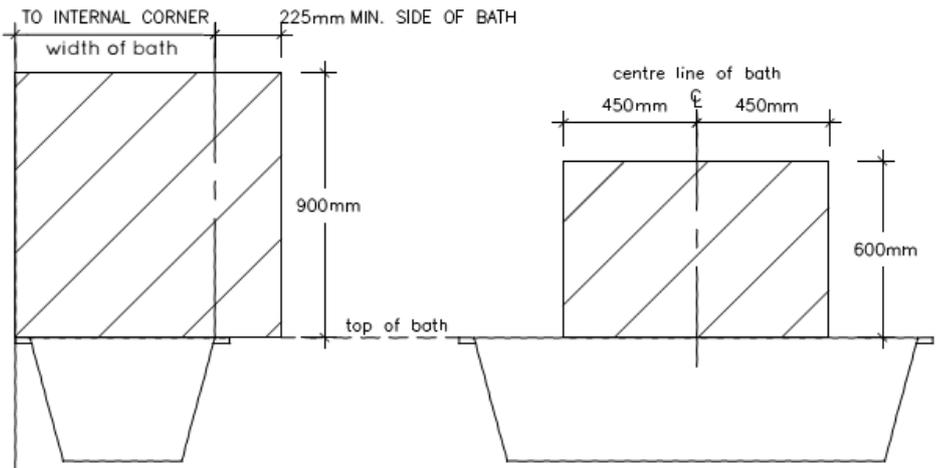


Figure 55


SAI Global Ltd License 1704-c045-2

The Livable units below are to be read in conjunction with each section of the SEPP 65 Part 4Q1


Liveable Unit G.12A

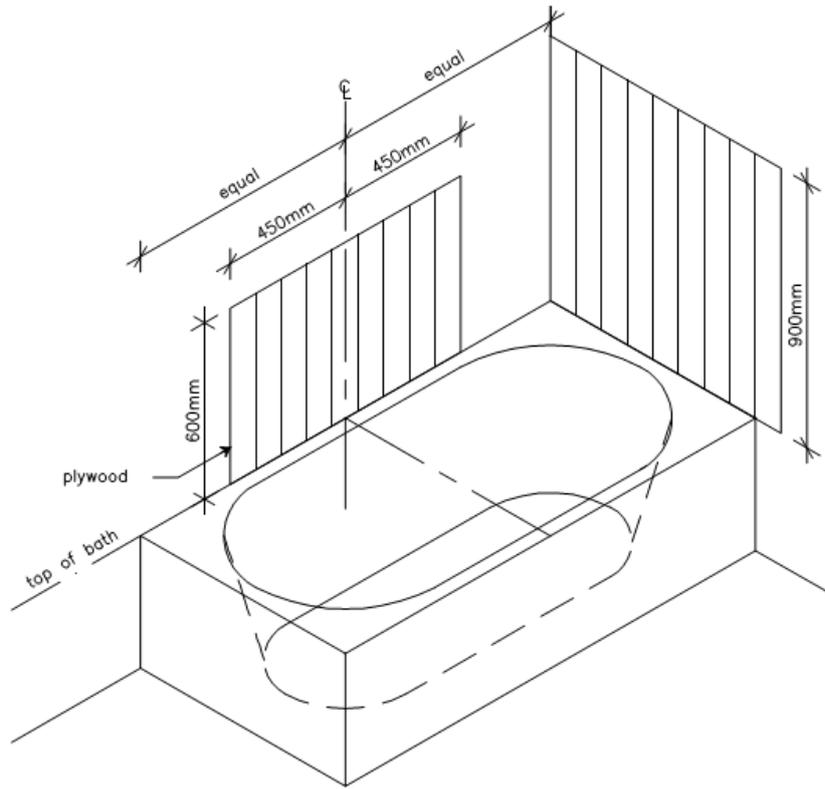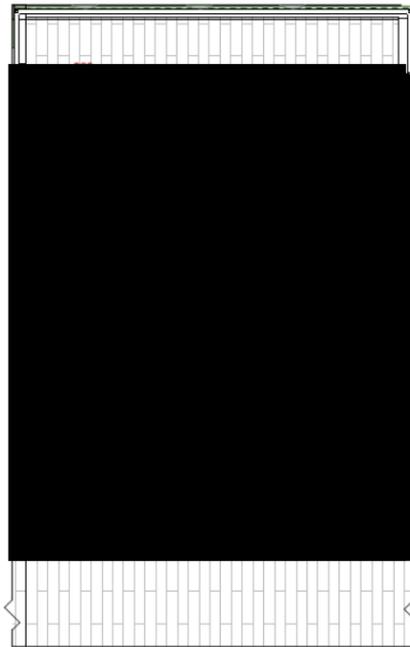


Liveable Unit G.13A

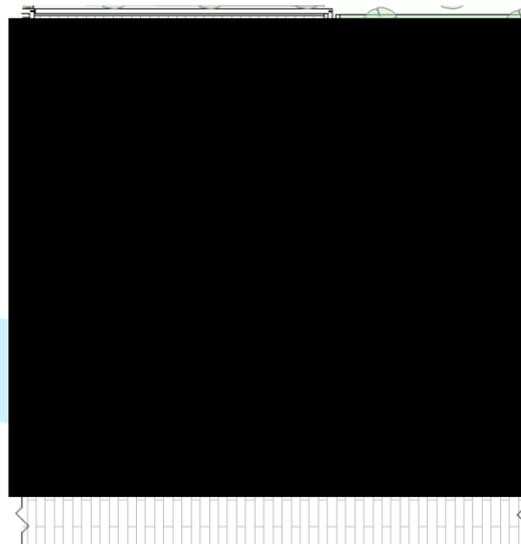


Liveable Units G.14A, L1.14A, L2.14A, L3.14A, L4.14A

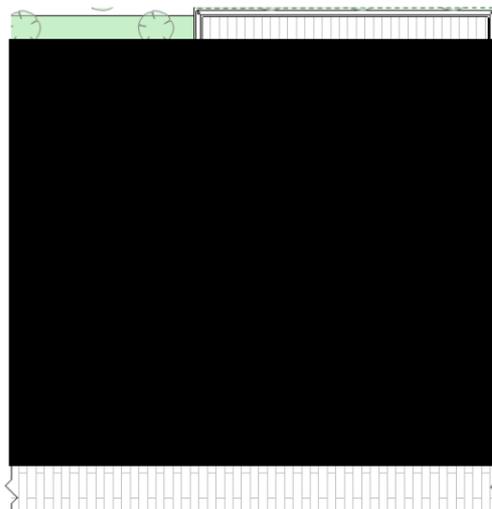


Liveable Unit G.01A

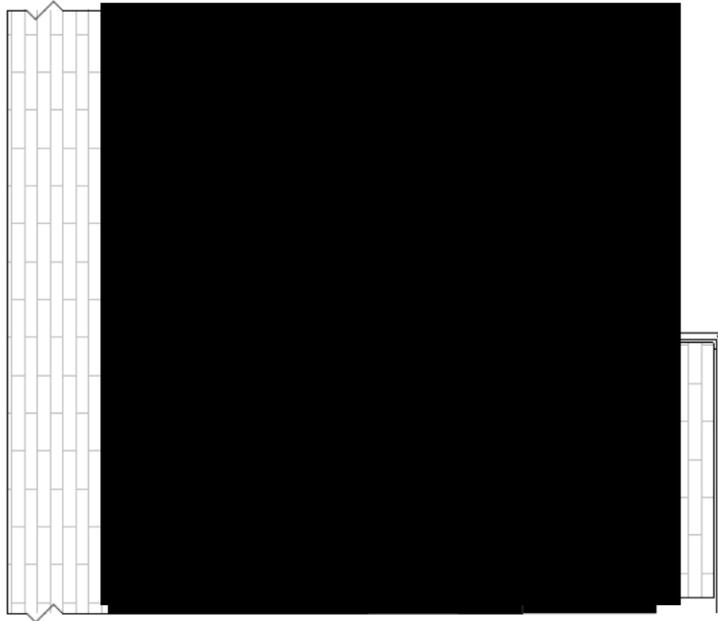


Liveable Unit G.02A

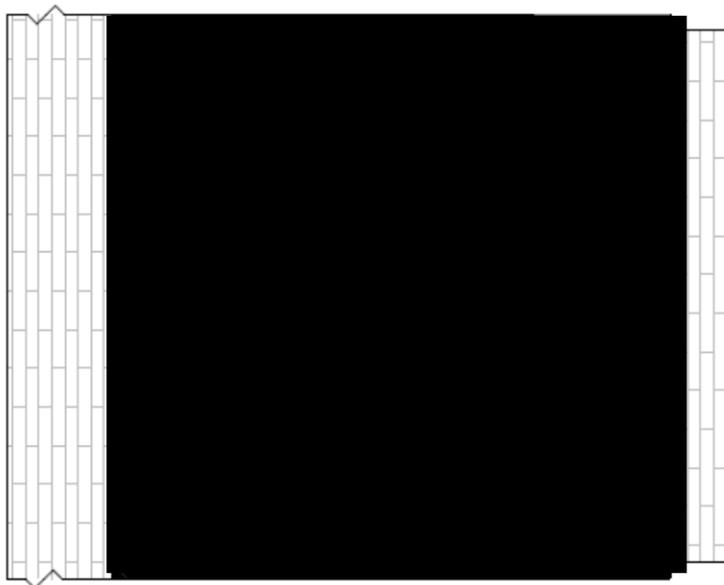


Liveable Unit G.03A

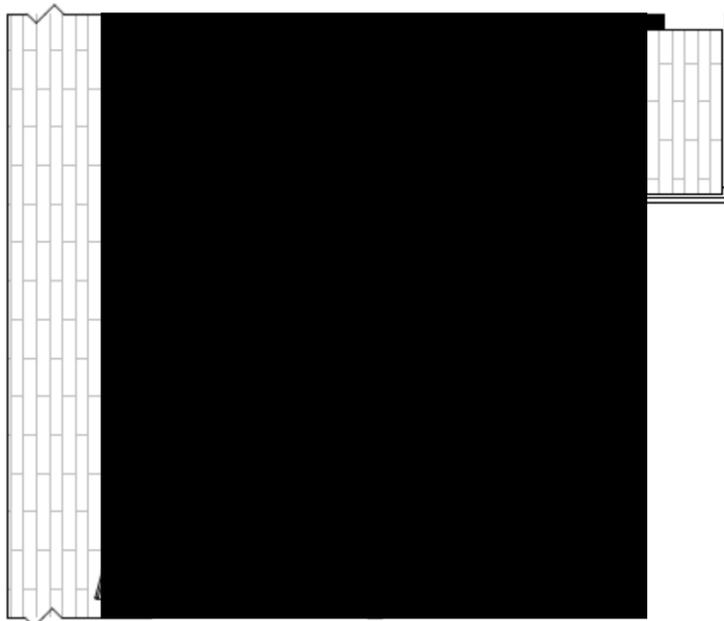


Liveable Units G.06A, L1.06A, L2.06A, L3.06A, L4.06A

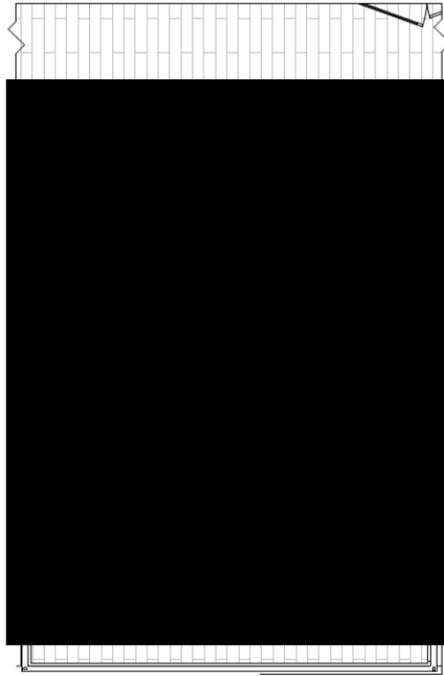


Liveable Unit G.09B

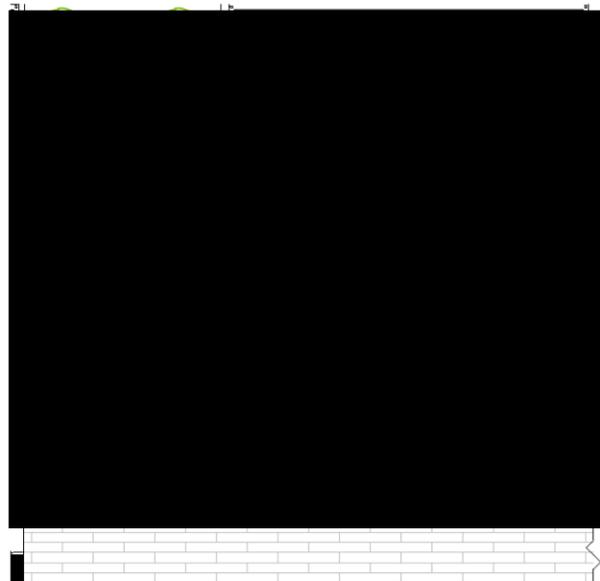

Liveable Units L1.13A, L2.13A, L3.13A

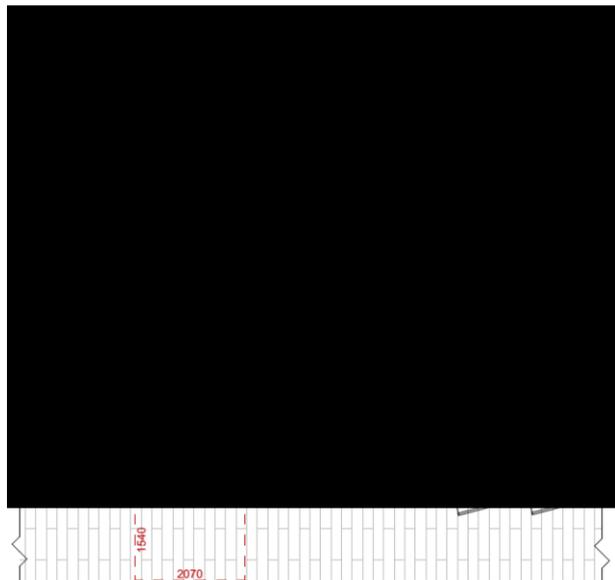

Liveable Units G.09A, L1.09A, L2.09A, L3.09A, L4.09A

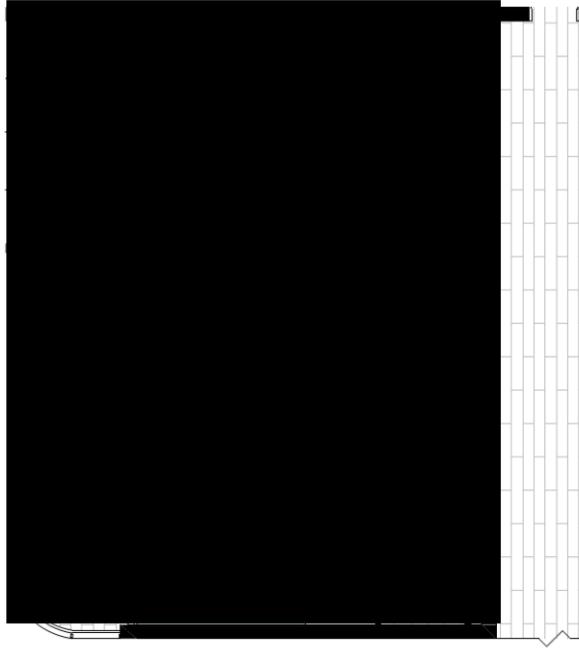

Liveable Units L1.09B, L2.09B, L3.09B



URBAN Link Plans Issue A dated 27.11.20

Advisory Only


The Disability Discrimination Act (1992) (DDA) protects everyone in Australia against discrimination based on disability ranging from, but not limited to mobility, sensory and cognitive disabilities. There is no doubt that the introduction of the Premises Standards has led to widespread and important improvements in the accessibility world and safety of all new and upgraded public buildings in Australia.

Section 32 of the DDA makes it unlawful to contravene a provision of a disability standard & the persons responsible who fail to address the 'affected part' requirements when triggered for a building could be subject to complaint under the DDA as a result.

If there is a difference between the technical requirements of the Access Code and any document referenced in the Access Code, including Australian Standards, the Access Code takes precedence.

The basic trigger for the application of the Premises Standards is when any building work is undertaken that requires building/construction approval. A building certifier, building developer or building manager of a relevant building must ensure that the building complies with the Access to Premises Standards.

The scope of the DDA also includes the area of the room measured within the finished surfaces of the walls, and includes the area occupied by any cupboard or other built-in furniture, fixture, or fittings.

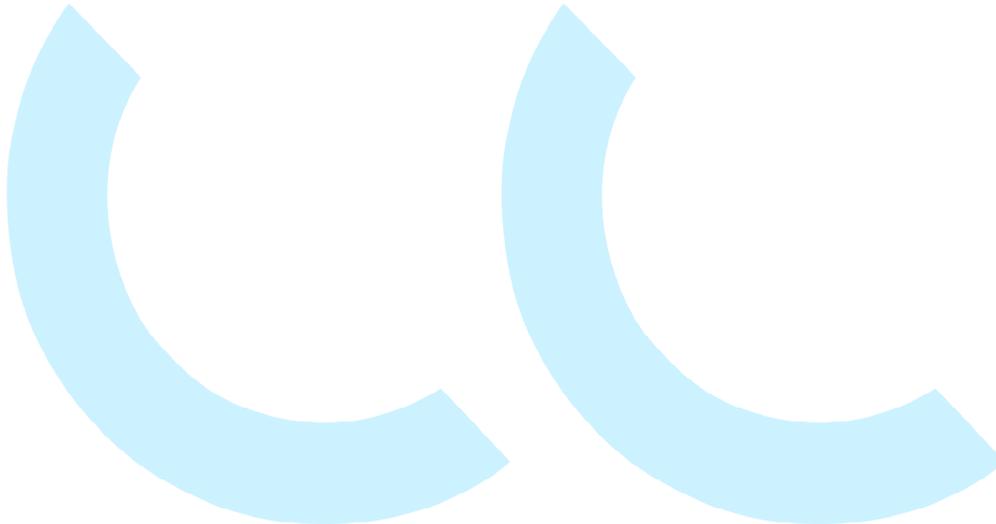

a: L10, 11-15 Deane St, Burwood NSW 2134

e: contact@accesslink.com.au

t: (02) 8319 4646

accesslink.com.au