

DATE PLOTTED: 9 March 2021 2:47 PM BY: KUMPLE PATEL




Cardno (NSW/ACT) Pty Ltd | ABN 95 001 145 035  
 Level 9, The Forum, 203 Pacific Highway  
 St. Leonards, NSW 2065  
 Tel: 02 9496 7700 Fax: 02 9439 5170  
 Web: www.cardno.com.au

BREAKSPEAR ARCHITECTS

# REGATTA PARK KIOSK

## EMU PLAINS

### COVER SHEET, LOCALITY PLAN AND SCHEDULE OF DRAWINGS

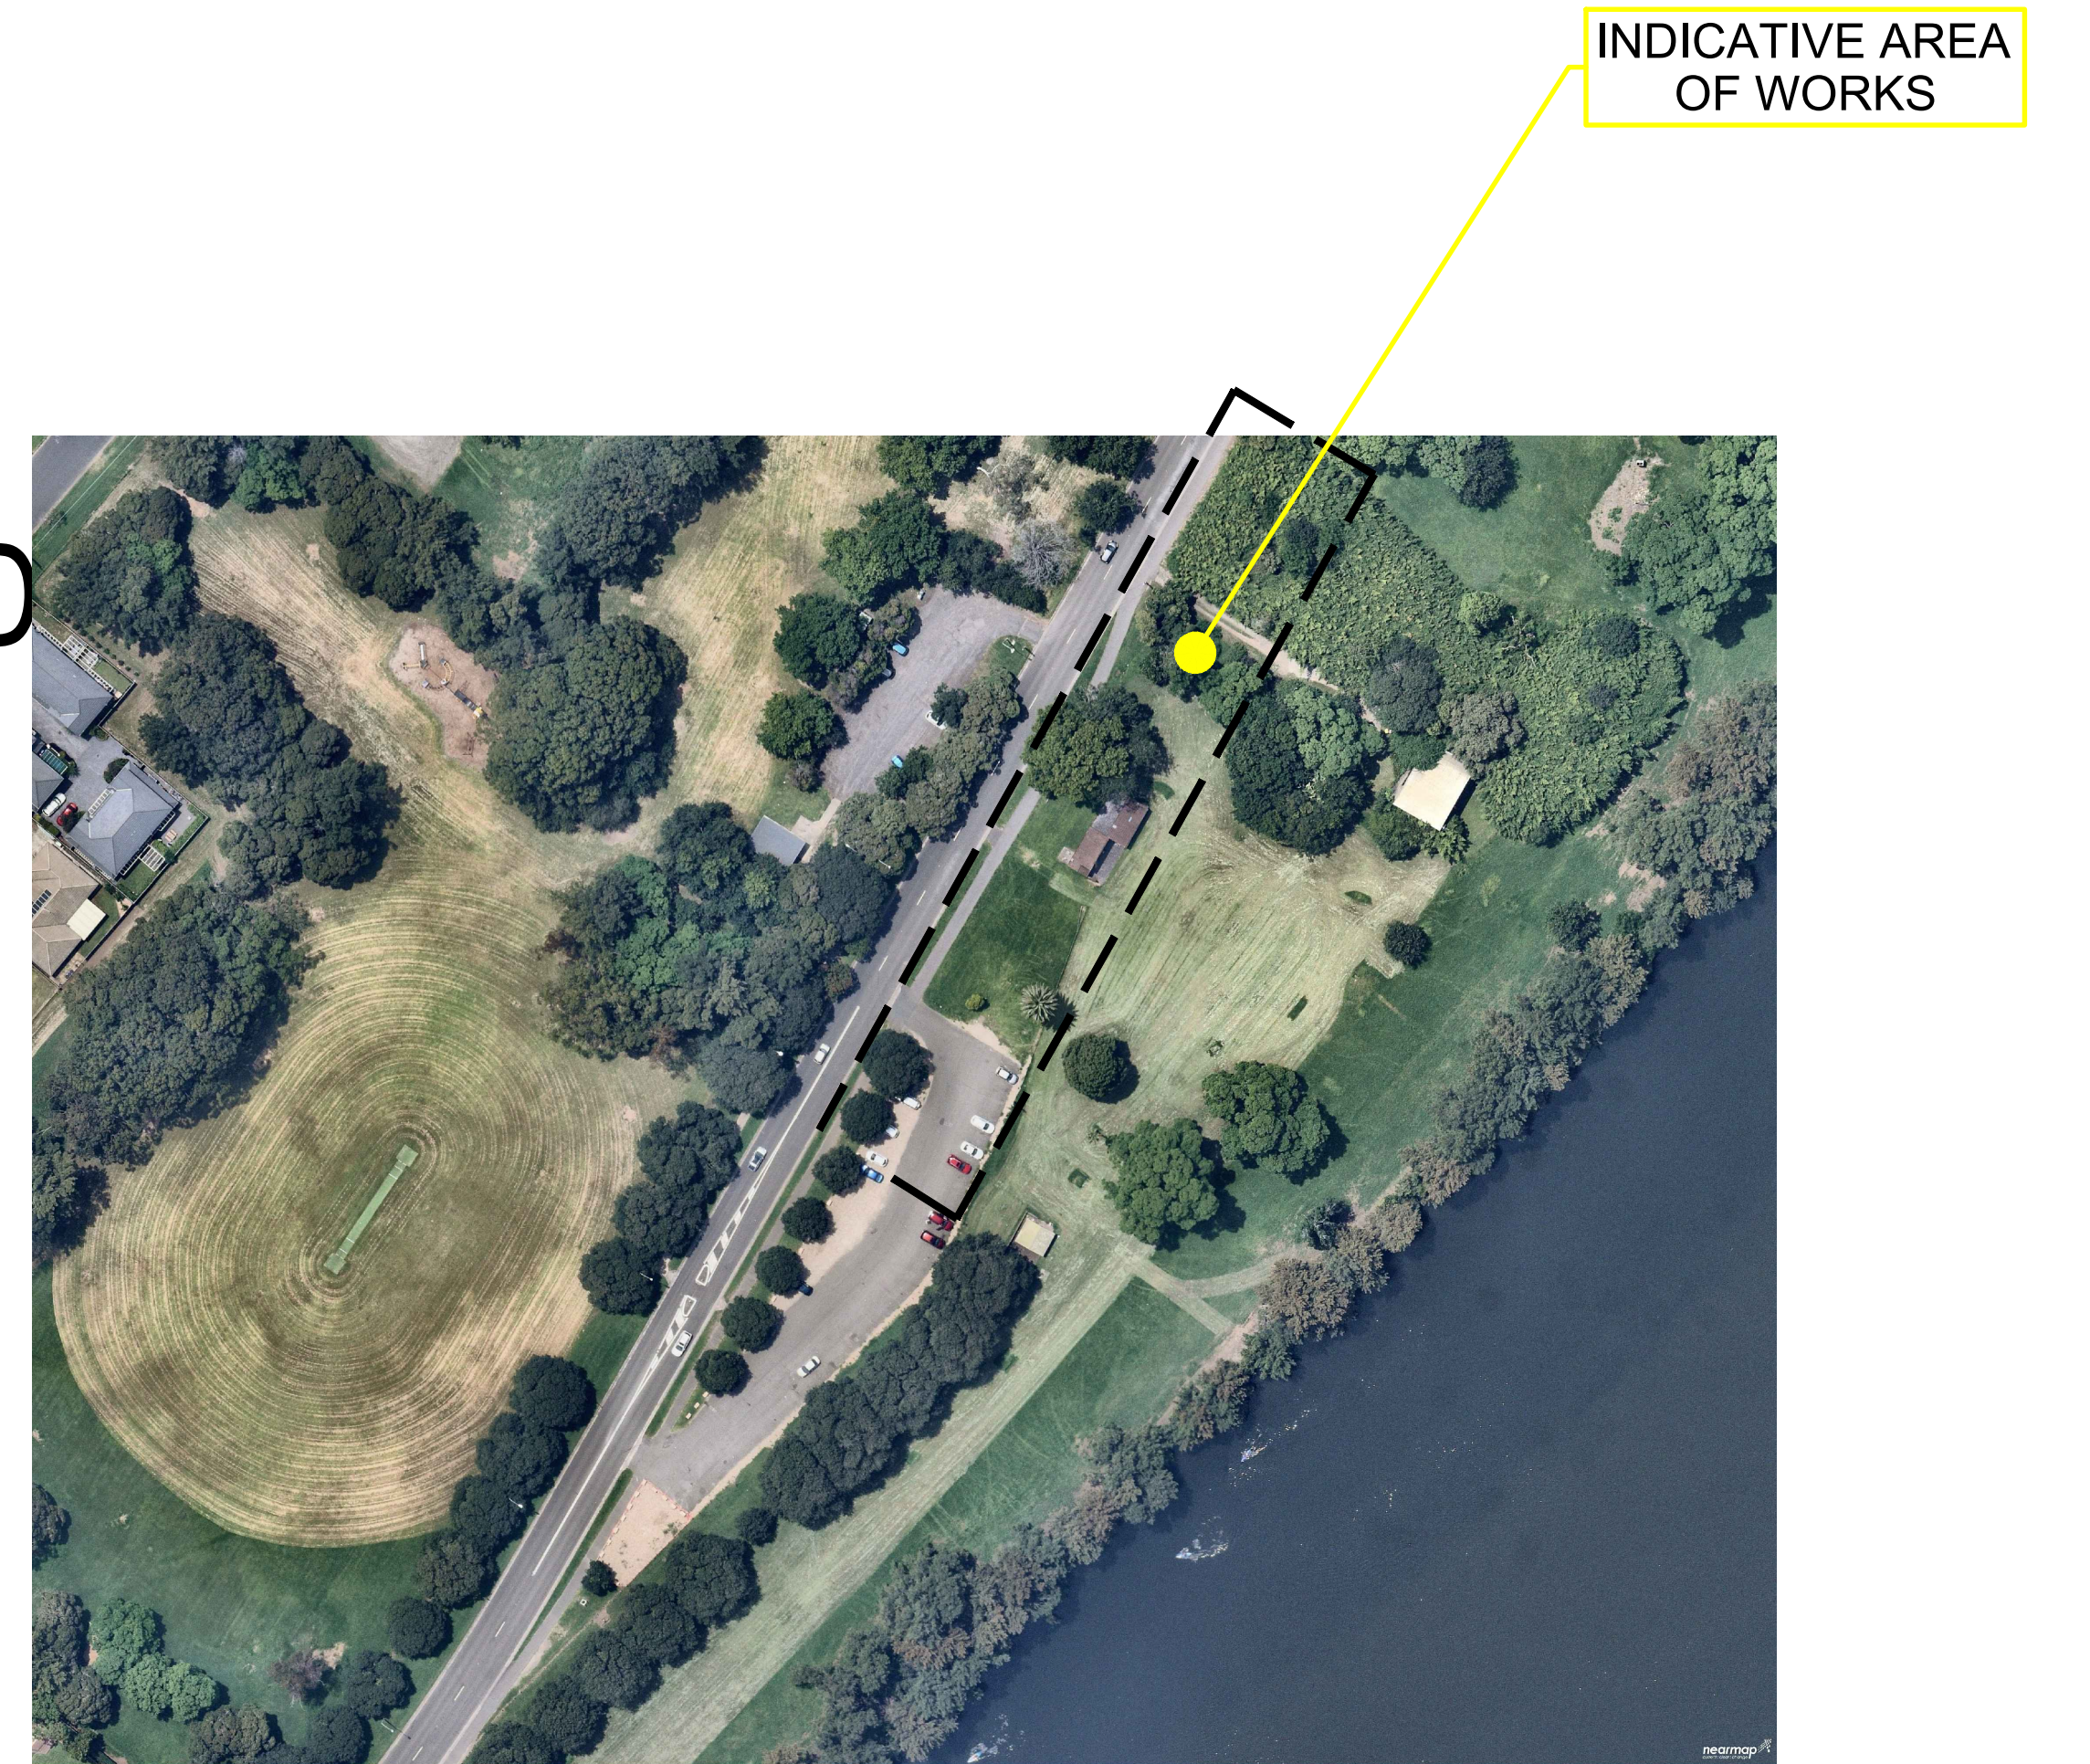

SCHEDULE OF DRAWINGS	
DRAWING No.	DESCRIPTION
	GENERAL
80821190-CI-0001	COVER SHEET, LOCALITY PLAN AND SCHEDULE OF DRAWINGS
808211901-CI-0002	CIVIL CONSTRUCTION NOTES
	PLANS AND SCHEDULES
808211901-CI-1001	STORMWATER DRAINAGE PLAN GROUND FLOOR AND ROOF
80821190-CI-1201	SEDIMENTATION AND EROSION CONTROL PLAN
	STANDARD DETAILS
80821190-CI-2101	STORMWATER DETAILS SHEET
80821211-CI-2201	SEDIMENTATION AND EROSION CONTROL DETAILS


XREFS: CAD File: N:\Projects\80821190\_Regatta Park - Penrith\012\_CIVIL\Drawings\Build\80821190-CI-0001.dwg

Rev.	Date	Description	Des.	Verif.	Appd.
1	9/03/2021	PRELIMINARY ISSUE			

© Cardno Limited All Rights Reserved.  
 This document is produced by Cardno Limited solely for the benefit of and use by the client in accordance with the terms of the retainer. Cardno Limited does not and shall not assume any responsibility or liability whatsoever to any third party arising out of any use or reliance by third party on the content of this document.

Drawn K.P.	Date MAR2021	Status	<b>PRELIMINARY</b> NOT TO BE USED FOR CONSTRUCTION PURPOSES
Checked K.P.	Date MAR2021		
Designed K.P.	Date MAR2021		
Verified C.F.	Date MAR2021	Datum AHD	Scale N.T.S.
Approved			Size A1
Drawing Number 80821190-CI-0001			Revision 1



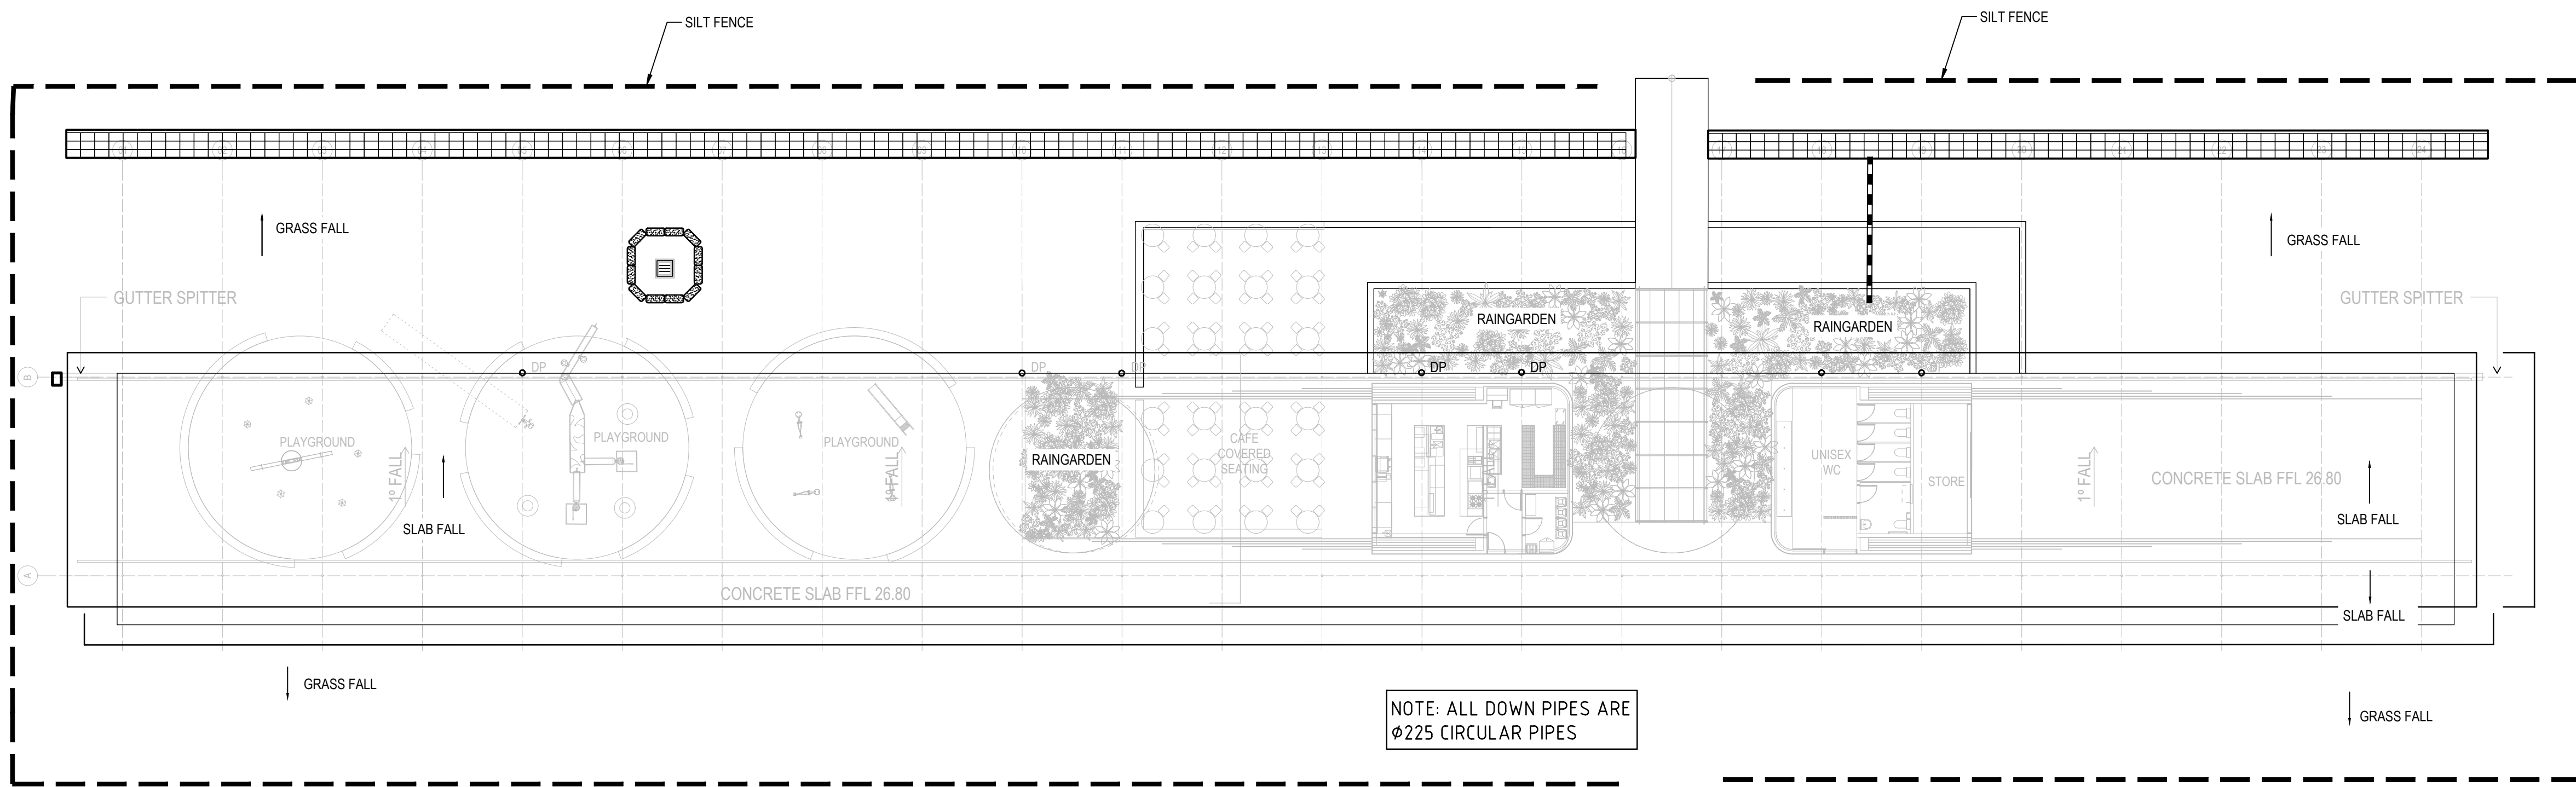


### LEGEND

- SILT FENCE
- PROPOSED STORMWATER PIT
- SILT TRAP/SAND BAGS
- TEMPORARY SURFACE INLET  
SEDIMENT TRAP OR GROSS  
POLLUTANT TRAP
- TEMPORARY CONSTRUCTION  
VEHICLE EXIT

**SEDIMENTATION AND EROSION CONTROL PLAN**  
SCALE 1:100

XREFS: X-SITE PLAN - X-ROOF PLAN  
CAD File: N:\Projects\80821190\_Regatta Park - Penrith\012\_CIVIL\Drawings\Build\80821190-CI-1201.dwg

Rev.	Date	Description	Des.	Verif.	Appd.
1	9/03/2021	PRELIMINARY ISSUE	K.P.	C.F.	

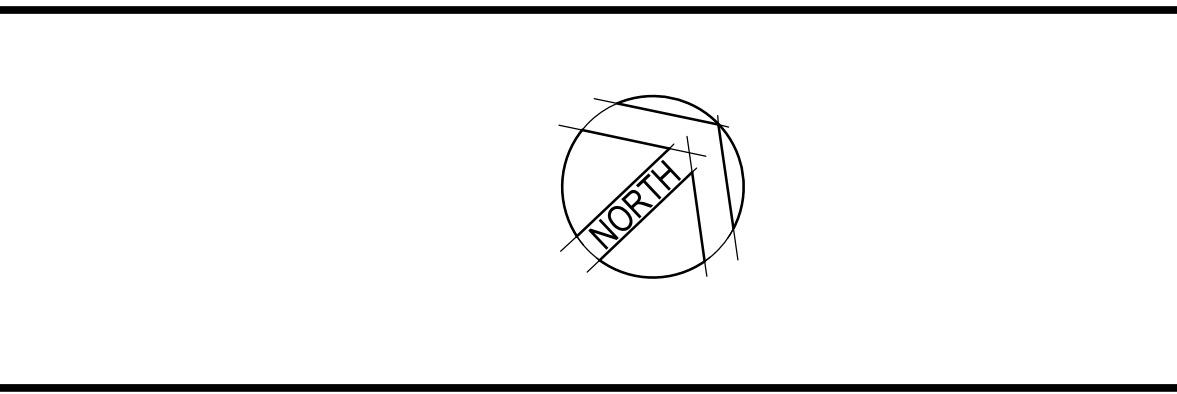




© Cardno Limited All Rights Reserved.  
This document is produced by Cardno Limited solely for the benefit of and use by the client in accordance with the terms of the retainer. Cardno Limited does not and shall not assume any responsibility or liability whatsoever to any third party arising out of any use or reliance by third party on the content of this document.

Cardno (NSW/ACT) Pty Ltd | ABN 95 001 145 035  
Level 9, The Forum, 203 Pacific Highway  
St Leonards, NSW 2065  
Tel: 02 9496 7700 Fax: 02 9439 5170  
Web: www.cardno.com.au





Drawn K.P.	Date MAR/2021
Checked K.P.	Date MAR/2021
Designed K.P.	Date MAR/2021
Verified C.F.	Date MAR/2021
Approved	

Client <b>BREAKSPEAR ARCHITECTS</b>
Project REGATTA PARK KIOSK
Title SEDIMENTATION AND EROSION CONTROL PLAN

Status <b>PRELIMINARY</b>			
NOT TO BE USED FOR CONSTRUCTION PURPOSES			
Datum AHD	Scale 1:200	Size A1	Revision
Drawing Number 80821190-CI-1201			1

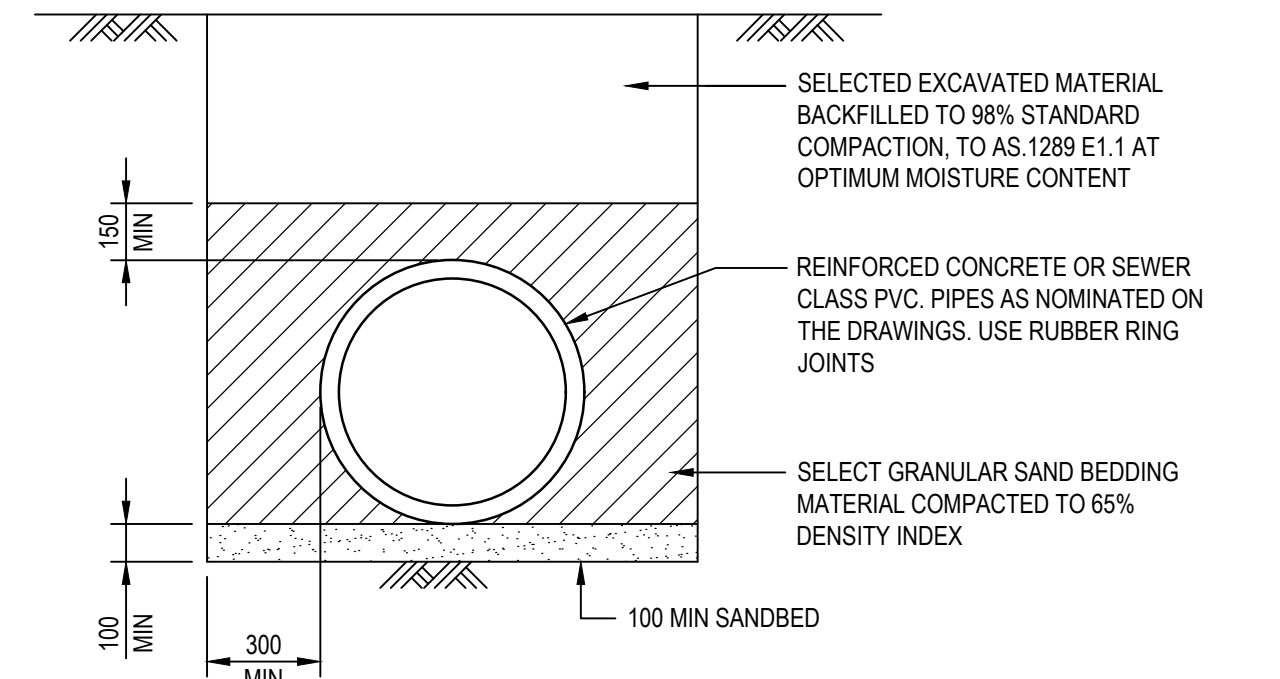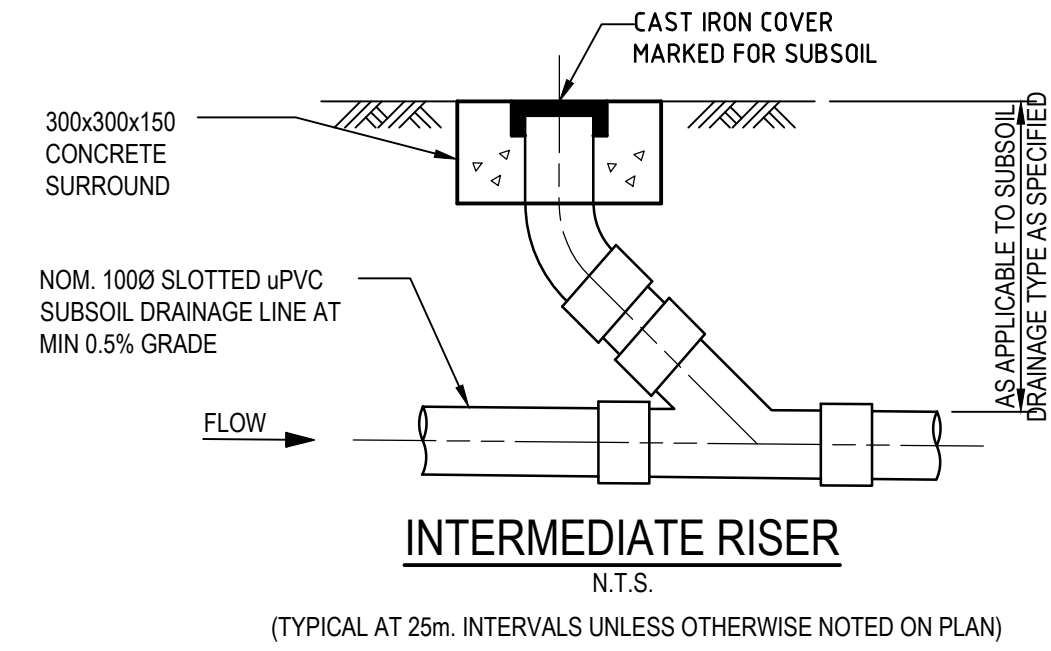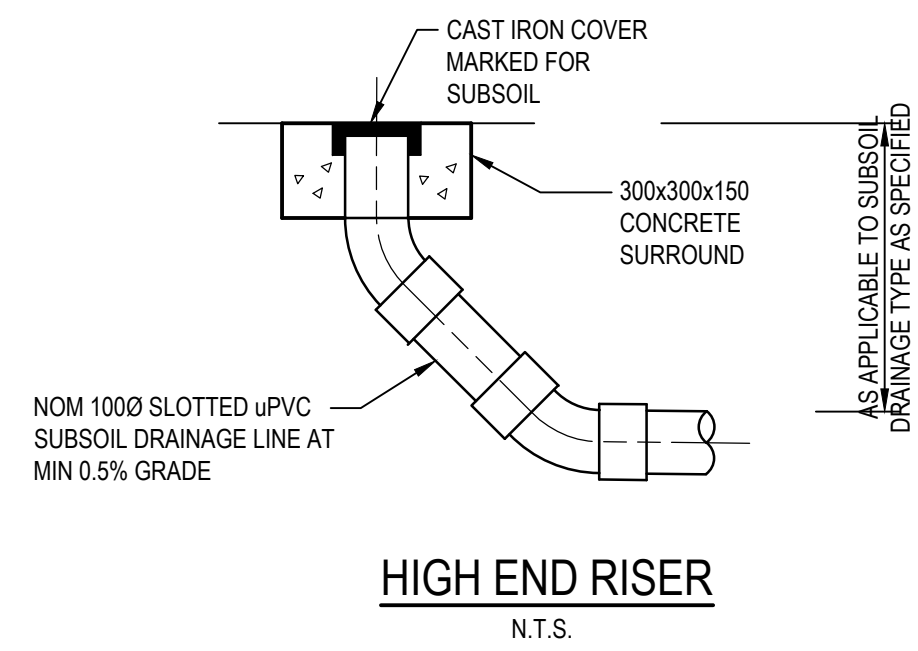

**TYPICAL PIPE LAYING DETAIL U.N.O.**  
NOTE:  
ALLOW TO BUILD 1000 AG. DRAIN IN THE LAST 3.0m OF DRAINAGE PIPE, UPSTREAM OF ALL DRAINAGE PITS.

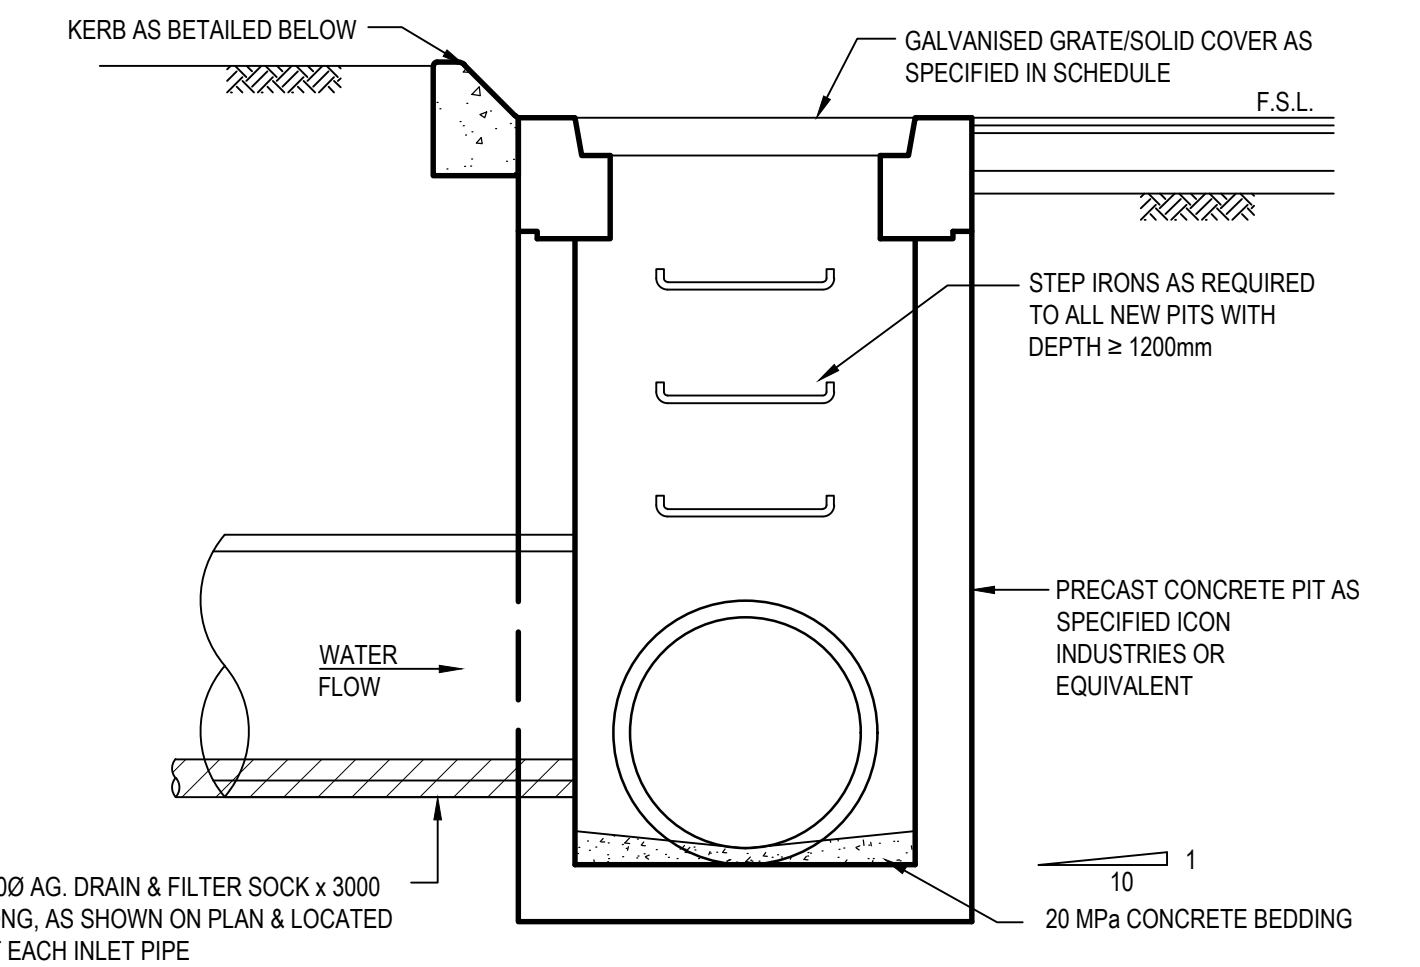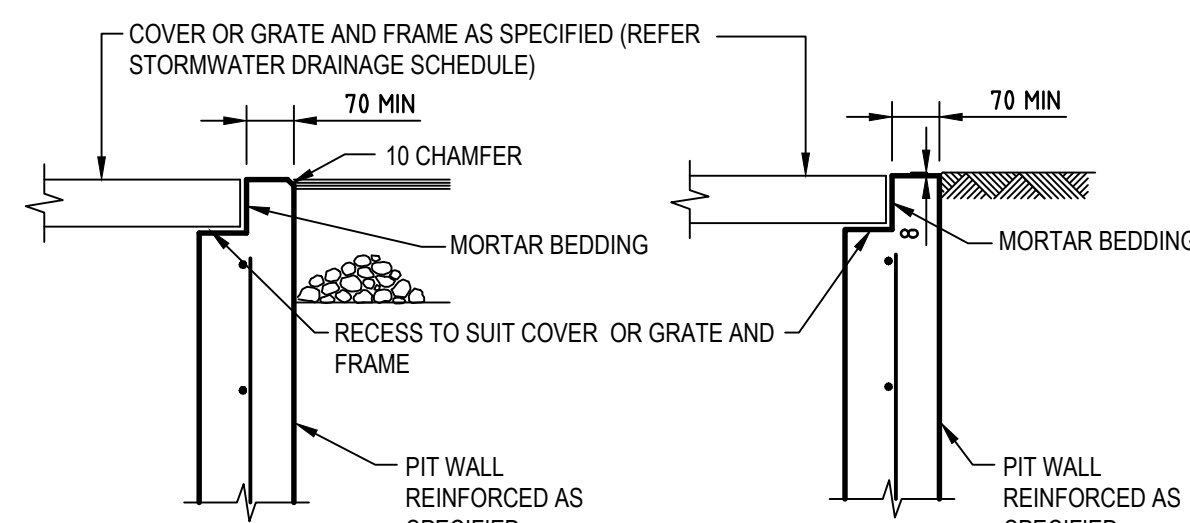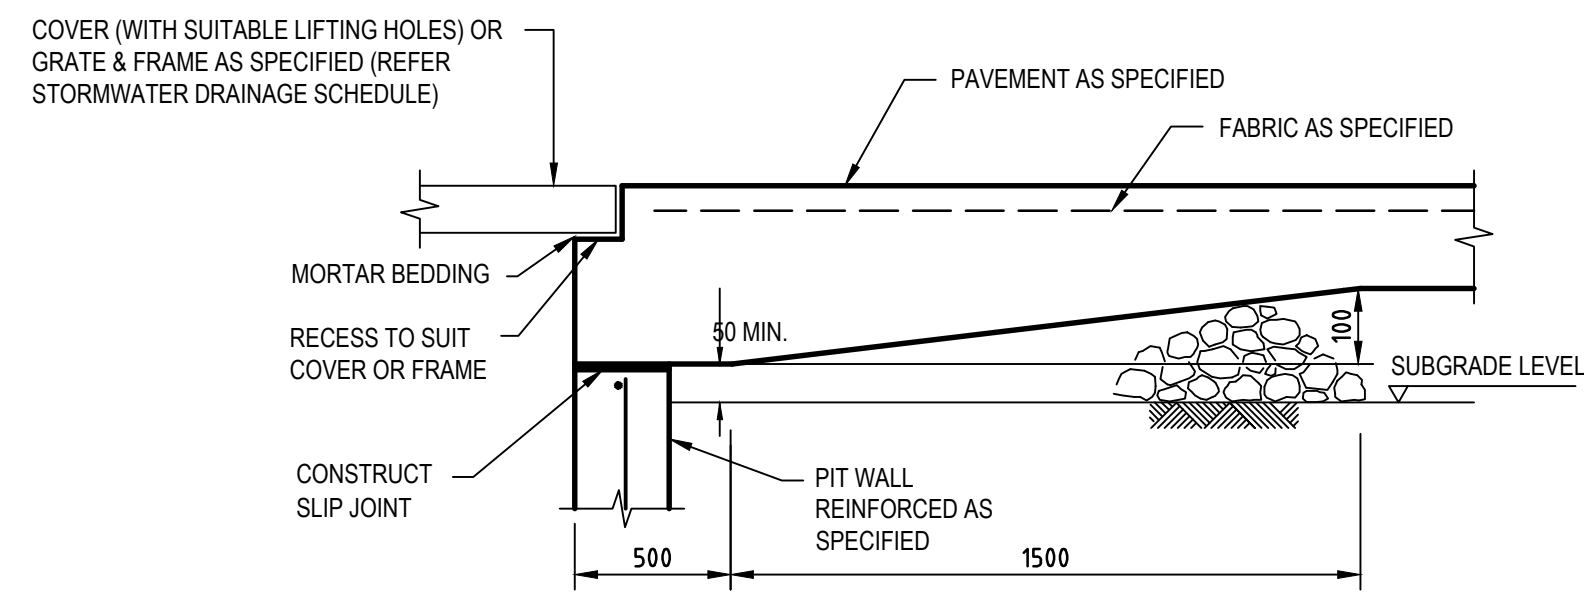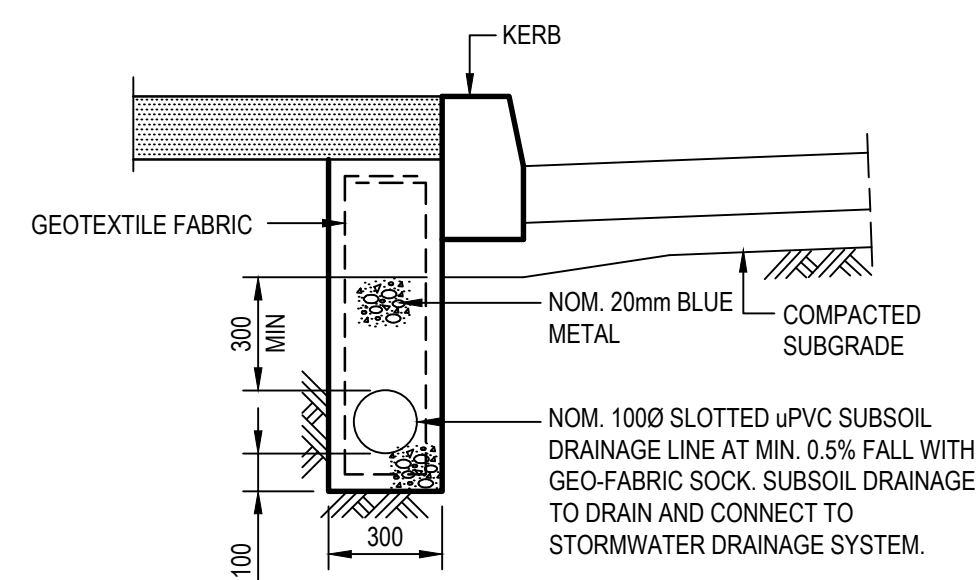

**PRECAST STORMWATER PIT**  
TO BE INSTALLED AND BEDDED IN ACCORDANCE WITH MANUFACTURERS RECOMMENDATIONS. PROVIDE GALVANISED IRON STEP IRONS EPOXIED INTO CONCRETE FOR PITS DEEPER THAN 1200mm.

**SUBSOIL DRAINAGE LINE IN LANDSCAPED AREAS ADJACENT TO ROADS**

**PIT EDGE TREATMENT FOR STORMWATER DRAINAGE AND OTHER SERVICES PITS IN ROAD PAVEMENTS AND LANDSCAPED AREAS**

Rev.	Date	Description	Des.	Verif.	Appd.
1	9/03/2021	PRELIMINARY ISSUE	K.P.	C.F.	

© Cardno Limited All Rights Reserved.  
This document is produced by Cardno Limited solely for the benefit of and use by the client in accordance with the terms of the retainer. Cardno Limited does not and shall not assume any responsibility or liability whatsoever to any third party arising out of any use or reliance by third party on the content of this document.



Cardno (Qld) Pty Ltd | ABN 57 051 074 992

Tel: Fax:  
Web: www.cardno.com.au







Drawn	Date	Client
K.P.	MAR2021	BREAKSPEAR ARCHITECTS
Checked	Date	Project
K.P.	MAR2021	REGATTA PARK KIOSK
Designed	Date	
K.P.	MAR2021	EMU PLAINS
Verified	Date	Title
C.F.	MAR2021	STORMWATER STANDARD DETAILS
Approved		

Status	Scale	Size
PRELIMINARY	AS SHOWN	A1
Datum	Drawing Number	
AHD	80821190-CI-2101	
	Revision	
	1	

NOT TO BE USED FOR CONSTRUCTION PURPOSES

Revision 1



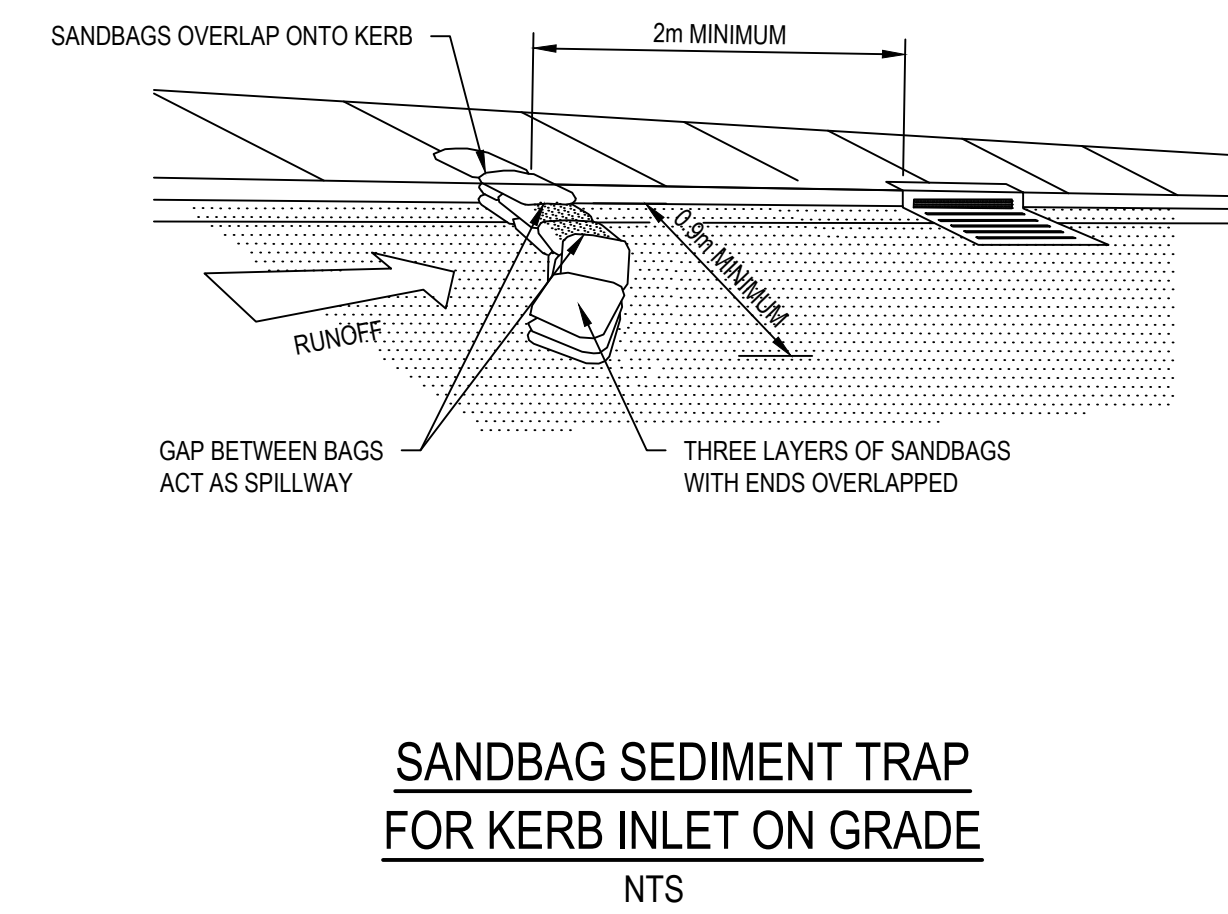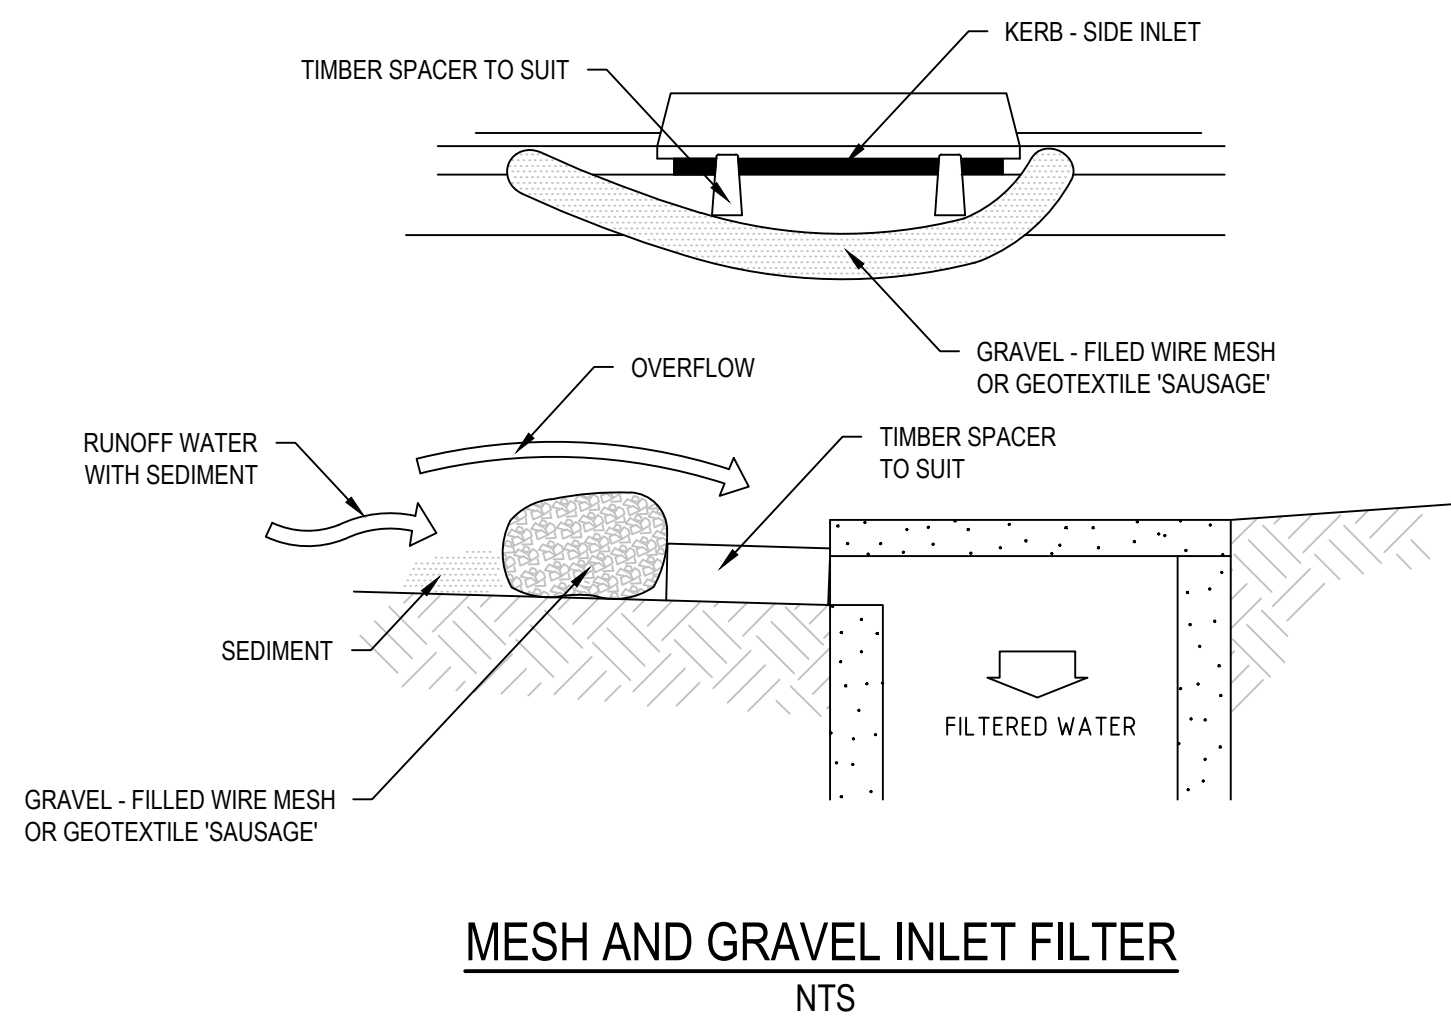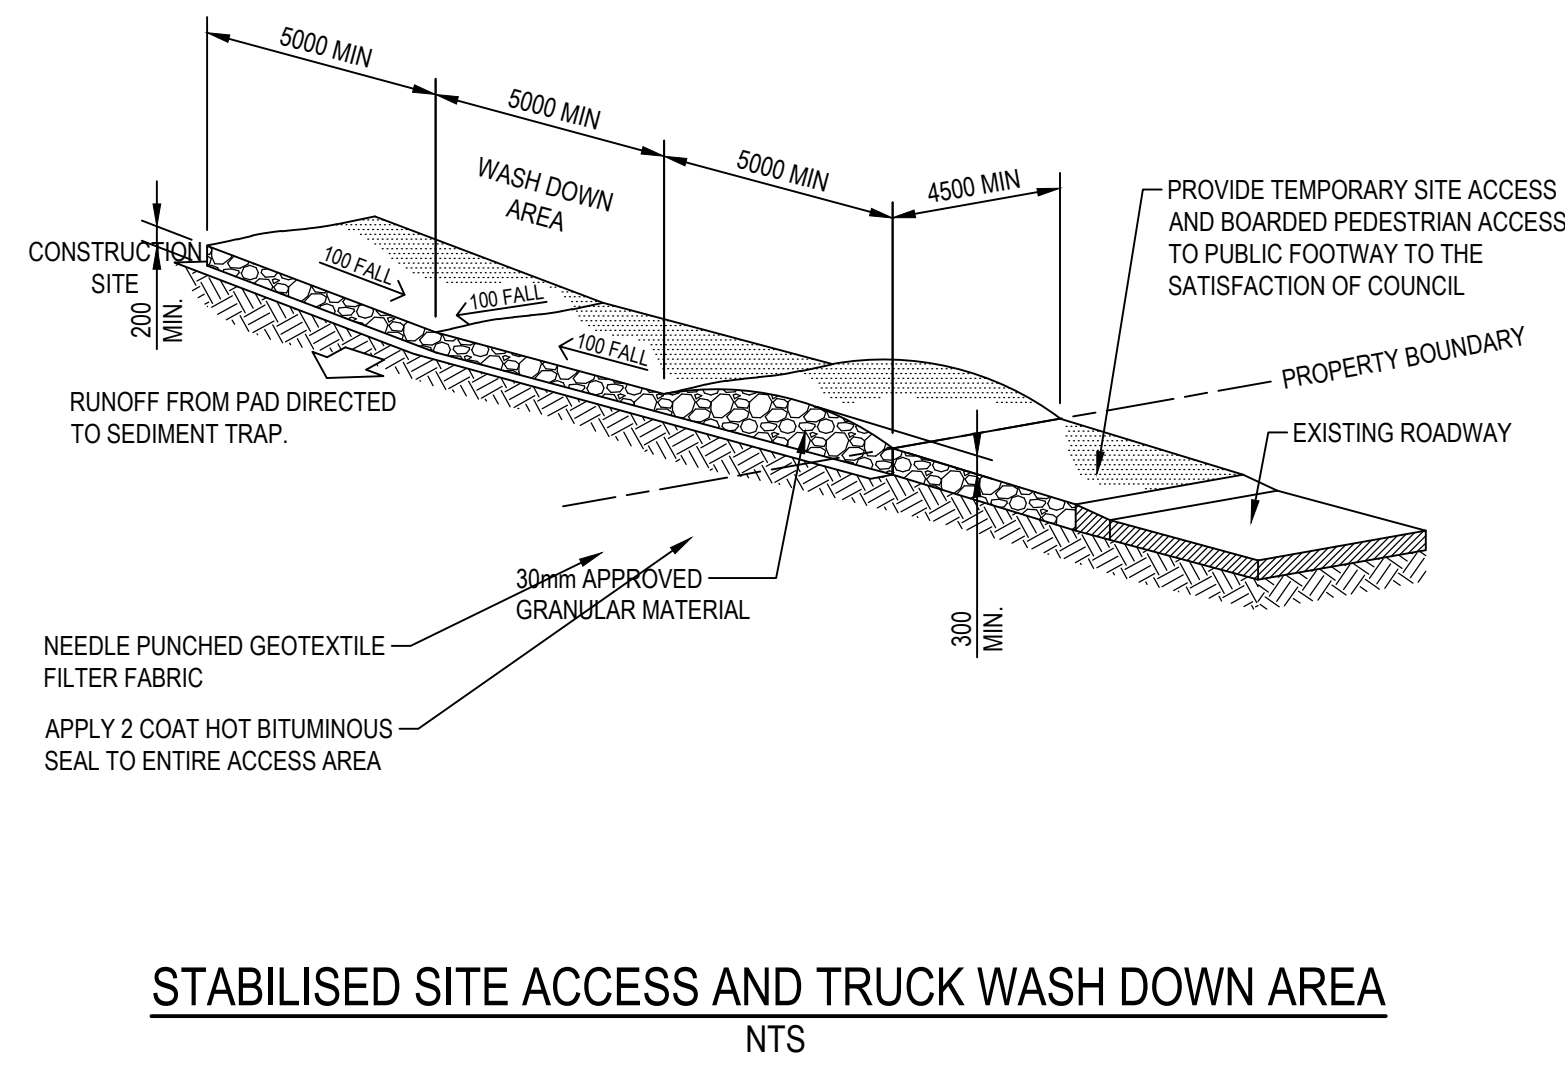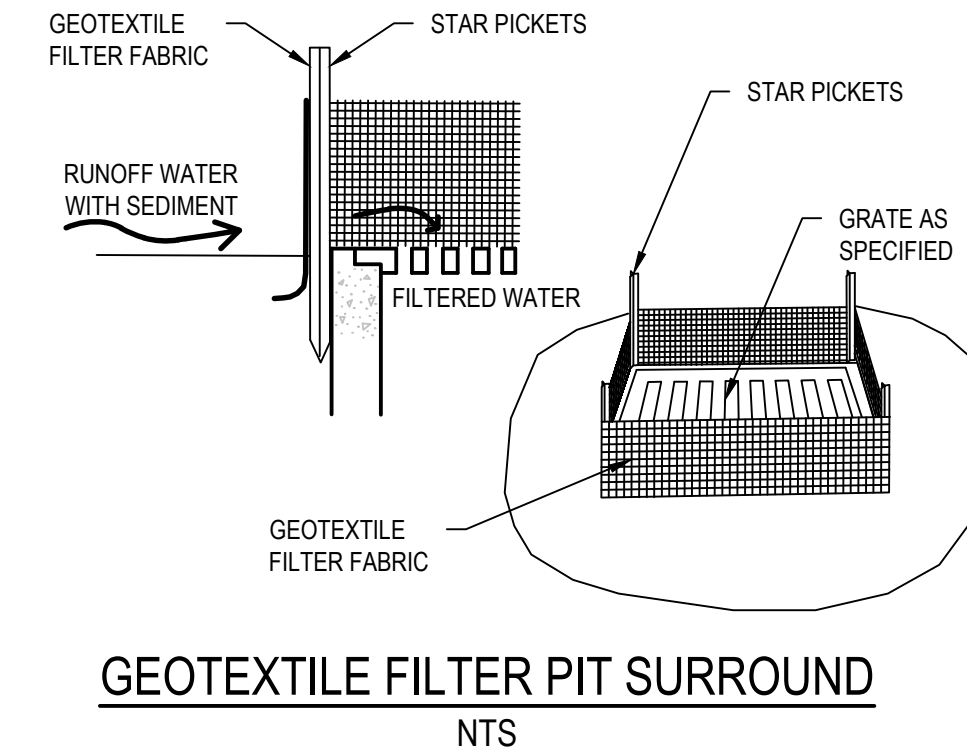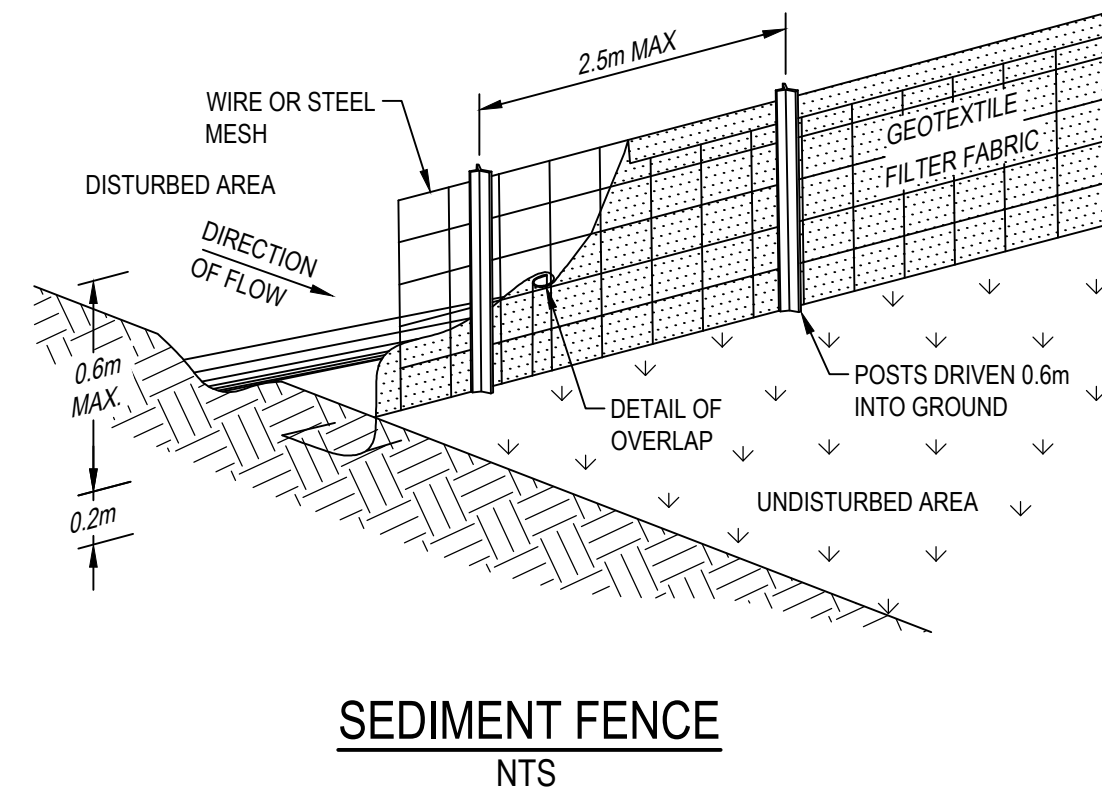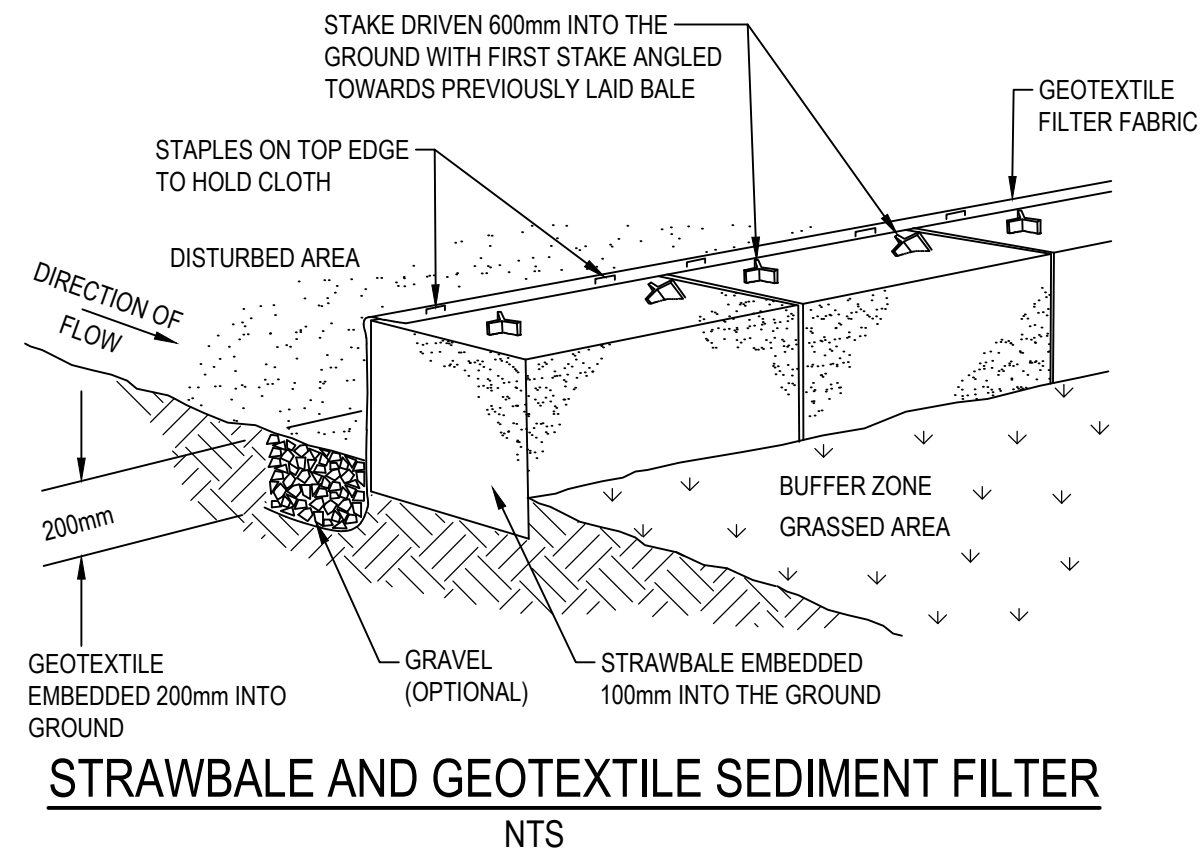

Rev.	Date	Description	Des.	Verif.	Appd.
1	9/03/2021	PRELIMINARY ISSUE	K.P.	C.F.	

© Cardno Limited All Rights Reserved.  
This document is produced by Cardno Limited solely for the benefit of and use by the client in accordance with the terms of the retainer. Cardno Limited does not and shall not assume any responsibility or liability whatsoever to any third party arising out of any use or reliance by third party on the content of this document.

Cardno (NSW/ACT) Pty Ltd | ABN 95 001 145 035  
Level 9, The Forum, 203 Pacific Highway  
St Leonards, NSW 2065  
Tel: 02 9496 7700 Fax: 02 9439 5170  
Web: www.cardno.com.au

Drawn K.P.	Date MAR'2021	Client BREAKSPEAR ARCHITECTS
Checked K.P.	Date MAR'2021	Project REGATTA PARK KIOSK
Designed K.P.	Date MAR'2021	Status <b>PRELIMINARY</b>
Verified C.F.	Date MAR'2021	NOT TO BE USED FOR CONSTRUCTION PURPOSES
Approved		Datum AHD
		Scale AS SHOWN
		Size A1
		Drawing Number 80821190-CI-2201
		Revision 1



GENERAL CIVIL NOTES

- 1. THESE DRAWINGS SHALL BE READ IN CONJUNCTION WITH ALL OTHER CONSULTANTS DRAWINGS, SPECIFICATIONS, STANDARDS, LOCAL GOVERNMENT ORDINANCES AND ADDITIONAL WRITTEN INSTRUCTIONS THAT MAY BE ISSUED DURING THE COURSE OF THE CONTRACT.
2. THE INFORMATION CONTAINED ON THESE DRAWINGS IS FOR CIVIL ENGINEERING PURPOSES ONLY.
3. ALL DISCREPANCIES THAT COULD RESULT IN CHANGES TO THE CIVIL DETAILS SHALL BE REFERRED TO THE CIVIL ENGINEER PRIOR TO PROCEEDING WITH CONSTRUCTION.
4. THE CONTRACTOR SHALL CHECK AND BE RESPONSIBLE FOR THE CORRECTNESS OF ALL DIMENSIONS AND ANY DISCREPANCY SHALL BE REPORTED IMMEDIATELY TO THE SUPERINTENDENT.
5. ALL LEVELS ARE IN METRES AND ALL DIMENSIONS ARE IN MILLIMETRES U.N.O.
6. IT IS THE CONTRACTOR'S SOLE RESPONSIBILITY TO ENSURE THE SAFETY AND STABILITY OF NEW AND EXISTING STRUCTURES, TEMPORARY STRUCTURES, EXCAVATIONS, SHORING AND THE LIKE DURING CONSTRUCTION.
7. THE CONTRACTOR SHALL NOTIFY THE ENGINEER FORTY EIGHT (48) HOURS BEFORE ANY SITE INSPECTION IS REQUIRED.
8. ALL MATERIALS AND WORKMANSHIP SHALL BE IN ACCORDANCE WITH THE RELEVANT AND CURRENT AUSTRALIAN STANDARDS AND WITH THE BY-LAWS AND ORDINANCES OF THE RELEVANT BUILDING AUTHORITIES EXCEPT WHERE VARIED BY THE PROJECT SPECIFICATION.
9. ALL WORK IS TO BE CARRIED OUT IN ACCORDANCE WITH ALL WORKCOVER REQUIREMENTS AND OCCUPATIONAL HEALTH AND SAFETY ACT REGULATIONS.
10. ALL PROPRIETARY PRODUCTS AND APPROVED EQUIVALENTS NOTED ON THE DRAWINGS SHALL BE SUPPLIED AND INSTALLED IN STRICT ACCORDANCE WITH THE MANUFACTURER'S SPECIFICATIONS.
11. SUBSTITUTIONS OF NOMINATED PRODUCTS AND MATERIALS SHALL ONLY OCCUR IF APPROVED BY CARDNO. NO SUBSTITUTIONS SHALL BE MADE OR SIZES OF STRUCTURAL MEMBERS VARIED WITHOUT OBTAINING THE APPROVAL OF THE ENGINEER.
12. NO CHANGES SHALL BE MADE WITHOUT THE WRITTEN CONSENT OF THE ENGINEER.
13. CONSTRUCTION FROM THESE DRAWINGS AND ASSOCIATED CONSULTANTS' DRAWINGS SHALL NOT COMMENCE UNTIL APPROVED BY THE LOCAL AUTHORITIES AND PRINCIPAL CERTIFYING AUTHORITY.
14. CONTRACTOR IS NOT TO ENTER UPON NOR DO ANY WORK WITHIN ADJACENT LANDS OR PROPERTIES WITHOUT THE PERMISSION OF THE OWNERS AND SUPERINTENDENT.
15. THE CONTRACTOR SHALL PROVIDE TRAFFIC CONTROL WHICH COMPLIES WITH AS1742.3 - 2018. A COPY OF THE PLAN SHOWING LAYOUT OF PROPOSED TRAFFIC CONTROL FOR THE COMMENCEMENT OF WORK AND CERTIFIED BY A SUITABLY QUALIFIED PERSON IS TO BE SUBMITTED TO COUNCIL PRIOR TO COMMENCEMENT OF ANY WORK.
16. ANY QUANTITIES GIVEN ARE FOR GUIDANCE ONLY.

SITE PREPARATION

ROAD WORKS

- 1. SP1. REMOVE TOP SOIL, ROOT AFFECTED SOIL, FILL AND OTHER DELETERIOUS MATERIAL TO EXPOSE NATURAL SUBGRADE.
2. SP2. THE EXPOSED SUBGRADE SHOULD THEN BE PROOF ROLLED WITH AT LEAST EIGHT (8) PASSES OF A 10 TONNE MIN. DEAD WEIGHT ROLLER.
3. SP3. COMPACTED FILL SHOULD BE PLACED IN LAYERS NOT EXCEEDING 150mm THICK AND COMPACTED TO AT LEAST 100% SMD.
4. SP4. DENSITY TESTING SHALL BE CARRIED OUT TO LEVEL 2 CERTIFICATION IN ACCORDANCE WITH AS3798.
5. SP5. SUB-BASE COURSE - TO BE DGS20 OR DGS40 OR RIPPED OR CRUSHED SANDSTONE WITH A CBR GREATER THAN 40%.
6. SP6. ALL KERBS TO BE FORMED BY KERB MACHINE AND NOT BY HAND.
7. EXTERNAL FOOTPATHS/PAVEMENTS
8. SP7. REMOVE TOP SOIL, ROOT AFFECTED SOIL, FILL AND OTHER DELETERIOUS MATERIAL TO EXPOSE NATURAL SUBGRADE.
9. SP8. THE EXPOSED SUBGRADE SHOULD BE PROOF ROLLED. ANY SOFT OR HEAVING AREAS SHOULD BE REPLACED WITH CLEAN WELL GRADED MATERIAL.

STORMWATER DRAINAGE NOTES

- 1. STORMWATER DRAINAGE SHALL BE GENERALLY IN ACCORDANCE WITH AS3500.3-2018.
2. PIPES Ø675mm AND LARGER SHALL BE CLASS 3 APPROVED SPIGOT AND SOCKET REINFORCED CONCRETE PIPES WITH RUBBER RING JOINTS U.N.O.
3. PIPES Ø375mm TO Ø600mm SHALL BE CLASS 2 APPROVED SPIGOT AND SOCKET REINFORCED CONCRETE PIPES WITH RUBBER RING JOINTS U.N.O.
4. PIPES UP TO AND INCLUDING Ø300mm SHALL BE uPVC DWV (GRADE CLASS S8) U.N.O.
5. SUBSOIL PIPES AND FITTINGS TO BE PERFORATED PLASTIC IN ACCORDANCE WITH AS2439.1-2007.
6. HEAVY DUTY uPVC PIPES TO BE IN ACCORDANCE WITH AS/NZS1254-2010.
7. EQUIVALENT STRENGTH FIBROUS REINFORCED CONCRETE (F.R.C.) AND/OR HIGH DENSITY POLYETHYLENE (H.D.P.E.) MAY BE USED SUBJECT TO APPROVAL BY THE SUPERINTENDENT.
8. CONTRACTOR TO SUPPLY AND INSTALL ALL FITTINGS AND SPECIALS INCLUDING VARIOUS PIPE ADAPTORS TO ENSURE PROPER CONNECTION BETWEEN DISSIMILAR PIPEWORK.
9. ALL CONNECTIONS TO EXISTING DRAINAGE PITS SHALL BE MADE IN A TRADESMAN-LIKE MANNER AND THE INTERNAL WALL OF THE PIT AT THE POINT OF ENTRY SHALL BE CEMENT RENDERED TO ENSURE A SMOOTH FINISH WITH NO PROTRUSIONS.
10. BEDDING MATERIAL SHALL BE TYPE H2 U.N.O. FOR PIPES NOT UNDER PAVEMENTS, AND TYPE HS2 FOR PIPES UNDER PAVEMENTS IN ACCORDANCE WITH AS/NZS3725-2007.
11. ALL PIPES ARE TO BE UNIFORMLY SUPPORTED ALONG THE LENGTH OF THE BARREL BY SUITABLE FILL MATERIAL.
12. MINIMUM GRADE TO STORMWATER LINES TO BE 1% U.N.O.
13. ANY PIPES OVER 16% GRADE SHALL HAVE CONCRETE BULKHEADS AT ALL JOINTS.
14. CARE IS TO BE TAKEN WITH LEVELS OF STORMWATER LINES.
15. PROVIDE 3m LENGTH OF Ø100mm SUBSOIL DRAINAGE LINE OR 200mm 'NYLEX' STRIP DRAIN SURROUNDED WITH 150mm OF 20mm BLUE METAL OR GRAVEL.
16. ALL STORMWATER DRAINAGE LINES UNDER PROPOSED BUILDING SLABS TO BE uPVC PRESSURE PIPE GRADE 6.
17. WHERE SUBSOIL DRAINAGE LINES PASS UNDER FLOOR SLABS AND VEHICULAR PAVEMENTS, UNSLOTTED uPVC DWV (GRADE CLASS S8) PIPE SHALL BE USED.
18. UNLESS NOTED OTHERWISE ON THE PLANS, PROVIDE THE FOLLOWING MINIMUM COVER TO ALL STORMWATER PIPES:
19. REFER TO AS/NZS3725-2007 TABLE B1 FOR REQUIRED FILL DEPTHS ABOVE PIPE BARREL PRIOR TO USE OF COMPACTION MACHINERY OR TRAVERSING OF PIPES BY GENERAL SITE EQUIPMENT.
20. PRECAST CONCRETE PITS MAY BE INSTALLED IN LIEU OF CAST IN-SITU PITS.
21. PITS DEEPER THAN 1200mm, MEASURED FROM TOP OF GRATE TO INVERT OF PIT, SHALL HAVE STEP IRONS INSTALLED IN ACCORDANCE WITH THE LOCAL OR STATUTORY AUTHORITY REQUIREMENTS.
22. ACCESS COVERS AND GRATES TO BE INSTALLED IN ACCORDANCE WITH AS3996-2019.
23. ALL GRATES IN PAVEMENTS TO BE CYCLE SAFE AND WHERE IN ROADWAYS TRAFFICABLE HEAVY DUTY.
24. AT ALL TIMES DURING CONSTRUCTION OF STORMWATER PITS, ADEQUATE SAFETY PROCEDURES SHALL BE TAKEN TO ENSURE AGAINST THE POSSIBILITY OF PERSONNEL FALLING DOWN PITS.
25. ALL EXISTING STORMWATER DRAINAGE LINES AND PITS THAT ARE TO REMAIN ARE TO BE INSPECTED AND CLEANED. DURING THIS PROCESS ANY PART OF THE STORMWATER DRAINAGE SYSTEM THAT WARRANTS REPAIR SHALL BE REPORTED TO THE SUPERINTENDENT/ENGINEER FOR FURTHER DIRECTIONS.

EROSION AND SEDIMENT CONTROL NOTES

- 1. ALL WORKS SHALL BE GENERALLY CARRIED OUT IN ACCORDANCE WITH:
a. LOCAL AUTHORITY REQUIREMENTS
b. EPA REQUIREMENTS
c. NSW DEPARTMENT OF HOUSING MANUAL "MANAGING URBAN STORMWATER, SOILS AND CONSTRUCTION", 4th EDITION, MARCH 2004 (THE BLUE BOOK).
2. EROSION AND SEDIMENT CONTROL DRAWINGS AND NOTES ARE PROVIDED FOR THE WHOLE OF THE WORKS. SHOULD THE CONTRACTOR STAGE THESE WORKS THEN THE DESIGN MAY REQUIRE TO BE MODIFIED. VARIATIONS TO THESE DETAILS MAY REQUIRE TO BE APPROVED BY THE RELEVANT AUTHORITIES.
3. MINIMISE THE AREA OF SITE BEING DISTURBED AT ANY ONE TIME.
4. THE CONTRACTOR SHALL BE SOLELY RESPONSIBLE FOR THE CONTROL OF EROSION AND SEDIMENTATION AND THAT ALL SOIL AND WATER MANAGEMENT WORKS ARE LOCATED AS DOCUMENTED OR AS OTHERWISE DIRECTED BY THE SUPERINTENDENT.
5. ALL SOIL AND WATER CONTROL MEASURES ARE TO BE PUT BACK IN PLACE AT THE END OF EACH WORKING DAY AND MODIFIED TO BEST SUIT SITE CONDITIONS.
6. PREVENT SITE RUNOFF ENTERING NEWLY CONSTRUCTED STORMWATER PITS UNLESS SEDIMENT FENCES ARE ERRECTED AROUND THEM.
7. MAINTAIN ALL STORMWATER PIPES AND PITS CLEAR OF DEBRIS AND SEDIMENT.
8. MAINTAIN ALL EROSION AND SEDIMENT CONTROL DEVICES, ENSURING THEY ARE IN GOOD WORKING ORDER AND OPERATE EFFECTIVELY.
9. WHERE PRACTICAL, THE SOIL EROSION HAZARDS ON THE SITE ARE TO BE KEPT AS LOW AS POSSIBLE AND WORKS SHOULD BE UNDERTAKEN IN THE FOLLOWING SEQUENCE TO MINIMISE THE RISKS:
a. INSTALL A SEDIMENT FENCE ALONG THE BOUNDARIES AS SHOWN ON PLAN.
b. CONSTRUCT STABILISED SITE ACCESS AND TRUCK WASH DOWN AREA AT THE LOCATION SHOWN ON THE DRAWINGS OR AS DETERMINED BY SUPERINTENDENT/ENGINEER.
c. INSTALL ANY SEDIMENT BASINS AND SEDIMENT TRAPS AS SHOWN ON DRAWINGS.
d. UNDERTAKE SITE DEVELOPMENT WORKS IN ACCORDANCE WITH THE ENGINEERING PLANS.
10. DURING WINDY WEATHER, LARGE, UNPROTECTED AREAS WILL BE KEPT MOIST (NOT WET) BY SPRINKLING WITH WATER TO KEEP DUST UNDER CONTROL.
11. CONTROL WATER FROM UPSTREAM OF THE SITE SUCH THAT IT DOES NOT ENTER THE DISTURBED SITE.
12. ALL CONSTRUCTION VEHICLES SHALL ENTER THE SITE VIA THE TEMPORARY CONSTRUCTION ENTRY/EXIT.
13. ALL VEHICLES LEAVING THE SITE SHALL BE CLEANED AND INSPECTED BEFORE LEAVING.
14. STOCKPILES ARE NOT TO BE LOCATED IN ROADWAYS, WITHIN 2 METRES OF HAZARD AREAS OR DRAINAGE PITS.
15. ANY SAND USED IN THE CONCRETE CURING PROCESS (SPREAD OVER THE SURFACE) WILL BE REMOVED AS SOON AS POSSIBLE AND WITHIN 10 WORKING DAYS FROM PLACEMENT.
16. WATER WILL BE PREVENTED FROM ENTERING THE PERMANENT DRAINAGE SYSTEM UNLESS IT IS RELATIVELY SEDIMENT FREE.
17. TEMPORARY SOIL AND WATER MANAGEMENT STRUCTURES WILL BE REMOVED ONLY AFTER THE LANDS THEY ARE PROTECTING ARE REHABILITATED.
18. ACCEPTABLE RECEPTACLES WILL BE PROVIDED FOR CONCRETE AND MORTAR SLURRIES, PAINTS, ACID WASHINGS, LIGHTWEIGHT WASTE MATERIALS AND LITTER.
19. ANY EXISTING TREES WHICH FORM PART OF THE FINAL LANDSCAPING PLAN WILL BE PROTECTED FROM CONSTRUCTION ACTIVITIES BY:
a. PROTECTING THEM WITH BARRIER FENCING OR SIMILAR MATERIALS INSTALLED OUTSIDE THE DRIP LINE
b. ENSURING THAT NOTHING IS NAILED TO THEM
c. PROHIBITING PAVING, GRADING, SEDIMENT WASH OR PLACING OF STOCKPILES WITHIN THE DRIP LINE EXCEPT UNDER THE FOLLOWING CONDITIONS.
d. ENCROACHMENT ONLY OCCURS ON ONE SIDE AND NO CLOSER TO THE TRUNK THAN EITHER 1.5 METRES OR HALF THE DISTANCE BETWEEN THE OUTER EDGE OF THE DRIP LINE AND THE TRUNK, WHICHEVER IS THE GREATER
e. A DRAINAGE SYSTEM THAT ALLOWS AIR AND WATER TO CIRCULATE THROUGH THE ROOT ZONE (E.G. A GRAVEL BED) IS PLACED UNDER ALL FILL LAYERS OF MORE THAN 300mm DEPTH
f. CARE IS TAKEN NOT TO CUT ROOTS UNNECESSARILY NOR TO COMPACT THE SOIL AROUND THEM.
20. FINAL SITE LANDSCAPING WILL BE UNDERTAKEN AS SOON AS POSSIBLE AND WITHIN 20 WORKING DAYS FROM COMPLETION OF CONSTRUCTION ACTIVITIES.
21. ANY REVEGETATED AREAS WHICH FAIL TO ESTABLISH WITHIN THREE MONTHS MUST BE RE-SOWN.

CONCRETE NOTES

- 1. ALL WORKMANSHIP AND MATERIALS SHALL BE IN ACCORDANCE WITH AS3600 AND AS1379 CURRENT EDITIONS WITH AMENDMENTS, EXCEPT WHERE VARIED BY THE CONTRACT DOCUMENTS.
2. FOR CONCRETE MIX DESIGN & COVER SUMMARY REFER TO TABLE C1.1 BELOW. ALL CEMENT TO BE TYPE 'GP' GENERAL PURPOSE CEMENT IN ACCORDANCE WITH AS3972-2010.
3. PROJECT ASSESSMENT SHALL BE CARRIED OUT IN ACCORDANCE WITH AS 1379-2007 CLAUSE B7:
a) ALL CONCRETE IN SLABS AND BEAMS TO BE PROPORTIONED TO LIMIT DRYING SHRINKAGE TO 650 MICROSTRAIN AT 56 DAYS.
b) DETAILS OF THE PROPOSED MIX TO BE SUBMITTED AND APPROVAL OBTAINED PRIOR TO POURING ANY CONCRETE.
4. NO ADMIXTURES OTHER THAN THOSE SPECIFIED IN THE CONCRETE QUALITY & COVER SUMMARY TABLE C1.1 (OR APPROVED EQUIVALENTS) SHALL BE USED IN CONCRETE UNLESS APPROVED BY THE ENGINEER.
5. CLEAR CONCRETE COVER TO REINFORCEMENT SHALL BE IN ACCORDANCE WITH CONCRETE QUALITY & COVER TABLE C1.1.
6. CONSTRUCTION JOINTS, WHERE NOT SHOWN, SHALL BE LOCATED TO THE APPROVAL OF THE STRUCTURAL ENGINEER.
7. ALL CONCRETE SHALL BE MECHANICALLY VIBRATED TO ACHIEVE A DENSE HOMOGENEOUS MASS. COMPLETELY FILLING THE FORMWORK THOROUGHLY EMBEDDING THE REINFORCEMENT AND FREE OF STONE POCKETS.
8. CURING OF ALL CONCRETE IS TO BE ACHIEVED BY KEEPING SURFACES CONTINUOUSLY WET FOR A PERIOD OF THREE (3) DAYS.
9. REPAIRS TO CONCRETE SHALL NOT BE ATTEMPTED WITHOUT THE PERMISSION OF THE ENGINEER.
10. CAST-IN FIXINGS, BOLTS ETC. SHALL NOT BE ALTERED WITHOUT THE PERMISSION OF THE ENGINEER.

Table with 7 columns: STRUCTURAL ELEMENT, SLUMP (MAX), MAX. AGG. SIZE, CEMENT TYPE, STRENGTH GRADE, ADMIXTURE, REBAR COVER (TOP, BTM). Rows include STORMWATER PITS, SLABS ON GROUND, BLOCK WALL CORE, and GROUT FILLING (UNO).

Revision table with columns: Rev, Date, Description, Des., Verif., Appd. Row 1: 1, 9/03/2021, PRELIMINARY ISSUE, K.P., C.F.

© Cardno Limited All Rights Reserved. This document is produced by Cardno Limited solely for the benefit of and use by the client in accordance with the terms of the retainer.


Cardno logo and contact information: Cardno (NSW/ACT) Pty Ltd | ABN 95 001 145 035 | Level 9, The Forum, 203 Pacific Highway | St Leonards, NSW 2065 | Tel: 02 9496 7700 | Fax: 02 9439 5170 | Web: www.cardno.com.au

Approval table with columns: Drawn, Checked, Designed, Verified, Approved. All entries by K.P. on MAR2021.


Client: BREAKSPEAR ARCHITECTS
Project: REGATTA PARK KIOSK
Title: CIVIL CONSTRUCTION NOTES

Status: PRELIMINARY
NOT TO BE USED FOR CONSTRUCTION PURPOSES
Drawing Number: 80821190-CI-0002
Revision: 1



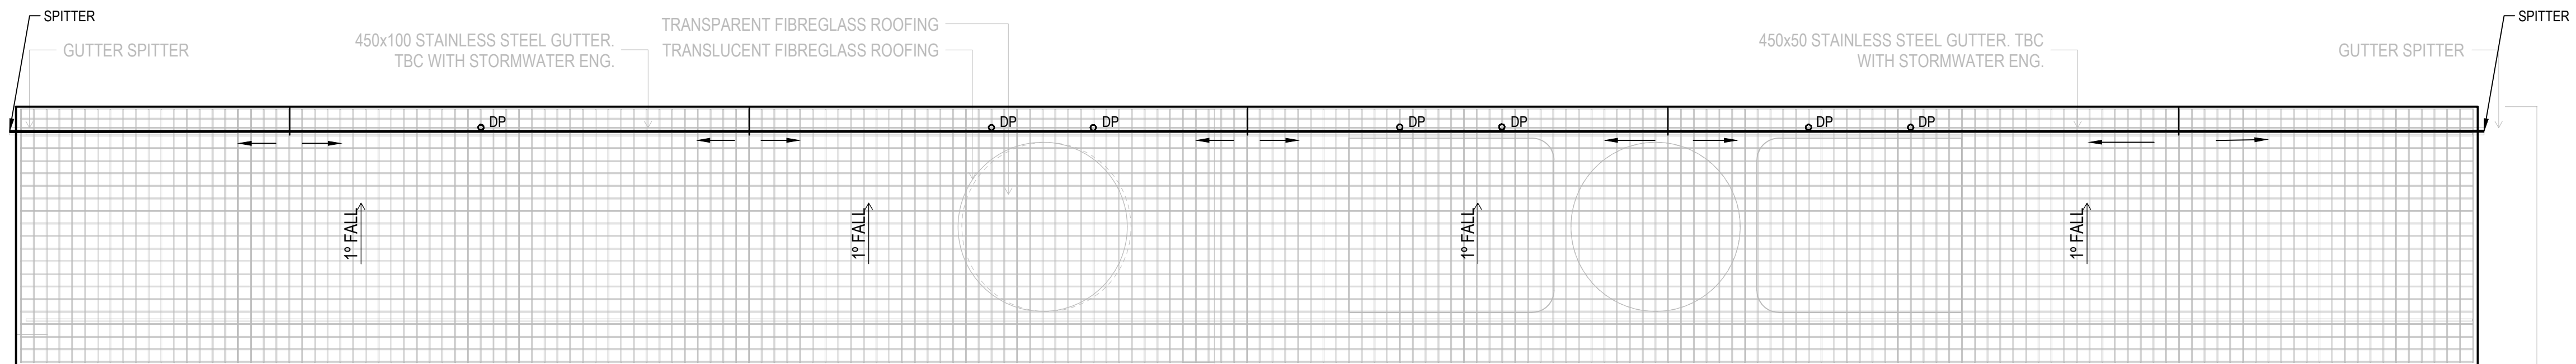


**ROOF DRAINAGE PLAN**  
SCALE 1:200

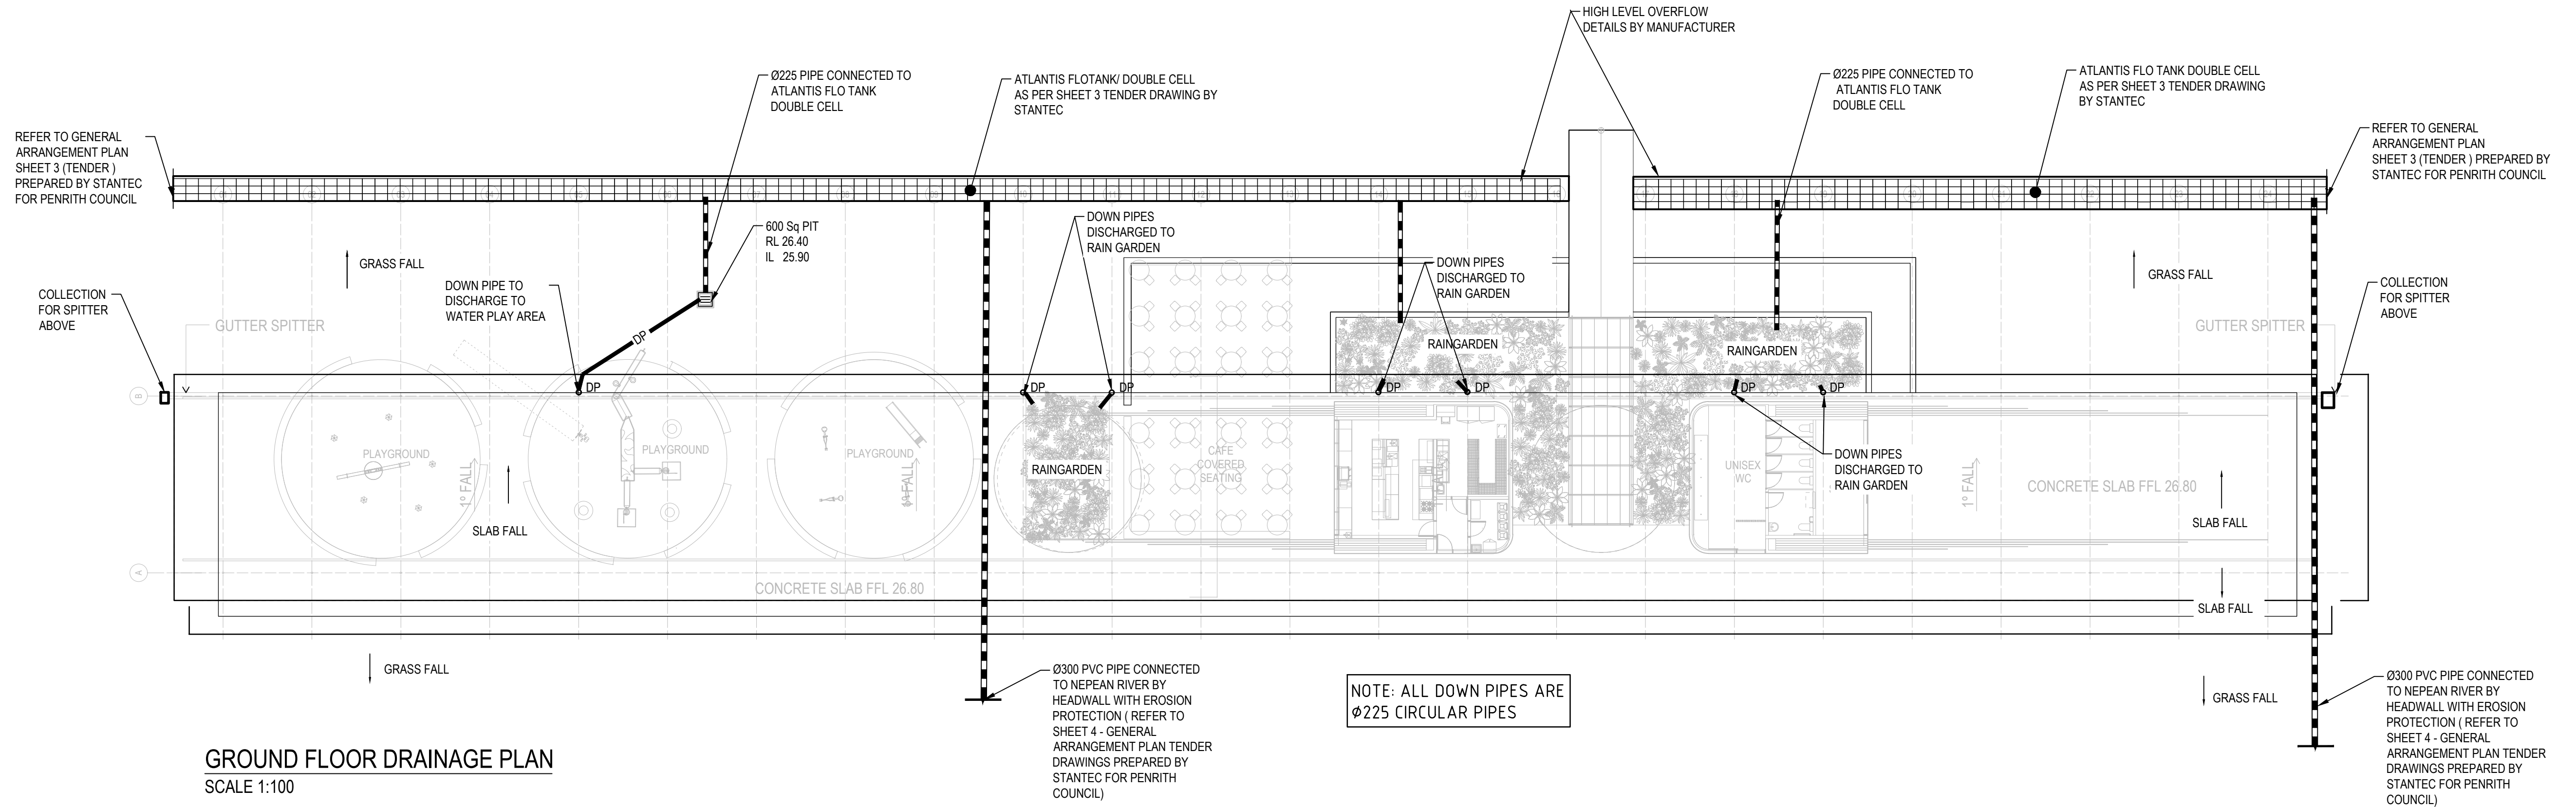

**GROUND FLOOR DRAINAGE PLAN**  
SCALE 1:100

Rev.	Date	Description	Des.	Verif.	Appd.
1	9/03/2021	PRELIMINARY ISSUE	K.P.	C.F.	



© Cardno Limited All Rights Reserved.  
This document is produced by Cardno Limited solely for the benefit of and use by the client in accordance with the terms of the retainer. Cardno Limited does not and shall not assume any responsibility or liability whatsoever to any third party arising out of any use or reliance by third party on the content of this document.

**Cardno**  
Cardno (NSW/ACT) Pty Ltd | ABN 95 001 145 035  
Level 9, The Forum, 203 Pacific Highway  
St Leonards, NSW 2005  
Tel: 02 9496 7700 Fax: 02 9439 5170  
Web: www.cardno.com.au

Drawn	K.P.	Date	MAR'2021
Checked	K.P.	Date	MAR'2021
Designed	K.P.	Date	MAR'2021
Verified	C.F.	Date	MAR'2021
Approved			

Client	BREAKSPEAR ARCHITECTS
Project	REGATTA PARK KIOSK
Title	EMU PLAINS STORMWATER DRAINAGE PLAN GROUND FLOOR AND ROOF PLAN

Status	<b>PRELIMINARY</b>		
NOT TO BE USED FOR CONSTRUCTION PURPOSES			
Datum	AHD	Scale	1:200
Size	A1	Revision	1
Drawing Number	80821190-CI-1001		