

**Report Type:**

DA Access Report

**Reference Number:**

21183

**Client:**

Fobupu Pty Ltd c/o PBD Architects

**Site Address:**

10-14 Lethbridge Street, Penrith, NSW



# ACCESS REPORT

Vista Access Architects

**Company Details**

Vista Access Architects Pty. Ltd  
ABN 82 124 411 614 ARN 6940  
ACAA 281, CP 006, LHA 10032

**Postal Address**

POBox 353  
Kingswood  
NSW 2747

**Contact details**

[www.accessarchitects.com.au](http://www.accessarchitects.com.au)  
[admin@accessarchitects.com.au](mailto:admin@accessarchitects.com.au)  
Farah Madon 0412 051 876

## Executive Summary and Design Certificate

This Access Compliance Report is to accompany a Development Application for the development proposed at 10-14 Lethbridge Street, Penrith, NSW.

This development proposes a New Building with a total of 36 Residential units. The development is within Penrith Council LGA that requires the provision of 10% Adaptable units and therefore the development proposes 4 Adaptable units. A total of 4 Accessible parking spaces has been provided in the development.

The project also provides 8 Livable units to comply with the SEPP 65 Objective 4Q1, that requires 20% of the units to incorporate the features of the Silver level of the Livable Housing Guidelines.

The development has building classification as detailed below;

- Class 2 (building containing more than 2 SOUs i.e. sole-occupancy units)
- Class 7a (car park)

This Access report is based on the relevant components of;

- Building Code of Australia (BCA) 2019, Volume 1- Performance requirements of DP1, DP2, DP8, DP9, EP3.4, FP2.1 and Parts D2, D3, E3 and F2 (where applicable)
- Disability (Access to Premises-Building) Standards 2010 (henceforth referred to as APS)
- AS1428.1-2009 Part 1: General requirements for access, including any amendments.
- AS1428.4.1-2009 Part 4.1: TGSIs (Tactile ground surface indicators), including any amendments.
- AS2890.6-2009 Part 6: Off-street parking for people with disabilities.
- AS4299-1995 Adaptable Housing
- AS1735 Lifts types included in the BCA including Part 12: Facilities for persons with disabilities.
- State Environmental Planning Policy 65 (SEPP 65), Objective 4Q1, relating to requirements of the provision of Livable Housing Australia's Silver Level Apartments
- Livable Housing Australia's Livable Housing Design Guidelines- Fourth Edition

The assessment of the proposed development has been undertaken to the extent necessary to issue DA (Development application) consent under the Environmental Planning and Assessment Act. The proposal achieves the spatial requirements to provide access for people with a disability and it is assumed that assessment of the detailed requirements such as assessment of internal fit-out, details of stairs, ramps and other features will occur at CC (Construction Certificate) stage.

By compliance with the recommendation in this report, the development complies with the requirements of Access Code of Disability (Access to Premises-Building) Standards 2010, the Disability Access relevant sections of Building Code of Australia 2019, the requirements of SEPP 65 related to Objective 4Q1 - Livable Housing and the essential criteria of AS4299-Adaptable Housing.

The information contained in this statement is true and accurate to the best of our knowledge. Our qualifications and accreditations are listed below.

Assessed by

Peer reviewed by

**Jenny Desai**

*Accredited Access Consultant and LHA Assessor  
ACAA Accredited Membership number 572  
Qualified- Certificate IV in Access Consulting LHA Assessor  
Licence number 20242*

**Farah Madon**

*Accredited Access Consultant and LHA Assessor  
ACAA Accredited Membership number 281  
Qualified- Diploma in Access Consulting  
LHA Assessor Licence number 10032*

**Vista Access Architects Pty. Ltd.**

Relevant dates:

Fee proposal, number FP-21277 dated 21-04-2021. Fee proposal was accepted by Client on 21-05-2021.

### Assessed Drawings:

The following drawings by PTI Architects have been assessed for compliance.

Drawing no	Issue	Date	Details
DA100	A	21-11-2021	Basement 2
DA101	A	21-11-2021	Basement 1
DA102	A	21-11-2021	Ground floor plan
DA103	A	21-11-2021	Level 1
DA104	A	21-11-2021	Level 2 - 3
DA105	A	21-11-2021	Levels 4 - 5
DA106	A	21-11-2021	Roof plan

## Document Issue:

Issue	Date	Details
Draft 1	26-05-2021	Issued for Architect's review
A	19-11-2021	Issued for DA

## Limitations and Copyright information:

*This report is based on discussions with the project architect and a review of drawings and other relevant documentation provided to us. No site visit was undertaken for the purposes of this project.*

*This assessment is based on the provided drawings and not based on constructed works, hence the assessment will provide assurance of compliance only if all the recommendations as listed in this report are complied with and constructed in accordance with the requirements of the current BCA, AS1428.1-2009 and other latest, relevant standards and regulations applicable at the time of construction.*

*Assessment is based on classification/use of the building. If the Class of the building changes to any other building Class, this access report will have to be updated accordingly.*

***Unless stated otherwise, all dimensions mentioned in the report are net (CLEAR) dimensions and are not be reduced by projecting skirting, kerbs, handrails, lights, fire safety equipment, door handles less than 900mm above FFL (finished floor level) or any other fixtures/fit out elements. When we check drawings, we assume that the dimensions noted are CLEAR dimensions and therefore the Architect / Builder shall allow for construction tolerances.***

*Only some numerical requirements from relevant AS (Australian Standards) have been noted in the report and for further details and for construction purposes refer to the latest relevant AS.*

***This report and all its contents including diagrams are a copyright of Vista Access Architects Pty Ltd (VAA) and can only be used for the purposes of this particular project. Copy- pasting diagrams from this report to Architectural plans will constitute copyright infringement.***

*This report does not assess compliance matters related to WHS, Structural design, Services design, Parts of DDA other than those related to APS or Parts of BCA or Parts of AS other than those directly referenced in this report. VAA gives no warranty or guarantee that this report is correct or complete and will not be liable for any loss arising from the use of this report. We will use our best judgement in regard to the LHA assessments. However, we are not to be held responsible if another licenced LHA assessor comes to a different conclusion about compliance, certification or allocation of a particular Quality mark to us as a number of items are subject to interpretation.*


*We have no ability to check for slip resistance of surfaces. All wet areas, parking areas, pavement markings shall have the appropriate slip resistance for the location. We also have no ability to check for wall reinforcements once the walls have already been constructed. The builder shall take full responsibility that the requirements listed in this report are met and the construction and slip resistance shall be as per requirements of AS1428.1/ AS4299 / AS2890.6/ AS3661/ AS4586 and any other applicable regulation and Australian Standard.*

# Compliance assessment with Access related requirements of BCA and Disability (Access to Premises-Building) Standards 2010 (APS)


	BCA Part D3 Access for People with a Disability
	BCA D3.1 General building Access requirements SOU refers to a Sole Occupancy Unit
<b>Requirement</b>	<b>Class 2</b> - building containing more than 2 SOUs i.e. sole-occupancy units For residential use components, access is required: <ul style="list-style-type: none"> <li>- From a required accessible pedestrian entrance to at least 1 floor with SOUs and till the entry of door of each SOU on that level.</li> <li>- To and within 1 of each type of room or space in common use.</li> <li>- Where floor is accessed by an AS1428.1 ramp or lift, access is required to the entry doorway of each SOU on that level and to and within all common use areas on that level.</li> </ul>
<b>Compliance Comments</b>	Complies <ul style="list-style-type: none"> <li>- Access has been provided from the main pedestrian entry doorway to the entry doors of all SOUs on all levels by means of accessible pathways and lifts.</li> <li>- Access has been provided to at least 1 of each common use space such as communal garden on Ground floor level, Roof top level and on individual floors</li> <li>- Where common use areas are on a floor that is accessible by means of a ramp or lift (Ground floor level, Roof Level and on individual floors in this case), access has been provided to the same.</li> <li>- Access has been provided to common use garbage chutes on each floor level.</li> </ul> Details to be verified at CC stage of works.
<b>Requirement</b>	<b>Class 7a</b> - Covered car park. <ul style="list-style-type: none"> <li>- To and within any level containing accessible carparking spaces.</li> </ul>
<b>Compliance Comments</b>	Complies Access has been provided to all Basement levels containing Accessible carparking spaces. Details to be verified at CC stage of works.
	BCA Part D3.2 Access to buildings
<b>Requirement</b>	<b>Accessway is required from;</b> <ul style="list-style-type: none"> <li>- Main pedestrian entry at the site boundary for new buildings.</li> <li>- Any other accessible building connected by a pedestrian link.</li> <li>- Accessible car parking spaces.</li> </ul>
<b>Compliance Comments</b>	Complies <ul style="list-style-type: none"> <li>- Access by means of BCA compliant platform lift has been provided from the main pedestrian entry at the site boundary.</li> <li>- Access has been provided from accessible car parking spaces by means of lifts.</li> </ul> Details to be verified at CC stage of works.
<b>Requirement</b>	<b>External Walkway / Pedestrian Access-</b> to be as per requirements of AS1428-2009.
<b>Compliance Comments</b>	Complies with spatial requirements. Details to be verified at CC stage of works.




<b>Requirement</b>	<b>Accessway</b> is required through: <ul style="list-style-type: none"> <li>- Principal pedestrian entry; and</li> <li>- Not less than 50% of all pedestrian entrances; and</li> <li>- In building with floor area over 500m<sup>2</sup>, a non-accessible entry must not be located more than 50M from an accessible entry.</li> </ul>
<b>Compliance Comments</b>	Complies The building has only 1 pedestrian entry, which has been designed to be accessible. Details to be verified at CC stage of works.
<b>Requirement</b>	<b>All common use doorways and doorways to and within Accessible and Adaptable units</b> to comply with AS1428.1. Where accessible pedestrian entry has Multiple doorways: <ul style="list-style-type: none"> <li>- At least 1 to be accessible if 3 provided</li> <li>- At least 50% to be accessible, if more than 3 provided</li> <li>- Where doorway has multiple leaves, at least 1 leaf is to have clear opening of 850mm (excluding automatic doors)</li> </ul>
<b>Compliance Comments</b>	Complies with spatial requirements. In common use areas, all single hinged doors and in case of multiple leaf doorways, at least 1 operable leaf is required to provide a clear opening of 850mm with the door circulations spaces as per AS1428.1-2009.  Note that the circulation spaces to have a maximum floor grade of 1:40 (doorway threshold ramps are permitted within the circulation space).  Sliding doorways to be provided with recessed floor tracks to enable flush transition from the inside of the building.  Where there is an external level difference at the door threshold, the maximum level difference can be 35mm if provided with a 1:8 doorway threshold ramp.  Details to be verified at CC stage of works.

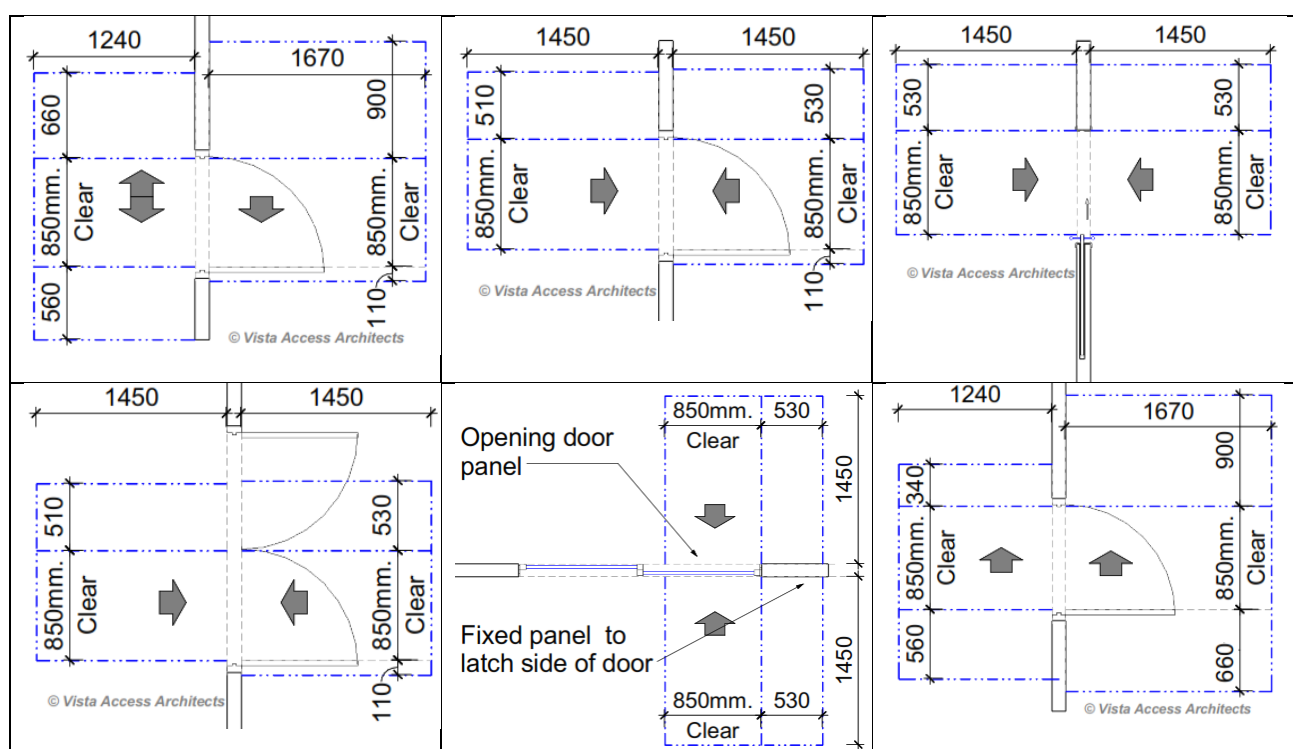

[Image description: Different types of doorways with door circulation requirements as per AS1428.1]

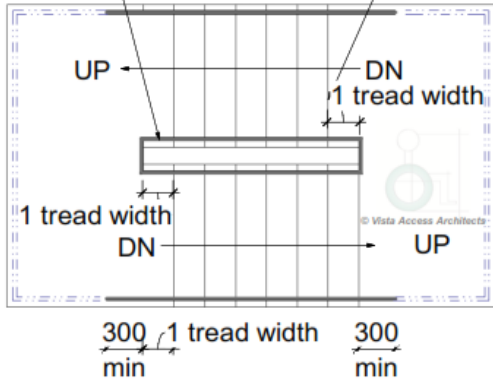
	BCA Part D3.3 Parts of buildings required to be accessible
<b>Requirement</b>	<p>Every <b>Ramp</b> with grades steeper than 1:20 and less than or equal to 1:14 (excluding fire-isolated ramp) is to be compliant with Clause 10 of AS1428.1:</p> <ul style="list-style-type: none"> <li>- AS1428.1-2009 (including but not limited to - maximum grade of 1:14 with appropriate landings at a maximum of 9M of a flight of ramp).</li> <li>- 1M clear width to be provided between handrails / kerb / kerbrails.</li> <li>- Handrails and kerbs to be provided on both sides with appropriate handrails extensions.</li> <li>- Slip resistance of ramp and landings to comply with BCA Table D2.14</li> </ul>
<b>Compliance Comments</b>	<p>N/A</p> <p>No 1:14 ramps have been identified in the development.</p>
<b>Requirement</b>	<p><b>Step ramp</b> if provided is to be compliant with:</p> <ul style="list-style-type: none"> <li>- AS1428.1-2009 including max grade of 1:10, max height of 190mm, max length of 1.9M</li> <li>- Slip resistance of ramp and landings to comply with BCA Table D2.14.</li> <li>- A landing for a step ramp must not overlap a landing for another step ramp or ramp</li> </ul>
<b>Compliance Comments</b>	<p>N/A</p> <p>No step ramps have been identified in the development.</p>
<b>Requirement</b>	<p><b>Kerb ramp</b> if provided is to be compliant with:</p> <ul style="list-style-type: none"> <li>- AS1428.1-2009 including max grade of 1:8, max height of 190mm, max length of 1.52M</li> <li>- Slip resistance of ramp and landings to comply with BCA Table D2.14.</li> </ul>
<b>Compliance Comments</b>	<p>N/A</p> <p>No kerb ramps have been identified in the development.</p>
<b>Requirement</b>	<p>Every <b>Stairway</b> (excluding fire-isolated stairway) is to be compliant with:</p> <ul style="list-style-type: none"> <li>- Clause 11 of AS1428.1-2009 (including but not limited to opaque risers, handrails on both sides including appropriate handrail extensions between 1M clear width and compliant nosing strips).</li> <li>- Slip resistance to comply with BCA Table D2.14 when tested in accordance with AS4586.</li> </ul>
<b>Compliance Comments</b>	<p>Complies with spatial requirements</p> <p>Where non-fire-isolated stairways have been provided, the features of the stairway will be assessed with the requirements of AS1428.1-2009 at the CC stage of works.</p> <div style="display: flex; align-items: flex-start;"> <div style="flex: 1;"> <p>Option A- extend handrail by 1 tread at midlanding</p> <p>Option B- offset first riser going up at at midlanding</p>  </div> <div style="flex: 1; padding-left: 20px;"> <p><b>Note:</b> In some cases, the stairway from the basement to the ground floor level is considered to be non-fire-isolated, in which case full compliance will be required as per AS1428.1-2009. Verify with the BCA consultant.</p> </div> </div>

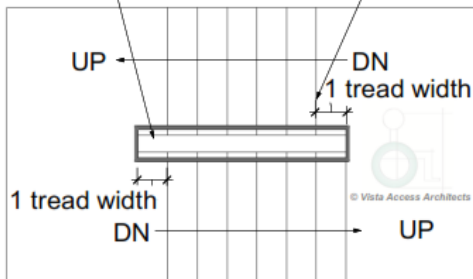Requirement	Every <b>Fire-isolated Stairway</b> is to be compliant with AS1428.1-2009 in the following aspects: <ul style="list-style-type: none"><li>- Handrail on one side (requirement under D2.17) with 1M clear space. Handrail extensions are not required however since the handrails cannot have any vertical sections and since handrail is required to be at a consistent height throughout the stairway including at landings, it may be essential to either provide handrail extensions or offset first riser going up at mid landings to achieve this at 90° to 180° turns.</li><li>- Slip resistance to comply with BCA Table D2.14 when tested in accordance with AS4586.</li></ul>																		
Compliance Comments	<div>Complies with spatial requirements</div> <div>Detailed features of the fire-isolated stairways will be assessed with the requirements of AS1428.1 at the CC stage of works.</div> <div><div><div>Option A- extend handrail by 1 tread at midlanding</div><div>Option B- offset first riser going up at midlanding</div></div><div></div></div> <div><div><b>Note:</b> For stairways with 90° to 180° turns at landings, in order for the handrails to comply with the consistent height requirement, the risers have to be offset at the mid-landings OR provided with a 300mm handrail extension, so that no vertical sections are created in the handrails. This applies to both non- fire-isolated and fire-isolated stairways.</div><div>[Image description: Diagram shows the requirements of a fire-isolated stairway as per AS1428.1]</div></div>																		
Requirement	<b>Nosing strips to both fire-isolated and non-fire-isolated stairways</b> <ul style="list-style-type: none"><li>- Each tread to have a nosing strip between 50mm-75mm depth (of any one colour) for the full width of the stair, which can be setback for a maximum of 15mm from the front of the nosing.</li><li>- Multiple strips making up the 50mm-75mm depth is NOT permitted.</li><li>- This strip is to have a minimum luminance contrast of 30% to the background and to comply with any change in level requirements if attached on the treads.</li><li>- Where the nosing strip is not set back from the front of the nosing then any area of luminance contrast shall not extend down the riser more than 10mm</li><li>- Slip resistance to comply with BCA Table D2.14 when tested in accordance with AS4586.</li></ul>																		
Compliance Comments	<div>Capable of compliance.</div> <div>Detailed features of the nosing strips will be assessed with the requirements of AS1428.1 at the CC stage of works.</div>																		
Requirement	<b>Handrail cross-sectional profile</b> – for stairways and ramps to comply with AS1428.1 <ul style="list-style-type: none"><li>- Diameter of handrails to be between 30mm-50mm and located not less than 50mm from adjacent walls with no obstructions to top 270° arc.</li></ul>																		
Compliance Comments	<div>Capable of compliance.</div> <div>Detailed features of the handrails will be assessed with the requirements of AS1428.1 at the CC stage of works.</div>																		
Requirement	<b>Slip resistance requirements as per BCA</b> BCA Table D2.14 has the following Slip –resistance requirements when tested in accordance with AS4586: <table><tr><th rowspan="2">Application</th><th colspan="2">Surface conditions</th></tr><tr><th>Dry</th><th>Wet</th></tr><tr><td>Ramp steeper than 1:14</td><td>P4 or R11</td><td>P5 or R12</td></tr><tr><td>Ramp steeper than 1:20 but not steeper than 1:14</td><td>P3 or R10</td><td>P4 or R11</td></tr><tr><td>Tread or landing surface</td><td>P3 or R10</td><td>P4 or R11</td></tr><tr><td>Nosing or landing edge strip</td><td>P3</td><td>P4</td></tr></table>		Application	Surface conditions		Dry	Wet	Ramp steeper than 1:14	P4 or R11	P5 or R12	Ramp steeper than 1:20 but not steeper than 1:14	P3 or R10	P4 or R11	Tread or landing surface	P3 or R10	P4 or R11	Nosing or landing edge strip	P3	P4
Application	Surface conditions																		
	Dry	Wet																	
Ramp steeper than 1:14	P4 or R11	P5 or R12																	
Ramp steeper than 1:20 but not steeper than 1:14	P3 or R10	P4 or R11																	
Tread or landing surface	P3 or R10	P4 or R11																	
Nosing or landing edge strip	P3	P4																	



	<p><b>Slip resistance requirements as per AS4299</b></p> <p>AS4299 has slip resistance requirements based on requirements of AS3661 (Slip resistance of pedestrian surfaces) for the following areas:</p> <ul style="list-style-type: none"> <li>- Floor surfaces in sanitary facilities including all toilets and bathrooms (essential feature).</li> <li>- Floor surfaces in the kitchens and Laundries (essential feature).</li> <li>- Pathways / walkways within the site, within landscaped areas, balconies and other external paved areas (desirable feature for Class A or B developments).</li> <li>- AS3661.1-1993 is an old Australian standard which has been superseded with AS4586:2013 (Slip resistance classification of new pedestrian surface materials).</li> </ul> <p><b>HB 197/ HB198</b> An introductory guide to the slip resistance of pedestrian surface materials provides guidelines for the selection of slip-resistant pedestrian surfaces</p>
<b>Compliance Comments</b>	<p>Capable of compliance.</p> <p>For Slip resistance of surfaces the builder is required to provide a Certificate stating that the Slip resistance of the surfaces comply with the above listed requirements when tested as per AS4586. Details to be provided at the CC stage of works.</p>
<b>Requirement</b>	Every <b>Passenger lift</b> is to comply with the requirements of BCA E3.6.
<b>Compliance Comments</b>	<p>This has been assessed further in the report in the Lifts section.</p> <p>Refer to Lifts section.</p>
<b>Requirement</b>	<p><b>Passing spaces requirement</b></p> <p>It is a requirement to provide passing spaces in accessways complying with AS1428.1 at maximum 20 M intervals, where a direct line of sight is not available. Space required is 1800x2800mm (in the direction of travel). Chamfer of 400x400mm is permitted at corners.</p>
<b>Compliance Comments</b>	<p>N/A</p> <p>There are no accessways over 20M lengths in the development where a direct line of sight is not available.</p>
<b>Requirement</b>	<p><b>Turning spaces requirement</b></p> <p>It is a requirement to provide turning spaces in accessways complying with AS1428.1-2009 within 2M of the end of accessways where it is not possible to continue travelling and at every 20M intervals. CLEAR Space required is 1540mmx2070mm in the direction of travel (measured from skirting to skirting).</p>
<b>Compliance Comments</b>	<p>Complies</p> <ul style="list-style-type: none"> <li>- Adequate turning spaces have been provided with minimum common use passageway widths being 1540mm clear or alternatively a space of 1540mmx2070mm provided at or within 2M of the end of the passageway.</li> <li>- A space of 1540mmx2070mm is also required / provided in front of all passenger lift doors.</li> </ul> <p>Details to be verified at CC stage of works.</p>
<b>Requirement</b>	<p><b>Carpet specifications</b></p> <p>Carpet if used in areas required to be accessible are to be provided with pile height or thickness not more than 11mm and carpet backing not more than 4mm bringing the total height to a maximum of 15mm.</p>
<b>Compliance Comments</b>	<p>N/A</p> <p>Use of carpets have not been identified in the common use areas.</p>

	<b>BCA Part D3.4 Exemption</b>
<b>Requirement</b>	<p><b>Access is not required to be provided in the following areas:</b></p> <ul style="list-style-type: none"> <li>- Where access would be inappropriate because of the use of the area</li> <li>- Where area would pose a health and safety risk</li> <li>- Any path which exclusively provides access to an exempted area</li> </ul>
<b>Compliance Comments</b>	<p>For information only.</p> <p>Areas such as lift machine rooms, fire services room, commercial kitchens etc. in the development are exempted from providing access under this clause due to WHS concerns.</p> <p>Where a caretaker is provided in the development, the toilet provided exclusively for use by the caretaker can be excluded from providing access based on the provisions in this clause.</p>
	<b>BCA Part D3.5 Accessible Carparking</b>
<b>Requirement</b>	<p><b>Class 2</b></p> <p>There are no Accessible carparking requirements for a Class 2 under the BCA.</p> <p>If adaptable housing has been mandated by the Council, then carparking spaces for Adaptable units will be required under the requirements of AS4299- Adaptable housing.</p>
<b>Compliance Comments</b>	<p>Complies</p> <p>Penrith Council requires provision of 10% Adaptable units in the development.</p> <p>Development has total number of 36 units. 10% of 36 = 4 required Adaptable units.</p> <p>Therefore, 4 accessible carparking spaces are required for the residential component of the development.</p> <p>4 Accessible car parking spaces have been provided in development.</p> <p>One accessible/ parking space is required to be allocated to each of the Adaptable units.</p>

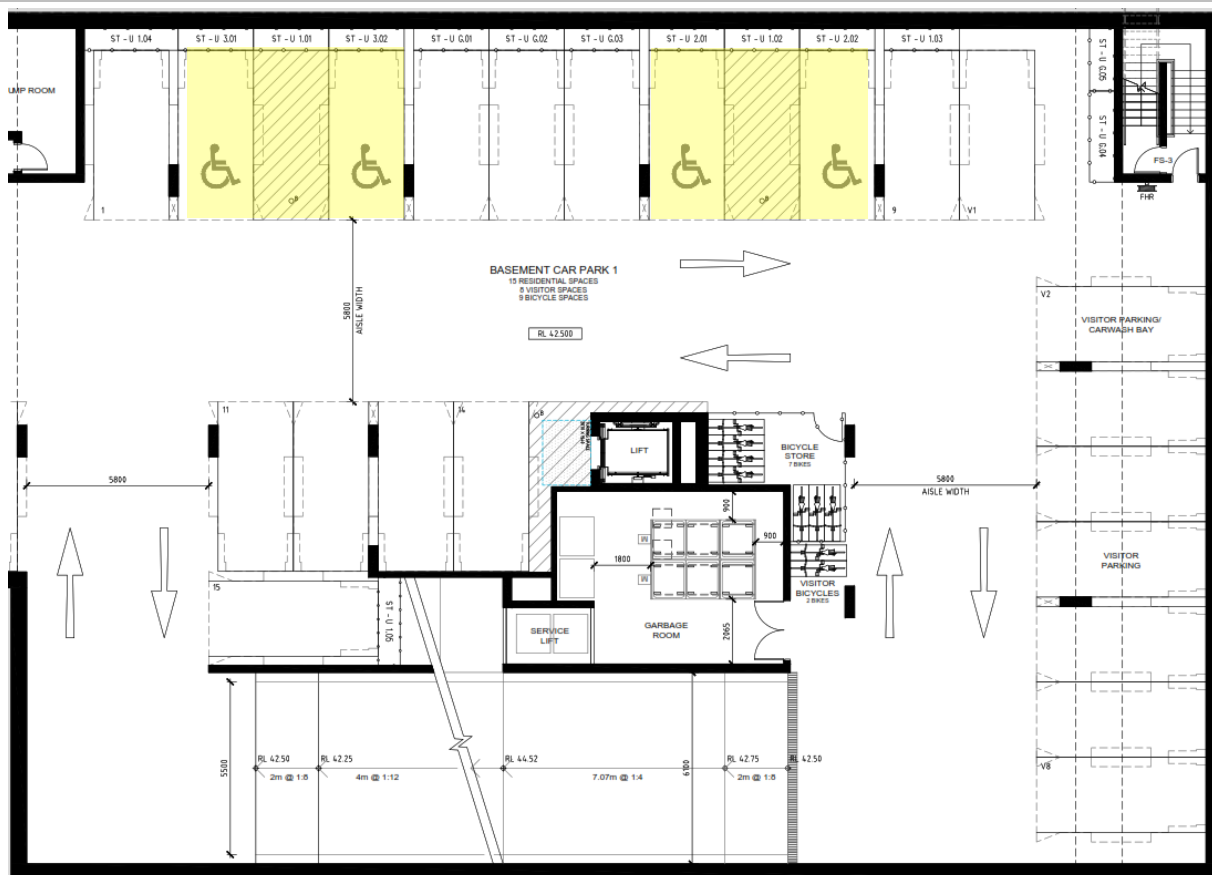

[Image description: Plan of Basement above shows the provision of Accessible parking spaces]


## AS2890.6-2009 requirements for Accessible car parking space

### Requirement


- Dedicated space 2.4Mx5.4M, Shared space 2.4Mx5.4M at the same level
- Slip resistant flooring surface with maximum fall 1:40 in any direction or maximum 1:33 if bituminous and outdoors.
- Central Bollard in shared space at 800+/-50mm from entry point.
- Pavement marking in dedicated space by means of access symbol between 800mm-1000mm high placed on a blue rectangle of maximum 1200mm and between 500mm-600mm from its entry point (marking not required where allocated to an Adaptable unit).
- Minimum headroom of 2.2M at entrances and 2.5M is required over shared space as well as dedicated spaces.
- Non-trafficked area of the shared space to have marking strips at 45°, 150-200mm wide at 200mm-300mm spaces (not required where driveways are used as shared spaces)

### Compliance Comments

Complies with spatial requirements.  
Details to be verified at the CC stage of works.  
Refer to diagrams below for requirements, especially in regard to head height requirements.  
**Note:** The pavement marking shall have the appropriate slip resistance for the location. This requirement is to be added to the project specifications to ensure compliance.

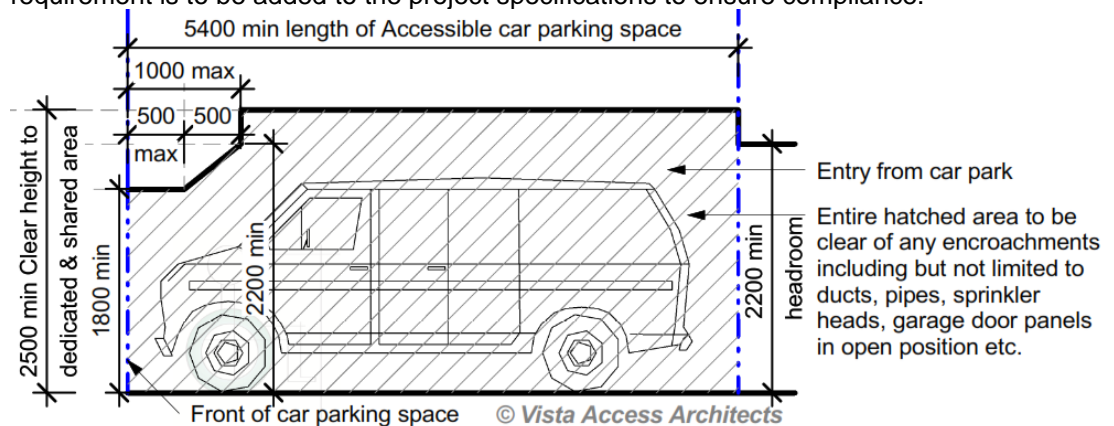



[Image description: Diagram shows head height requirements as per AS2890.6 for both dedicated accessible parking space and the shared space. No beams, pipes, sprinklers or any other encroachments are permissible within the required clear head height space ]

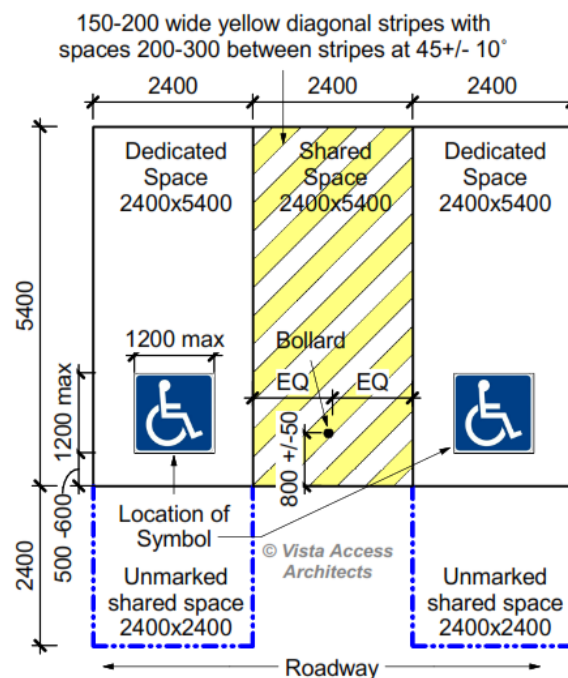

[Image description: Diagram shows spatial requirements of AS2890.6 including line marking, symbol and bollard requirements ]

**Access symbol is not to be provided when spaces are allocated to Adaptable or Platinum level units.**

	BCA Part D3.6 Signage
<b>Requirement</b>	<p><b>Braille and Tactile signage is required to identify Accessible Sanitary facilities</b></p> <div>  <p>Unisex Toilet RH</p> </div> <p>Signage must incorporate the international symbol of access in accordance with AS 1428.1 and identify each sanitary facility, except a sanitary facility associated with a bedroom in a Class 1b building or a SOU unit in a Class 3 or Class 9c building. Signage in accordance with AS 1428.1 must be provided for accessible unisex sanitary facilities to identify if the facility is suitable for left or right handed use.</p> <p>[Image description: Image of Signage]</p>
<b>Compliance Comments</b>	<p>Capable of compliance.</p> <p>Signage selections generally take place at CC stage of works. Selection and location of signage as specified above will lead to compliance.</p> <p>Details of selected signage to be verified at CC stage of works.</p>
<b>Requirement</b>	<b>Braille and Tactile signage is required to identify Ambulant Sanitary facilities</b>
<b>Compliance Comments</b>	<p>N/A</p> <p>No common use, ambulant sanitary facilities have been provided in the development.</p>
<b>Requirement</b>	<b>Braille and Tactile signage is required to identify Hearing Augmentation</b>
<b>Compliance Comments</b>	<p>N/A</p> <p>Hearing augmentation is not provided since there is no inbuilt amplification system proposed in the development.</p>
<b>Requirement</b>	<div>  <p>Exit Level ?</p> </div> <p><b>Braille and Tactile signage is required to identify a Fire exit door</b> required by E4.5 by stating the 'Exit' and 'Level', followed by either:</p> <ul style="list-style-type: none"> <li>- The floor level number or floor level descriptor or a combination of both of the above.</li> <li>- Sign must be located on the side that faces a person seeking egress</li> </ul> <p>The "?" shown in image above is to be replaced with the floor level where the door is located.</p> <p>[Image description: Image of Signage]</p>
<b>Compliance Comments</b>	<p>Capable of compliance.</p> <p>All doors nominated as Exit doors require signage as described above.</p> <p>Signage selections generally take place at CC stage of works. Selection of signage as specified above will lead to compliance.</p> <p>Details of selected signage to be verified at CC stage of works.</p>
<b>Requirement</b>	<b>Signage is required to a non-accessible pedestrian entrance</b>
<b>Compliance Comments</b>	<p>N/A</p> <p>The development has only 1 entry which has been designed to be accessible.</p>
<b>Requirement</b>	<b>Signage is required where a bank of sanitary facilities is not provided with an accessible unisex sanitary facility.</b>
<b>Compliance Comments</b>	N/A
<b>Requirement</b>	<p><b>All signage is required to be as per Specification D3.6 Braille and Tactile Signs</b></p> <p>This includes location of signage, specifications in regards to braille and tactile characters, luminance contrast and lighting.</p>
<b>Compliance Comments</b>	<p>Capable of compliance.</p> <p>Signage selections generally take place at CC stage of works. Selection of signage as specified above will lead to compliance.</p> <p>Details of selected signage to be verified at CC stage of works.</p>


	<b>BCA Part D3.7 Hearing Augmentation</b>
<b>Requirement</b>	<b>Hearing Augmentation</b> is only required where an inbuilt amplification system (other than emergency) is installed in a Class 9b building, or in an auditorium, conference / meeting room or a reception area where a screen is used.
<b>Compliance Comments</b>	N/A No areas with provision of inbuilt amplification have been identified on plans and hence no hearing augmentation requirements apply to this development.
	<b>BCA Part D3.8 Tactile indicators (TGSIs)</b>
<b>Requirement</b>	<b>TGSIs are required when approaching:</b> <ul style="list-style-type: none"> <li>- Stairways other than fire-isolated stairways.</li> <li>- Escalators / passenger conveyor / moving walk.</li> <li>- Ramp (other than fire-isolated ramps / kerb or step or swimming pool ramps).</li> <li>- Under an overhead obstruction of &lt;2M if no barrier is provided.</li> <li>- When accessway meets a vehicular way adjacent to a pedestrian entry (if no kerb / kerb ramp provided at the location).</li> </ul> Compliance is required with AS1428.4.1 including Luminance contrast and slip resistance requirements for all TGSIs.
<b>Compliance Comments</b>	Capable of compliance. TGSIs selections generally take place at CC stage of works. Selection of TGSIs as specified will lead to compliance and these selection details are to be verified at CC stage of works.
	<b>BCA Part D3.11 Limitations on Ramps</b>
<b>Requirement</b>	<b>On an accessway:</b> <ul style="list-style-type: none"> <li>- A series of connected ramps must not have a combined vertical rise of more than 3.6M;</li> <li>- And a landing for a step ramp must not overlap a landing for another step ramp or ramp.</li> </ul>
<b>Compliance Comments</b>	N/A No ramps have been identified in the development.
	<b>BCA Part D3.12 Glazing on Accessways</b>
<b>Requirement</b>	<b>Glazing requirements:</b> <ul style="list-style-type: none"> <li>- Where there is no chair rail, handrail or transom, all frameless or fully glazed doors, sidelights and any glazing capable of being mistaken for a doorway or opening are required to have a glazing strip</li> <li>- The marking should be for the full width with a solid and non-transparent 75mm wide, contrasting line located 900-1000mm above FFL and provide a minimum luminance contrast of 30% when viewed against the floor surface within 2M of the glazing on the opposite end. Graphical representation or cut-outs are not permitted.</li> </ul>
<b>Compliance Comments</b>	Capable of compliance Glazing strips are required to be provided to full length glazed areas (doors and windows) used in common use areas such as lift lobbies and common passageways. Glazing strip selections generally take place at CC stage of works. Selection of glazing strips as specified above will lead to compliance and these selection details are to be verified at CC stage of works.



## BCA Part F Accessible Sanitary Facilities

### BCA F2.4 Accessible sanitary facilities

<b>Requirement</b>	<b>Accessible unisex toilet</b> is to be provided in accessible part of building such that; <ul style="list-style-type: none"> <li>- It can be entered without crossing an area reserved for 1 sex only</li> <li>- Where male and female sanitary facilities are provided at different locations, Accessible unisex toilet is only required at one of the locations</li> <li>- Even distribution of LH and RH facilities</li> <li>- An accessible facility is not required on a level with no lift / ramp access.</li> </ul>
<b>Compliance Comments</b>	Complies 1 unisex accessible RH transfer toilet has been provided in the development on Roof top level.
<b>BCA F2.4(a) Accessible unisex sanitary compartments</b>	
<b>Requirement</b>	<b>Class 2</b> At least 1 unisex Accessible toilet when sanitary compartments are provided in common areas.
<b>Compliance Comments</b>	Complies 1 unisex RH transfer accessible toilet has been provided in the common use areas.
<b>BCA F2.4(b) Requirements for Accessible unisex showers</b>	
<b>Requirement</b>	<b>Class 2</b> At least 1 unisex Accessible shower when showers are provided in common areas.
<b>Compliance Comments</b>	N/A No common use shower facilities have been identified in the development.
<b>Requirement</b>	<b>Accessible unisex toilet is to be designed in accordance with AS1428.1-2009</b>
<b>Compliance Comments</b>	Complies with spatial requirements. Detailed features of the Accessible unisex toilet will be assessed with the requirements of AS1428.1-2009 at the CC stage of works.

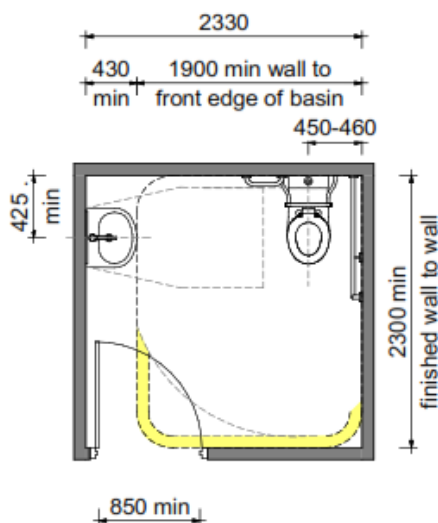

Mirror image of the above applies.

[Image description: Circulation requirements for typical accessible toilets as per AS1428.1. Mirror images of the above may apply. Note that location of the door is indicative only]

<b>Requirement</b>	<b>Showers for Accessible use are to be designed in accordance with AS1428.1.</b>
<b>Compliance Comments</b>	N/A No accessible shower facilities have been identified in the development.
<b>Requirement</b>	<b>Ambulant use male / female toilets</b> are to be provided if an additional toilet to the Accessible unisex toilet is provided
<b>Compliance Comments</b>	N/A. No common ambulant use facilities have been provided in the development.
	<b>BCA Part E Lift Installations</b>
	BCA E3.2 Stretcher facility in lifts
<b>Requirement</b>	A <b>Stretcher lift</b> is to be provided if a passenger lift is installed to serve any storey with an effective height of 12M. The space requirement is 600mm wide x 2000mm deep x 1400mm high above the floor level. Confirm this requirement with your BCA consultant.
<b>Comments</b>	For information only. Contact BCA consultant / PCA in regard to applicable requirements.
	BCA E3.6 Passenger lift
<b>Requirement</b>	In an accessible building, <b>Every Passenger Lift</b> (excluding electric passenger lift, electrohydraulic passenger lift, inclined lift) must be subject to limitations on use and must comply with <b>Tables E3.6a and E3.6b</b>
<b>Compliance Comments</b>	Capable of compliance. A certificate of compliance from the lift supplier will be required at the CC stage of works stating that the proposed lift complies with the requirements of BCA Part E3- Lift installations.
	BCA E3.6 Table E3.6a Limitations on use of types of passenger lifts
<b>Requirement</b>	<b>Limitations on use of Low-rise platform lift</b> - Must not travel more than 1M  <b>Limitations on use of Low-rise, low-speed constant pressure lift</b> - If enclosed, must not travel more than 4M - If unenclosed, must not travel more than 2M - Must not be used in high traffic public use areas in buildings such as theatres, cinema, auditorium, transport interchange, shopping complex, etc.  <b>Limitations on use of small sized, low-speed automatic lift</b> - Must not travel more than 12M
<b>Compliance Comments</b>	Capable of compliance. A wheelchair stairway platform lift has been provided on Ground floor level. A certificate of compliance from the lift supplier will be required at the CC stage of works stating that the proposed lift complies with the requirements of BCA Part E3- Lift installations.

	BCA E3.6 Table E3.6b -Application of features to passenger lifts
<b>Requirement</b>	<b>Handrail requirements for passenger lifts.</b> Apart from stairway platform lift and low-rise lifts, a handrail is required as per AS1735.12.
<b>Compliance Comments</b>	Capable of compliance. Details to be verified at CC stage of works.
<b>Requirement</b>	<b>Lift floor dimensions</b> (excluding stairway platform lift) <ul style="list-style-type: none"> <li>- Lifts traveling <b>12M</b> or under, floor size, <b>1100mm wide x 1400mm deep</b></li> <li>- Lifts travelling <b>more than 12M</b>, floor size <b>1400mm wide x 1600mm deep</b></li> </ul>
<b>Compliance Comments</b>	Capable of compliance Details to be verified at CC stage of works. Additional lift car size may apply if stretcher lift is required under the BCA.
<b>Requirement</b>	Minimum <b>Door opening size</b> complying with AS1735.12, not less than 900mm clear (excluding stairway platform lift).
<b>Compliance Comments</b>	Capable of compliance Details to be verified at CC stage of works.
<b>Requirement</b>	All lifts with a power operated door are required to have a <b>Passenger protection system</b> complying with AS1735.12.
<b>Compliance Comments</b>	Capable of compliance Details to be verified at CC stage of works.
<b>Requirement</b>	<b>Lift landing doors</b> to be provided at upper landing (excluding stairway platform lift).
<b>Compliance Comments</b>	Capable of compliance Details to be verified at CC stage of works.
<b>Requirement</b>	<b>Lift car and landing control buttons</b> to comply with AS1735.12 (excluding stairway platform lift and low-rise platform lift).
<b>Compliance Comments</b>	Capable of compliance Details to be verified at CC stage of works.
<b>Requirement</b>	<b>Lighting</b> (for all enclosed lift cars) to be provided in accordance with AS1735.12 and AS1680. Minimum illuminance of 100 lx is required at the level of the car floor and average of 50 lx is required on the control panel surface.
<b>Compliance Comments</b>	Capable of compliance Details to be verified at CC stage of works.
<b>Requirement</b>	<b>To all lifts serving more than 2 levels</b> , audible and visual indication to be provided as per AS1735.12.
<b>Compliance Comments</b>	Capable of compliance. Details to be verified at CC stage of works.
<b>Requirement</b>	<b>Emergency hands free communication</b> (excluding stairway platform lift) – provide a button that alerts a call centre and a light that the call has been received.
<b>Compliance Comments</b>	Capable of compliance Details to be verified at CC stage of works.

## Additional Features required as per AS1428

Refer to AS1428 for full list of requirements.

	<p><b>The following accessibility requirements apply only to:</b></p> <ul style="list-style-type: none"> <li>- Common use areas within the residential component (including passageways leading to SOUs)</li> </ul>
<b>Requirement</b>	<b>Accessway width requirements.</b> All Accessway widths are to be a minimum of 1M clear (measured from skirting to skirting) with vertical clearance of at least 2M
<b>Compliance Comments</b>	Complies. Details to be verified at CC stage of works.
<b>Requirement</b>	<p><b>Doorway requirements</b></p> <ul style="list-style-type: none"> <li>- All common use doorways in the development to be in accordance with AS1428.1</li> <li>- Door thresholds are to be level or they can incorporate a doorway threshold ramp as per AS1428.1 i.e. max 1:8 grade, max height of 35mm and located within 20mm of door leaf.</li> <li>- Distance between successive doorways in airlocks to be 1450mm which is measured when the door is in open position in case of swinging doors.</li> </ul>
<b>Compliance Comments</b>	Capable of compliance. Details to be verified at CC stage of works.
<b>Requirement</b>	<b>Door hardware</b> including door handles, door closers and the in-use indicators / snibs in accessible and ambulant toilets are required to comply with requirements of AS1428.1.
<b>Compliance Comments</b>	Capable of compliance. Door hardware selections generally take place at CC stage of works. Selection of door hardware as specified above will lead to compliance and these selection details are to be verified at CC stage of works.
<b>Requirement</b>	<p><b>Luminance contrast requirements for doorways.</b></p> <p>All doorways to have a minimum luminance contrast of 30% provided as per AS1428.1 with the minimum width of the luminance contrast to be 50mm.</p>
<b>Compliance Comments</b>	Capable of compliance. Check the selected colours for walls / doors/ door frames by checking the LRV / Luminance contrast on <a href="http://www.accessarchitects.com.au/luminance-contrast-calculator">http://www.accessarchitects.com.au/luminance-contrast-calculator</a> Details to be verified at CC stage of works.
<b>Requirement</b>	<p><b>Floor or ground surfaces</b></p> <ul style="list-style-type: none"> <li>- Use slip-resistant surfaces. The texture of the surface is to be traversable by people who use a wheelchair and those with an ambulant or sensory disability.</li> <li>- Abutment of surfaces is to have a smooth transition. Construction tolerances to be as per AS1428.1</li> <li>- Grates if used in the accessible path of travel is required to comply with the requirements as per AS1428.1</li> </ul>
<b>Compliance Comments</b>	Capable of compliance. Floor surface selections generally take place at CC stage of works. Selection of floor surfaces as specified above will lead to compliance and these selection details are to be verified at CC
	<p><b>Switches, Controls and Lighting requirements</b></p> <p>All switches and controls (including controls for intercom facilities and external lift control buttons) on an accessible path of travel, Accessible SOUs and Accessible sanitary facilities to be located as per requirements of AS1428.1</p>
<b>Compliance Comments</b>	Capable of compliance. Lighting fixture selections and locations generally take place at CC stage of works. Selection of lighting fixtures and locating them as specified above will lead to compliance. These selection/location details are to be verified at CC stage of works.

## AS4299.1995- Adaptable Housing

Appendix A of AS4299 schedule is a list of features to be incorporated into a housing unit for it to be termed an 'Adaptable House'.

**There are 3 Classification levels for Adaptable Housing**

**Adaptable Class C** in which all essential features are to be incorporated.

**Adaptable Class B** in which all Class C and 50% of 64 available desirable features are to be incorporated

**Adaptable Class A** in which all 119 essential and all desirable features are to be incorporated.

4 Adaptable units are required by the Council's DCP to a Class C level.

The units designated as adaptable are unit numbers 2.01, 2.02, 3.01 and 3.02

At DA stage there is insufficient information to certify compliance with the Standard, however, in accordance with the table below, the nominated units can comply with the spatial requirements of AS4299 for Adaptable Housing.

**Pre-adaptation layout**

**Post-adaptation layout**

By incorporating the essential requirements listed Checklist below in the Specifications, the nominated Adaptable units can achieve full compliance with Adaptable House Class C




## AS4299.1995 - Class C – Essential requirements.

R☑ = Required;

C☑ = Capable of compliance at **by adding the requirement to the project specifications** or in some cases capable of compliance at post adaptation stage (where noted in comments).

Requirements as per AS4299	R	C	Comments
<b>Drawings</b>			
Provision of drawings showing the housing unit in its pre-adaptation and post-adaptation stages	☑	☑	
<b>Siting</b>			
An AS1428.1 compliant, continuous accessible path of travel is required from street frontage and vehicle parking to entry doorway of the Adaptable unit.	☑	☑	Complies. Access is provided from street by means of an AS1428.1 compliant pathway, lifts and from accessible parking space by means of a lift. Details to be verified at the CC stage
<b>Letter boxes</b>			
Letterboxes to be on hard standing area connected to accessible pathway	☑	☑	Capable of compliance. Details to be verified at the CC stage
<b>Parking</b>			
Car parking space or garage of minimum 6.0Mx 3.8M or a hard surfaced level outside of 5.4Mx3.8M is to be provided as a sheltered car park or can be provided in the future	☑	☑	Complies. Space can also be provided as per AS2890.6 Details to be verified at the CC stage
<b>Accessible Entry</b>			
Door circulation requirements of AS1428.1 with approach directions shown with arrows below. Accessible entry to be provided with, <ul style="list-style-type: none"> <li>- An accessible door threshold</li> <li>- 1550mm diameter landing</li> <li>- 850mm clear opening door with clearances, door hardware operable with one hand and located 900-1100mm above floor</li> </ul>	☑	☑	Capable of compliance. Refer to door circulation requirements noted earlier in the report. Details to be verified at the CC stage
<b>Interior: General</b>			
<ul style="list-style-type: none"> <li>- Internal doors to have 820mm minimum clearance with provision for compliance with AS1428.1 for door approaches and minimum corridors width of 1M</li> <li>- Door hardware operable with one hand and located 900-1100mm above floor</li> </ul>	☑	☑	Capable of compliance. Provide an 850mm clear opening door to the adaptable bathroom and 1 main bedroom. Rest to have 820mm clear opening. Details to be verified at the CC stage
<b>Living room and dining room</b>			
Circulation space of minimum 2250mm diameter.	☑	☑	Complies.
<b>Kitchen</b>			
It is general industry practice to accept that kitchen is something that has a very short life span and can be completely replaced when required to be adapted. As such only the following requirements apply, <u>Potential of achieving the following at Post- Adaptation:</u> <ul style="list-style-type: none"> <li>- Minimum width 2.7M and 1550mm clear between benches</li> <li>- Provision for circulation at doors to comply with AS1428.1 (if doors provided)</li> <li>- Provision for benches, taps, cooktops, ovens as required under AS4299</li> </ul>	☑	☑	Can be compliant post adaptation. Details to be verified at the CC stage

## Main bedroom

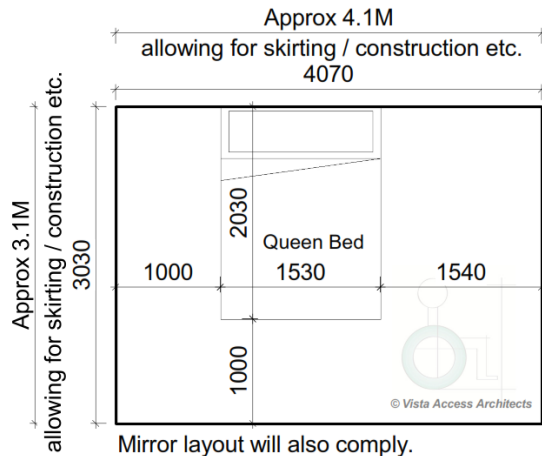


[Image description: Diagram showing circulation spaces around a queen bed as per AS4299]

At least one bedroom of area sufficient to accommodate a queen size bed and wardrobe and circulation space requirements of AS1428.2



Complies. **TBC**  
Details to be verified at the CC stage

## Main Adaptable bathroom

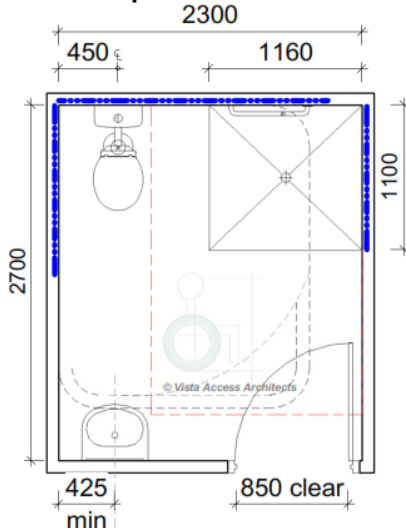



[Image description: Diagram shows Post Adaptation bathroom layout and location of wall reinforcements in pre-adaptation locations with reference to post adaptation layout. Location of door is indicative only]

*Noted dimensions in these diagrams are approximate and depend on selected features such as size of the basin. These dimensions include allowances for reinforcements and normal construction tolerances. Thick blue line indicates the location of wall reinforcements which are to be provided at pre-adaptation itself. Red dotted line indicates the shower circulation space. Black dotted line indicates the WC pan circulation space.*

- Provision for bathroom area with Circulation spaces of Shower and WC (including fixtures) to comply with AS1428.1.
- Note that wall reinforcements and waterproofing details to comply with AS4299



Complies.  
A bathroom with minimum space of 2.3Mx2.7M is achievable.  
Wall reinforcement details to be verified at the CC stage.

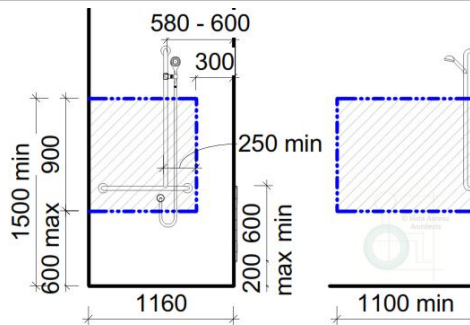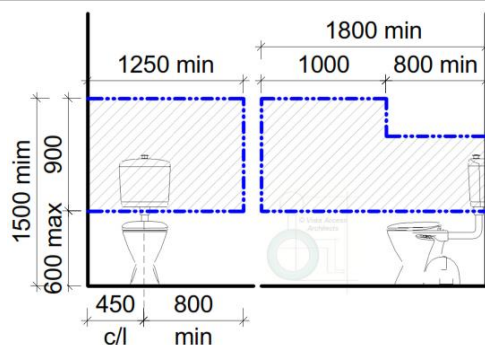

*Note: Shower seats are not required to be provided in Adaptable units.*

[Image description: Diagram showing min 12mm thick wall reinforcement requirements for the Adaptable unit for WC and Shower, in post adaptive position]

<b>Laundry</b>			
<ul style="list-style-type: none"> <li>- Provision for adequate circulation space in front of or besides appliances (minimum 1550mm depth)</li> <li>- Circulation at doors to comply with AS1428.1</li> <li>- Provision for automatic washing machine</li> </ul>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	Capable of compliance. Details to be verified at the CC stage
<b>Other General requirements</b>			
<ul style="list-style-type: none"> <li>- All surfaces to be Slip resistant to AS3661 and AS 4586</li> <li>- All GPOs and Lighting/ lux requirements as per AS4299</li> <li>- All waterproofing as per AS4730</li> </ul>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	Capable of compliance. Details to be verified at the CC stage

<b>Requirement</b>	<ul style="list-style-type: none"> <li>- Where the location of fixtures such as WC pans, wash basins, sinks, laundry fixtures and any other fixtures are to be relocated post-adaptation to comply with AS1428.1, then the service pipes (waste and water supply pipes) have to be laid in the correct AS1428.1 specified position at pre-adaptation itself and the services to be capped off for future use.</li> </ul>
<b>General recommendations</b> (Advisory only / not mandatory)	<ul style="list-style-type: none"> <li>- It is recommended that where balconies / outdoor areas have been provided to Adaptable units, provide the sliding doors such that the floor tracks are recessed, so level access can be provided to the balcony / outdoor areas from inside the unit.</li> <li>- Sliding doors in the living areas leading to outdoor areas are to be such that opening of the door is able to provide a clear opening space of 850mm with a latch side space of 530mm.</li> <li>- If the balcony is to be brought up to the same level as the unit at post-adaptation by means of decking etc. then ensure that the minimum handrail height requirements required under the BCA are complied with, considering the raised height of the balcony.</li> <li>- Consideration to be given to recess the slab to the wet areas so that there is no level difference once the floor finishes are applied (i.e. flush transition from carpeted area to tiles area).</li> </ul>

---

## SEPP 65 – Part 4Q1

Compliance assessment with Objective 4Q1 that requires 20% of the units to incorporate the features of the **Livable Housing Guidelines Silver level**.

Total number of residential units in the development = 20% of 36 = 7.2 = **8** required Livable units.

The following 8 units **4.01, 4.02, 4.03, 4.04, 5.01, 5.02, 5.03 and 5.04** are capable of providing compliance with the features of Silver level of Livable Housing Guidelines as noted in the table below.

**Units 4.01 and 5.01 shown below**

---

**Units 4 03 and 5 03 shown below**


- Note that ALL internal passageways are required to be 1M clear when measured from skirting to skirting so allow for the same.
- Note that the wet areas are to be such that flush transition is available. One way of achieving this is to recess the floor slab.



By incorporating the requirements of the below Checklist in the Specifications of the project, the nominated Livable units can achieve full compliance with Livable Housing Guidelines- Silver Level


Design Element	Requirements (All dimensions noted are required to be clear of finishes as required under AS1428.1)	Compliance / Comments
<b>1</b> <b>Dwelling Access</b>	(a) Provide a safe and continuous 1M clear width pathway from front site boundary to an entry door to the dwelling. (b) Path including any ramps and walkways to have no steps, even firm, slip-resistant surface, max 1:40 crossfall, max slope of 1:14 with landings of 1.2M every 9M and landings every 15M for 1:20 walkways. 1.2M clear width of ramps are required.	Complies. Verify at CC
	(c) Pathway may be provided via an associated car parking in which case the car parking space to be - 3200 (width) x5400 (length), - even, firm and slip resistant, level surface of 1:40 max grade and 1:33 max grade for bitumen	N/A Access is provided from the site boundary.
	(d) Step ramp may be provided at an entrance doorway. The step ramp to be max 190mm height, max 1:10 grade, max 1900mm length.	N/A
	(e) Level landings of 1200mm are required exclusive of the swing of the door or gate and to be provided at the head and foot of the ramp.	N/A
<b>2</b> <b>Dwelling entry</b>	(a) Dwelling Entry should provide an entrance door with (i) min <b>clear</b> opening width of door to be 820mm (ii) Step free threshold of max 5mm with rounded or beveled lip (iii) reasonable shelter from the weather	Complies Verify at CC
	(b) Level landing of 1200x1200mm at step-free entrance door on the arrival / external side of the entrance door.	Complies Verify at CC
	(c) Max permissible threshold is less than 56mm where provided with a 1:8 grade threshold ramp.	N/A
	(d) Entrance to be connected to a pathway (specified under Element 1) Note: The entrance to incorporate waterproofing and termite management requirements as specified in the NCC	Complies Verify at CC
<b>3</b> <b>Internal doors and corridors</b>	(a) Doors to rooms on the entry level used for living, dining, bedroom, bathroom, kitchen, laundry and sanitary compartments to be (i) 820mm clear opening and (ii) provided with a level threshold of max 5mm between abutting surfaces with rounded or beveled lip	Complies Verify at CC
	(b) Internal corridors and passageways to doorway to be min 1M clear (measured from skirting to skirting)	Complies Verify at CC
<b>4</b> <b>Toilet</b>	(a) One Toilet to be provided on the ground or entry level that provides, (i) Min 900mm between walls or amenities (ii) Min 1200mm clear space in forward of the WC pan exclusive of door swing. (iii) The toilet pan to be positioned in the corner of a room to enable handrails	Complies Verify at CC
<b>5</b> <b>Shower</b>	(a) One bathroom should feature a slip resistant, hobless shower recess. Shower screens are permitted provided they can be easily removed at a later date. (b) The shower recess should be located in the corner of the room to enable the installation of grabrails at a future date.	Complies Verify at CC
	For hobless specification please see Australian Standard AS3740-3.6. Reinforcement guidelines for walls in bathrooms and toilets are found in	

	element 6	
<b>6</b> <b>Reinforcement of bathroom &amp; toilet walls</b>	(a) Except for walls constructed of solid masonry or concrete, the walls around the shower, bath (if provided) and toilet should be reinforced to provide a fixing surface for the safe installation of grabrails.	Capable of compliance. Verify at CC
	(b), (c) and (d) the walls around toilet, bath and shower to be via: (i) Noggins with a thickness of at least 25mm (ii) Sheeting with a thickness of at least 12mm Refer to diagrams provided in the Livable Housing Guideline document.	Capable of compliance. Verify at CC

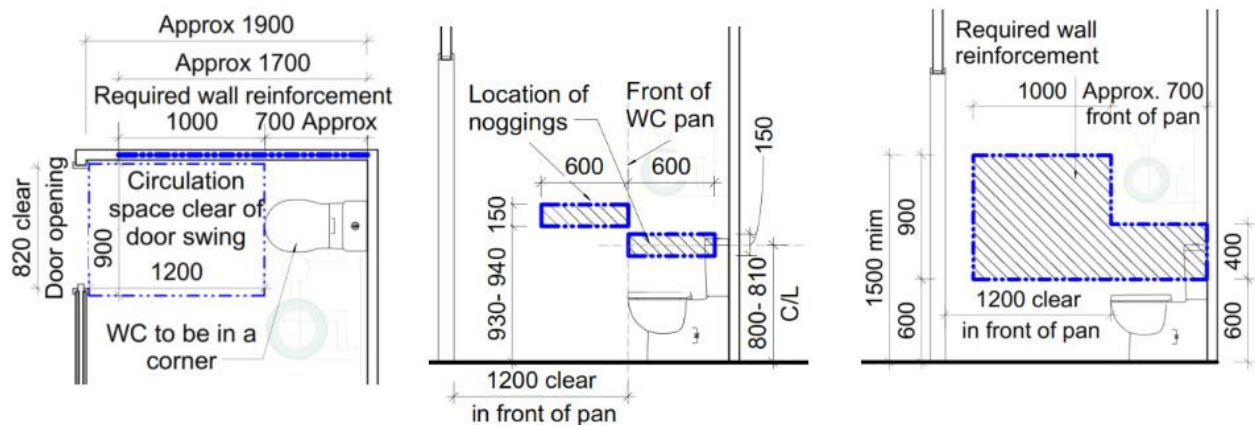


[Image description: Diagram shows wall reinforcements options of noggings or sheeting for a toilet]

**Note:** In a standalone toilet, the wall reinforcements are required to both sides. Any door openings/ door frames are required to be clear of the required wall reinforcements. If wall with cavity slider is used for wall reinforcements, then allow for additional thickness for the wall.

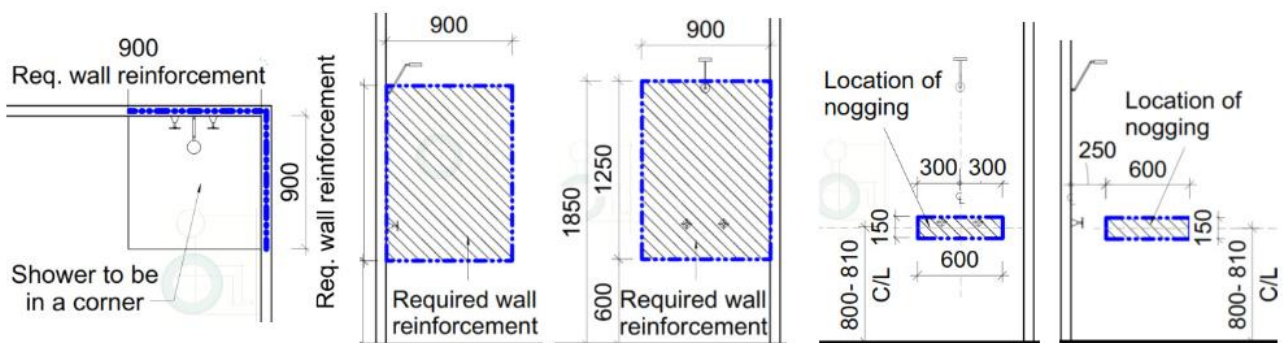

[Image description: Diagram shows wall reinforcements options of noggings or sheeting for a shower]

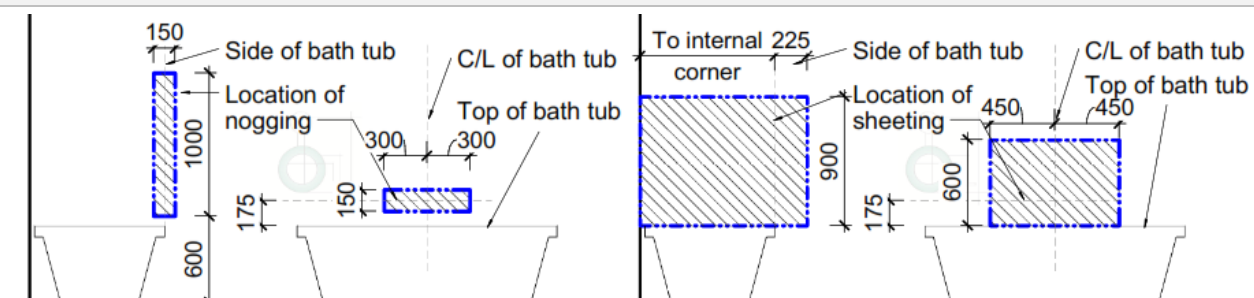

[Image description: Diagram shows wall reinforcements options of noggings or sheeting for a bathtub]

## 7

### Internal Stairways

Stairways in dwellings must feature:

- a continuous handrail on one side of the stairway where there is a rise of more than 1m. a minimum clear width of 1000mm

N/A  
No internal stairway in units.

## Disability Discrimination Act

### Advisory Only

The Federal Disability Discrimination Act 1992 (DDA) provides protection for everyone in Australia against discrimination based on disability. Section 32 of the DDA focuses on the provision of equitable and dignified access to services and facilities for people with mobility, sensory and cognitive disabilities.

Disability discrimination happens when people with a disability and their relatives, friends, carers, co-workers or associates are treated less fairly than people without a disability.

Compliance with Access to Premises Standards give certainty to building certifiers, building developers and building managers that, if access to (new parts) of buildings is provided in accordance with these Standards, the provision of that access, to the extent covered by these Standards, will not be unlawful under the DDA. This however applies only to the new building or new parts of an existing building and its affected part. All areas outside the scope of these areas are still subject to the DDA. We cannot guarantee or certify for DDA compliance because DDA compliance can only be assessed by the Courts.

Scope of DDA extends beyond the building fabric and also includes furniture and fittings.

Some recommendations to address common furniture and fittings have been listed below. Non-provision of the below recommendations may not affect compliance under the BCA but may leave the building owner vulnerable to a claim under the DDA.

For new common use kitchens / BBQ areas in residential common use areas / commercial use areas, it is suggested that this kitchen could be made partially accessible by providing a width of 900mm next to the sink as vacant space (without cabinetry under the bench top) and a long lever tap with spout and handle within 300mm from the front of the benchtop. The distance in between the benches to be 1550mm. 1 double GPO to be provided within 300mm from the edge of the benchtop. This would allow a person in a wheelchair to independently move within the kitchen and use basic facility, being the sink independently.

# Statement of Experience

Vista Access Architects specialises in access consultancy services, including, Access requirements and Access Performance Solutions under the NCC, NDIS SDA Certifications, Livable Housing Certifications and Changing Places Certifications.



## Farah Madon - Director

**ACAA Accredited Access Consultant**  
**NDIS Accredited SDA Assessor**  
**Livable Housing Assessor**  
**Changing Places Assessor**

- Accredited member of the Association of Consultants in Access Australia (ACAA) - Member 281
- NDIS Accredited SDA (Specialist Disability Accommodation) Assessor SDA00001
- Architect registered with the NSW Architect's Registration Board - Registration 6940
- Member of Australian Institute of Architects (RAIA), A+ Practice Member 49397
- Registered Assessor of Livable Housing Australia - Registration 10032
- Global Alliance on Accessible Technologies and Environments (GAATES) - Member BE-02-021-20
- Registered Assessor of Changing Places Australia - Registration CP006

### Farah's Educational Profile and Qualifications Include:

- Bachelor of Architecture Degree with Honours (B.Arch.)
- International Certification of Accessibility Consultants – Built Environment (ICAC-BE) Program, Level 2 Advanced Accessibility Consultant
- Diploma of Access Consulting
- Standards Australia's course on 'Writing Australian Standards'

Farah has 20 years of experience of working in the field of Architecture and Access.

Farah is the lead author of the NDIS SDA Design Standard. She has been invited on multiple occasions as an expert witness for Access related matters in the NSW Land and Environment Court.

### Farah currently participates on the following key committees concerning access for people with disabilities, on an honorary basis:

- Member of Standards Australia's ME-064 Committee responsible for the AS4299 and AS1428 suite of standards.
- Vice President of Association of Consultants in Access Australia (ACAA)
- Community Representative Member of the Penrith City Council's Access Committee
- Member of Australian Institute of Architect's National Access Work Group (NAWG)
- Management Committee member of NSW Network of Access Consultants
- Livable Housing Australia's Industry Reference Group (IRG) Member
- Member of Changing Places Australia Technical Advisory Team

### Some Recent Awards presented to Farah Include:

- 2019 Penrith Citizen of the Year
- 2019 Access Inclusion Award
- 2019 Australian Access Awards Finalist for Educational App of the Year- LRV App to calculate luminance contrast







## Vanessa Griffin

**ACAA Accredited Access Consultant**  
**NDIS Accredited SDA Assessor**  
**Livable Housing Assessor**  
**Changing Places Assessor**

- Accredited member of the Association of Consultants in Access Australia (ACAA) - Member 500
- NDIS Accredited SDA (Specialist Disability Accommodation) Assessor SDA00009
- Registered Assessor of Livable Housing Australia - Registration 20035
- Registered Assessor of Changing Places Australia Registration CP010

### Vanessa's Educational Profile and Qualifications include:

- Diploma of Surveying and Diploma of Health and Building Surveying, Sydney Institute of Technology
- Certificate IV in Access Consulting



## Jenny Desai

**ACAA Accredited Access Consultant**  
**NDIS Accredited SDA Assessor**  
**Livable Housing Assessor**

- Accredited member of the Association of Consultants in Access Australia (ACAA) - Member 572
- NDIS Accredited SDA (Specialist Disability Accommodation) Assessor SDA00043
- Registered Assessor of Livable Housing Australia - Registration 20242

### Jenny's Educational Profile and Qualifications include:

- Master of Design (M.Des) from University of Technology, Sydney
- Certificate IV in Access Consulting



## Art Phonsawat

**ACAA Associate Access Consultant**

- Associate member of the Association of Consultants in Access Australia (ACAA) - Member 695

### Art's Educational Profile and Qualifications include:

- Advanced Diploma in Interior design, Sydney
- Certificate IV in Access Consulting

